

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



1775 Expressway Drive North
Hauppauge, NY 11788
631.584.5492
Fax: 631.584.3395
www.jcbroderick.com

December 19, 2022

Mr. Miguel Cruz
Brentwood Union Free School District
Anthony Felicio Administration Building
52 Third Avenue
Brentwood, New York 11717

Re: **Lead Testing in School Drinking Water
2020 Compliance 10 NYCRR Subpart 67-4**

JCB#: **19-45270**

Dear Mr. Cruz:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document, and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 15 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead Testing Results for Applicable Outlets

Attachment 2: Laboratory Analytical Reports

Attachment 3: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.


Sincerely,

A handwritten signature in cursive script, appearing to read 'Meghan Gwynn', is written in black ink.

Meghan Gwynn
J C Broderick & Associates, Inc.

Attachment 1:

Lead Testing Results
for Applicable Outlets

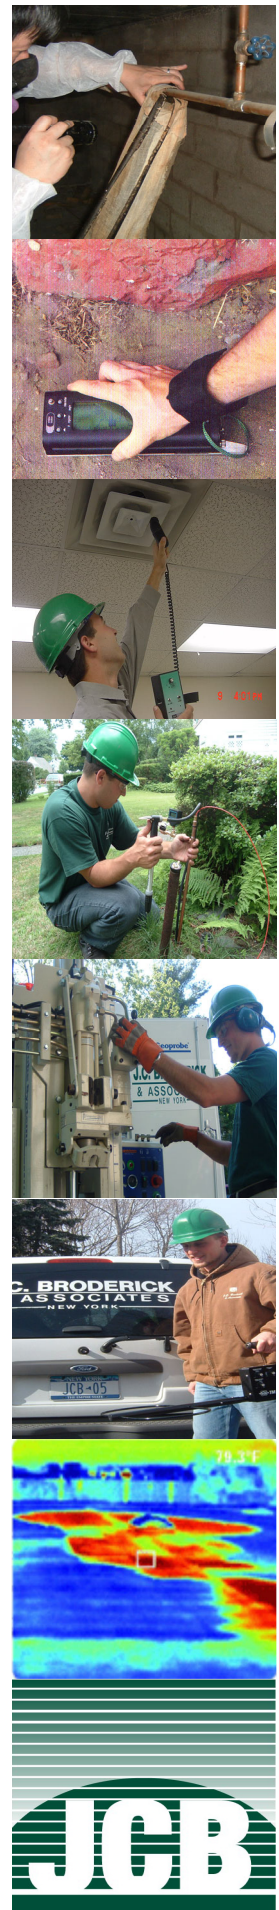

J.C. Broderick & Associates, Inc.


Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Brentwood Union Free School District

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
Anthony Felicio Administration Building							
BRTWD-2904	1013	Corridor Near IT Room (1006C)	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2905	1005	Men's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2906	1005	Men's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2908	1004	Faculty Room	Classroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2909	1002D1	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-2910	1039	Corridor Near Women's Bathroom (1017)	Water Fountain-No Chiller	Potable	12/11/2020	46	Removed From Service, Pending Remediation
BRTWD-2911	1017	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2912	1017	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2914	1032	Men's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2915	1032	Men's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-2916	1033	Corridor Near Men's Bathroom (1032)	Water Cooler	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M; Removed and Replaced by Outlets 3006/3007
BRTWD-2918	1030	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2919	1030	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2920	2005	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-2921	2005	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2923	2011	Corridor Near Custodial Closet (2007)	Water Cooler	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2924	2008	Men's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2925	2008	Men's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	7.3	Result Below Action Level, Continue O&M
BRTWD-2926	2009D1	Health Benefits Suite Kitchen Area Office	Classroom Faucet	Non-Potable	12/11/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2927	2009D1	Health Benefits Suite Kitchen Area Office	Bottled Water Dispenser	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2929	3002M	Main Office Suite Kitchen	Water Cooler	Potable	12/11/2020	25	Outlet Permanently Removed
BRTWD-2930	3002M	Main Office Suite Kitchen	Classroom Faucet	Non-Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2931	3002J	Women's Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	4.8	Result Below Action Level, Continue O&M
BRTWD-2932	3002J	Women's Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	13	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2933	3002J	Women's Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	11	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2934	3002I	Men's Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	8.0	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2935	1026	Performing Arts Room	Bottled Water Dispenser	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2936	1007C	Maureen Belanger Board Room Kitchen	Classroom Faucet	Non-Potable	12/11/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2995	1004	East Wing Conference Room Bathroom	Bathroom Faucet	Non-Potable	12/11/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-2996	1036	Human Resources Department	Bottled Water Dispenser	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2997	1040	Transportation/Security Office	Bottled Water Dispenser	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2998	3002M	Main Office Suite Kitchen	Bottled Water Dispenser	Potable	12/11/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3006	1033	West Corridor	Water Cooler	Potable	5/25/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3007	1033	West Corridor	Bottle Fill Station	Potable	5/25/2022	<3.0 ND	Result Below Action Level, Continue O&M

Brentwood Ross High School

BRTWD-0353	1001	Industrial Arts Room - Auto Shop	Hand Wash Only	Non-Potable	12/4/2020	2	Result Below Action Level, Continue O&M
BRTWD-0354	1001	Industrial Arts Room - Auto Shop	Hand Wash Only	Non-Potable	12/4/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-0355	1001	Industrial Arts Room - Auto Shop	Hand Wash Only	Non-Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0356	1002	Room 1170	Classroom Faucet	Non-Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0357	1025	Corridor Near Shop Storage Room (1004)	Water Fountain-No Chiller	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0358	1006	Room 1165	Classroom Faucet	Non-Potable	12/4/2020	20	Replaced by Outlet 3000
BRTWD-0359	1006	Room 1165	Classroom Faucet	Non-Potable	12/4/2020	6.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0369	1017	Room 1160	Hand Wash Only	Non-Potable	12/4/2020	7.2	Result Below Action Level, Continue O&M
BRTWD-0370	1025	Corridor Near Room 1157 (1018)	Water Fountain-No Chiller	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0403	N/A	Music Hallway	Water Cooler	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0404	N/A	Music Hallway	Water Cooler	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0405	N/A	Band Room	Classroom Faucet	Non-Potable	12/4/2020	5.5	Result Below Action Level, Continue O&M
BRTWD-0406	N/A	Orchestra Room	Classroom Faucet	Non-Potable	12/4/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-0414	1064	Corridor Near Room 1103 (1060)	Water Fountain-No Chiller	Potable	12/4/2020	9.8	Result Below Action Level, Continue O&M
BRTWD-0415	1064	Corridor Near Room 1110 (1057)	Water Fountain-No Chiller	Potable	12/4/2020	12	Result Below Action Level, Continue O&M
BRTWD-0449	N/A	Corridor Near Room 1117	Water Cooler	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0450	N/A	Corridor Near Room 1117	Water Cooler	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0517	1088	Custodial Closet	Ice Machine	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0519	1087A	Team Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0520	1086	Corridor to Locker Room	Water Cooler	Potable	12/5/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0521	1086	Corridor to Locker Room	Water Cooler	Potable	12/5/2020	12	Result Below Action Level, Continue O&M
BRTWD-0522	1084A	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	7.8	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0523	1084A	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-0525	1081A1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-0526	1081A1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0527	1081A	Girls Locker Room	Water Fountain-No Chiller	Potable	12/5/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-0528	1099	Corridor Across from Gymnasium	Water Cooler	Potable	12/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0529	1099	Corridor Across from Gymnasium	Bottle Fill Station	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0531	1076A	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-0532	1075	Cafeteria	Water Cooler	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0533	1070	Women's Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0534	1070	Women's Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0535	1070	Women's Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0536	1071	Men's Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0537	1071	Men's Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-0538	1073	Main Office	Bottled Water Dispenser	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0539	1099	Corridor Near Nurse's Office	Water Fountain-No Chiller	Potable	12/5/2020	37	Removed From Service, Pending Remediation

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0540	1066B	Health Office Suite Nurse's Office	Nurse's Office Sink	Potable	12/5/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-0541	1066B1	Health Office Suite Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0542	1037	Corridor Near Room 1125 (1033)	Water Fountain-No Chiller	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0547	N/A	Faculty Bathroom Near Faculty Room	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0548	N/A	Faculty Bathroom Near Faculty Room	Bathroom Faucet	Non-Potable	12/5/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0549	N/A	Faculty Bathroom Near Faculty Room	Bathroom Faucet	Non-Potable	12/5/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-0550	1031	Corridor Near Room 1142 (1029)	Water Fountain-No Chiller	Potable	12/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0574	N/A	Corridor Near Girls Bathroom	Water Cooler	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0575	N/A	Corridor Near Girls Bathroom	Water Cooler	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0581	1044	Room 1128 Faculty Lounge	Classroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0582	1049	Corridor Near Faculty Lounge	Water Fountain-No Chiller	Potable	12/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0587	1074	Kitchen	Hand Wash Only	Non-Potable	12/4/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-0588	1074	Kitchen	Kitchen Faucet (Cold)	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0589	1074	Kitchen	Spray Nozzle	Non-Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0590	1074	Kitchen	Pasta Pot/Steam Kettle	Potable	12/4/2020	11	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0591	1074	Kitchen	Hand Wash Only	Non-Potable	12/4/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-0592	1074	Kitchen	Kitchen Faucet (Cold)	Potable	12/4/2020	6.7	Result Below Action Level, Continue O&M
BRTWD-0593	N/A	Kitchen	Hand Wash Only	Non-Potable	12/4/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-0594	N/A	Kitchen	Hand Wash Only	Non-Potable	12/4/2020	OOS	Testing Required Before Return to Service
BRTWD-0595	N/A	Kitchen Women's Bathroom	Bathroom Faucet	Non-Potable	12/4/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-0596	N/A	Kitchen Bathroom	Bathroom Faucet	Non-Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0598	1074	Kitchen	Hand Wash Only	Non-Potable	12/4/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0599	1074	Kitchen	Kitchen Faucet (Cold)	Potable	12/4/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-0600	1074	Kitchen	Spray Nozzle	Non-Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0601	1074	Kitchen	Kitchen Faucet (Cold)	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0602	1074	Kitchen	Kitchen Faucet (Cold)	Potable	12/4/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-0604	N/A	Pool Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	5.5	Result Below Action Level, Continue O&M
BRTWD-0605	N/A	Pool	Water Cooler	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0607	N/A	Pool Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-0610	2005	Girls Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	11	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0611	2005	Girls Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	1	Result Below Action Level, Continue O&M
BRTWD-0612	2005	Girls Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0613	2005	Girls Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-0614	2005	Girls Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	13	Result Below Action Level, Continue O&M
BRTWD-0616	2008	Boys Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-0617	2008	Boys Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-0618	2008	Boys Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0679	N/A	Faculty Bathroom	Bathroom Faucet	Non-Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0685	N/A	Vestibule Near Storage Room	Water Cooler	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0686	N/A	Vestibule Near Storage Room	Water Cooler	Potable	12/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2990	N/A	Corridor Outside Library	Water Cooler	Potable	12/4/2020	OOS	Testing Required Before Return to Service
BRTWD-2991	N/A	Corridor Near Stairwell	Bottle Fill Station	Potable	12/4/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3000	1006	Room 1165	Classroom Faucet	Non-Potable	6/16/2021	17	Placarded for Non-Drinking Use, Pending Remediation

Brentwood Sonderling High School

BRTWD-0001	1031	Kitchen	Kitchen Faucet (Cold)	Potable	11/3/2020	8.3	Result Below Action Level, Continue O&M
------------	------	---------	-----------------------	---------	-----------	-----	---

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0002	1031	Kitchen	Kitchen Faucet (Cold)	Potable	5/5/2021	1.3	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-0003	1031	Kitchen	Hand Wash Only	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0004	1031	Kitchen	Pasta Pot/Steam Kettle	Potable	11/3/2020	9.4	Result Below Action Level, Continue O&M
BRTWD-0005	1031	Kitchen	Kitchen Faucet (Cold)	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0006	1031	Kitchen	Spray Nozzle	Non-Potable	11/3/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-0007	1031	Kitchen	Kitchen Faucet (Cold)	Potable	11/3/2020	5.6	Result Below Action Level, Continue O&M
BRTWD-0008	1031	Kitchen	Hand Wash Only	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0009	1031F	Kitchen Storage Room	Kitchen Faucet (Cold)	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0010	1031C	Kitchen Locker Room	Bathroom Faucet	Non-Potable	11/3/2020	3.7	Result Below Action Level, Continue O&M
BRTWD-0013	1030B	Cafeteria B	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0014	1030A	Cafeteria A	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0015	N/A	New Construction Hallway Near East Exit	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0016	N/A	New Construction Hallway Near East Exit	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0017	N/A	Womens Faculty Bathroom (Near Special Education Room 144)	Bathroom Faucet	Non-Potable	11/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-0018	N/A	Mens Faculty Bathroom (Near Special Education Room 144)	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0019	N/A	Asst. Principal's Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0024	N/A	Corridor Near Bathrooms	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0025	N/A	Corridor Near Bathrooms	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0035	N/A	Corridor Near Exit Vestibule 106	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0036	N/A	Corridor Near Exit Vestibule 106	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0038	N/A	Room 1831 Home Economics	Home Economics Faucet (Cold)	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0043	N/A	Kitchen (New Construction)	Hand Wash Only	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0044	N/A	Kitchen (New Construction)	Kitchen Faucet (Cold)	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0045	N/A	Kitchen (New Construction)	Kitchen Faucet (Cold)	Potable	11/3/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0046	N/A	Kitchen (New Construction)	Hand Wash Only	Non-Potable	11/3/2020	9.5	Result Below Action Level, Continue O&M
BRTWD-0047	N/A	Kitchen (New Construction)	Kitchen Faucet (Cold)	Potable	11/3/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-0048	N/A	Kitchen (New Construction)	Kitchen Faucet (Cold)	Potable	11/3/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0049	N/A	Kitchen (New Construction)	Pasta Pot/Steam Kettle	Potable	11/3/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0050	N/A	Kitchen (New Construction)	Hand Wash Only	Non-Potable	11/3/2020	10	Result Below Action Level, Continue O&M
BRTWD-0051	N/A	Kitchen (New Construction)	Hand Wash Only	Non-Potable	11/3/2020	1.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0055	N/A	Kitchen Girls Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0056	N/A	Kitchen Boys Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0064	1022	Nurse's Office	Nurse's Office Sink	Potable	3/25/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-0065	1022A1	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	7.4	Result Below Action Level, Continue O&M
BRTWD-0066	1026B	ISS Room	Bottled Water Dispenser	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0067	1027	Corridor Near Boiler Room (0001)	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0068	1027	Corridor Near Boiler Room (0001)	Bottle Fill Station	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0070	1027	Corridor Near Closet (1027A)	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0072	1027A	Closet in Corridor Outside Boiler Room	Ice Machine	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0073	1021E1A	Girls Coach's Office Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-0074	1021E2	Girls Locker Room	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0075	1021E2B	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	8.3	Result Below Action Level, Continue O&M
BRTWD-0076	1021E2B	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	<3.0 ND	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0077	1021E2B	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	<3.0 ND	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0078	1021B	Gym Vestibule to Aux. Gym & Girls Locker Room	Water Cooler	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0079	1021B	Gym Vestibule to Aux. Gym & Girls Locker Room	Water Cooler	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0080	1020C	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	4.7	Result Below Action Level, Continue O&M
BRTWD-0081	1020C	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	7.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0082	1019A	Gym Coach's Office Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-0083	1017	Corridor Near Custodial Room (1017A)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0085	1018A	Team Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0086	1018A	Team Locker Room Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	22	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-0087	1017	Corridor Near Gym Storage Room (1016)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0089	1035	Faculty Mens Bathroom (Auditorium Lobby)	Bathroom Faucet	Non-Potable	11/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-0090	1036	Faculty Womens Bathroom (Auditorium Lobby)	Bathroom Faucet	Non-Potable	11/3/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-0091	1067	Corridor Near Guidance Office (1040)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0093	1045	Mens Faculty Bathroom (Across Custodial Receiving)	Bathroom Faucet	Non-Potable	11/3/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-0094	1051	Corridor Near Men's Faculty Bathroom (1045)	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0095	1051	Corridor Near Men's Faculty Bathroom (1045)	Bottle Fill Station	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0096	1047	Womens Faculty Bathroom (Across Custodial Receiving)	Bathroom Faucet	Non-Potable	11/3/2020	2.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0097	1053B	Faculty Room Womens Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-0098	1053B	Faculty Room Womens Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	2	Result Below Action Level, Continue O&M
BRTWD-0099	1053	Faculty Lounge	Classroom Faucet	Non-Potable	5/5/2021	<3.0 ND	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0100	1053A	Faculty Room Mens Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	8.8	Result Below Action Level, Continue O&M
BRTWD-0101	1054	Room 1410 Home Economics	Home Economics Faucet (Cold)	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0102	1054	Room 1410 Home Economics	Home Economics Faucet (Cold)	Potable	11/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-0103	1054	Room 1410 Home Economics	Home Economics Faucet (Cold)	Potable	11/3/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-0104	1054	Room 1410 Home Economics	Home Economics Faucet (Cold)	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0105	1054	Room 1410 Home Economics	Home Economics Faucet (Cold)	Potable	11/3/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0125	1067	Corridor Near Men's Bathroom (1060)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0130	1067	Corridor Near Principal's Office (1065B)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0166	N/A	Handicap Bathroom (Across Rooms 2809 & 2805)	Bathroom Faucet	Non-Potable	11/3/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-0167	N/A	Library Workroom	Classroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0172	N/A	Corridor Near Faculty Bathrooms	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0173	N/A	Corridor Near Faculty Bathrooms	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0196	N/A	Room 2819/2823 Prep Room	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0207	N/A	Mens Faculty Bathroom (Across Rooms 2823 & 2819)	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0225	2054	Corridor Near Room 2537 (2001)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0229	2054	Corridor Near Men's Bathroom (2010)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0234	2054	Corridor Near Room 2520 Book Room (2023)	Water Fountain-No Chiller	Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0235	2026	Faculty Womens Bathroom (Adjacent Storage Room 2520)	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0236	2026	Faculty Womens Bathroom (Adjacent Storage Room 2520)	Bathroom Faucet	Non-Potable	11/3/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-0237	2027	Faculty Mens Bathroom (Adjacent Fan Room)	Bathroom Faucet	Non-Potable	11/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0238	2054	Corridor Room 2500 To Room 2537	Water Fountain-No Chiller	Potable	11/3/2020	12	Result Below Action Level, Continue O&M
BRTWD-0287	2054	Corridor Near Men's Bathroom (2045)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0311	2054	Corridor Near Science Prep Room 2500 (2053)	Water Fountain-No Chiller	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0371	1080A	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-0372	1078A	Wood Shop Storage	Bottled Water Dispenser	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0376	1079A	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	6.3	Result Below Action Level, Continue O&M
BRTWD-0377	1079A	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/3/2020	14	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0378	1081A	Auxiliary Gym Vestibule	Water Cooler	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0402	1068C	ROTC (1064) Office	Bottled Water Dispenser	Potable	11/3/2020	OOS	Testing Required Before Return to Service
BRTWD-0408	1089B6	Library Annex Break Room	Classroom Faucet	Non-Potable	11/3/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0410	1087	Mens Bathroom (Near TV Studio Room 1603)	Bathroom Faucet	Non-Potable	11/3/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-0411	1085	Womens Bathroom (Near TV Studio Room 1603)	Bathroom Faucet	Non-Potable	5/5/2021	5.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0412	1085	Womens Bathroom (Near TV Studio Room 1603)	Bathroom Faucet	Non-Potable	5/5/2021	4.7	Outlet Remediated Result Below Action Level, Continue O&M

Buildings & Grounds Building

BRTWD-2952	1008A1	Stairwell Vestibule Bathroom	Bathroom Faucet	Non-Potable	12/15/2020	4.4	Result Below Action Level, Continue O&M
BRTWD-2954	1006A	Vestibule Bathroom	Bathroom Faucet	Non-Potable	12/15/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2955	1005	Faculty Room	Water Cooler	Potable	12/15/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2956	1005	Faculty Room	Classroom Faucet	Non-Potable	12/15/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2957	2005	Women's Bathroom	Bathroom Faucet	Non-Potable	12/15/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2958	2007	Corridor Near Custodial Closet (2004)	Water Cooler	Potable	12/15/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2959	2003	Men's Bathroom	Bathroom Faucet	Non-Potable	12/15/2020	6.3	Result Below Action Level, Continue O&M
BRTWD-2960	2002	Faculty Room	Classroom Faucet	Non-Potable	12/15/2020	1.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2961	1010	Warehouse	Water Cooler	Potable	12/15/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2965	1011A	Auto Shop Bathroom	Bathroom Faucet	Non-Potable	12/15/2020	12	Result Below Action Level, Continue O&M
BRTWD-2966	1014A	Glazier/Locksmith Shop Vestibule Bathroom	Bathroom Faucet	Non-Potable	12/15/2020	3.9	Result Below Action Level, Continue O&M

East Kindergarten Center

BRTWD-2549	N/A	Room 1	Water Fountain-No Chiller	Potable	11/19/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2550	N/A	Room 1	Classroom Faucet	Non-Potable	11/19/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2551	N/A	Room 1 Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2552	N/A	Room 2	Water Fountain-No Chiller	Potable	11/19/2020	6.7	Result Below Action Level, Continue O&M
BRTWD-2553	N/A	Room 2	Classroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2554	N/A	Room 2 Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-2555	N/A	Room 3	Classroom Faucet	Non-Potable	11/19/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-2556	N/A	Room 3	Water Fountain-No Chiller	Potable	11/19/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2557	N/A	Room 3 Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	1	Result Below Action Level, Continue O&M
BRTWD-2558	N/A	Room 4	Water Fountain-No Chiller	Potable	11/19/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2559	N/A	Room 4	Classroom Faucet	Non-Potable	11/19/2020	1.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2560	N/A	Room 4 Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-2561	N/A	Room 5	Classroom Faucet	Non-Potable	11/19/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2562	N/A	Room 5	Water Fountain-No Chiller	Potable	11/19/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2563	N/A	Room 5 Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	OOS	Testing Required Before Return to Service
BRTWD-2564	N/A	Room 6	Classroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2565	N/A	Room 6	Water Fountain-No Chiller	Potable	11/19/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-2566	N/A	Room 6 Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	OOS	Testing Required Before Return to Service
BRTWD-2568	N/A	Corridor Near Faculty Bathroom	Water Cooler	Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2569	N/A	Faculty Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2570	1001	Room 7	Classroom Faucet	Non-Potable	11/19/2020	9.8	Result Below Action Level, Continue O&M
BRTWD-2571	1001	Room 7	Water Fountain-No Chiller	Potable	11/19/2020	4.8	Result Below Action Level, Continue O&M
BRTWD-2572	1003	Room 8	Classroom Faucet	Non-Potable	3/26/2021	<3.0 ND	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2573	1003	Room 8	Water Fountain-No Chiller	Potable	3/26/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2574	1004	Room 9	Classroom Faucet	Non-Potable	11/19/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2575	1004	Room 9	Water Fountain-No Chiller	Potable	11/19/2020	12	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2576	1005	Room 10	Classroom Faucet	Non-Potable	11/19/2020	11	Result Below Action Level, Continue O&M
BRTWD-2577	1005	Room 10	Water Fountain-No Chiller	Potable	11/19/2020	8.8	Result Below Action Level, Continue O&M
BRTWD-2578	1006	Room 11	Classroom Faucet	Non-Potable	11/19/2020	11	Result Below Action Level, Continue O&M
BRTWD-2579	1006	Room 11	Water Fountain-No Chiller	Potable	11/19/2020	12	Result Below Action Level, Continue O&M
BRTWD-2580	1007	Room 12	Classroom Faucet	Non-Potable	11/19/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2581	1007	Room 12	Water Fountain-No Chiller	Potable	11/19/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-2582	1008	Room 13	Classroom Faucet	Non-Potable	11/19/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-2583	1008	Room 13	Water Fountain-No Chiller	Potable	11/19/2020	9.9	Result Below Action Level, Continue O&M
BRTWD-2584	1011	Room 15	Classroom Faucet	Non-Potable	11/19/2020	3.8	Result Below Action Level, Continue O&M
BRTWD-2585	1011	Room 15	Water Fountain-No Chiller	Potable	11/19/2020	6.7	Result Below Action Level, Continue O&M
BRTWD-2586	1014	Room 17	Classroom Faucet	Non-Potable	11/19/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-2587	1014	Room 17	Water Fountain-No Chiller	Potable	11/19/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-2588	1015	Room 20	Classroom Faucet	Non-Potable	11/19/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2589	1015	Room 20	Water Fountain-No Chiller	Potable	11/19/2020	13	Result Below Action Level, Continue O&M
BRTWD-2590	1025	Corridor Near Room 19 (1016)	Water Cooler	Potable	11/19/2020	<3.0 ND	Replaced by Outlet 3073/3074

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2591	1018	Room 22	Classroom Faucet	Non-Potable	11/19/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-2592	1018	Room 22	Water Fountain-No Chiller	Potable	11/19/2020	9.5	Result Below Action Level, Continue O&M
BRTWD-2593	1020	Girls Bathroom (Across Room 22)	Bathroom Faucet	Non-Potable	11/19/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-2594	1028	Womens Bathroom (Near Room 21)	Bathroom Faucet	Non-Potable	11/19/2020	3.8	Result Below Action Level, Continue O&M
BRTWD-2595	1028	Womens Bathroom (Near Room 21)	Bathroom Faucet	Non-Potable	11/19/2020	5.1	Result Below Action Level, Continue O&M
BRTWD-2596	1029	Mens Bathroom (Near Room 21)	Bathroom Faucet	Non-Potable	11/19/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2597	1031	Nurse's Office	Nurse's Office Sink	Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2598	1031A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-2600	1037	Faculty Room	Classroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2601	1044	Corridor Near Faculty Room (1037)	Water Fountain-No Chiller	Potable	11/19/2020	<3.0 ND	Replaced by Outlet 3071/3072
BRTWD-2602	1041	Kitchen	Kitchen Faucet (Cold)	Potable	11/19/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2603	1041	Kitchen	Kitchen Faucet (Cold)	Potable	11/19/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2604	1041	Kitchen	Hand Wash Only	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2605	1041	Kitchen	Pasta Pot/Steam Kettle	Potable	3/26/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2606	1041	Kitchen	Kitchen Faucet (Cold)	Potable	3/26/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2607	1041	Kitchen	Kitchen Faucet (Cold)	Potable	11/19/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-2608	1041	Kitchen	Spray Nozzle	Non-Potable	11/19/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-2609	1041	Kitchen	Kitchen Faucet (Cold)	Potable	11/19/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-2610	1041A1	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2612	1047	Girls Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	11	Result Below Action Level, Continue O&M
BRTWD-2613	1047	Girls Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2614	1047	Girls Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	3.8	Result Below Action Level, Continue O&M
BRTWD-2615	1047	Girls Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	14	Result Below Action Level, Continue O&M
BRTWD-2617	1050	Boys Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	15	Result Below Action Level, Continue O&M
BRTWD-2618	1050	Boys Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	15	Result Below Action Level, Continue O&M
BRTWD-2619	1050	Boys Bathroom (Across Boiler Room)	Bathroom Faucet	Non-Potable	11/19/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-2621	1052	Room 32	Classroom Faucet	Non-Potable	11/19/2020	4.4	Result Below Action Level, Continue O&M
BRTWD-2622	1052	Room 32	Water Fountain-No Chiller	Potable	11/19/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-2623	1053	Room 31	Classroom Faucet	Non-Potable	11/19/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-2624	1053	Room 31	Water Fountain-No Chiller	Potable	3/26/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2625	1054	Room 34	Classroom Faucet	Non-Potable	11/19/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-2626	1054	Room 34	Water Fountain-No Chiller	Potable	11/19/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2627	1055	Room 33	Classroom Faucet	Non-Potable	11/19/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2628	1055	Room 33	Water Fountain-No Chiller	Potable	11/19/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-2629	1056	Room 36	Classroom Faucet	Non-Potable	11/19/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-2630	1056	Room 36	Water Fountain-No Chiller	Potable	8/24/2022	4.9	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2631	1057	Room 35	Classroom Faucet	Non-Potable	11/19/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-2632	1057	Room 35	Water Fountain-No Chiller	Potable	3/26/2021	15	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2633	1058	Room 38	Classroom Faucet	Non-Potable	3/26/2021	4.5	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2634	1058	Room 38	Water Fountain-No Chiller	Potable	5/7/2021	12	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2635	1060	Room 40	Classroom Faucet	Non-Potable	11/19/2020	5.2	Result Below Action Level, Continue O&M
BRTWD-2636	1060	Room 40	Water Fountain-No Chiller	Potable	11/19/2020	7.7	Result Below Action Level, Continue O&M
BRTWD-2637	1061	Room 39	Classroom Faucet	Non-Potable	11/19/2020	5.0	Result Below Action Level, Continue O&M
BRTWD-2638	1061	Room 39	Water Fountain-No Chiller	Potable	11/19/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2639	1062	Room 42	Classroom Faucet	Non-Potable	11/19/2020	3.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2640	1062	Room 42	Water Fountain-No Chiller	Potable	11/19/2020	10	Result Below Action Level, Continue O&M
BRTWD-2641	1064	Room 44	Classroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2642	1064	Room 44	Water Fountain-No Chiller	Potable	3/26/2021	7.6	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2643	1065	Room 41	Classroom Faucet	Non-Potable	11/19/2020	OOS	Testing Required Before Return to Service
BRTWD-2644	1065	Room 41	Classroom Faucet	Non-Potable	11/19/2020	OOS	Testing Required Before Return to Service
BRTWD-2645	1065	Room 41	Classroom Faucet	Non-Potable	11/19/2020	OOS	Testing Required Before Return to Service
BRTWD-2646	N/A	Room 46	Water Fountain-No Chiller	Potable	11/19/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2647	N/A	Room 46	Classroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2649	N/A	Room 47	Classroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2650	N/A	Room 47	Water Fountain-No Chiller	Potable	11/19/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-3071	1044	Corridor Near Faculty Room (1037)	Water Cooler	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3072	1044	Corridor Near Faculty Room (1037)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3073	1025	Corridor Near Room 19 (1016)	Water Cooler	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3074	1025	Corridor Near Room 19 (1016)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M

East Kindergarten Warehouse

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2977	1001A	Locker Area Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2978	1002A	Warehouse Bathroom	Bathroom Faucet	Non-Potable	11/19/2020	OOS	Testing Required Before Return to Service
BRTWD-2979	1001	Locker Area	Water Cooler	Potable	11/19/2020	OOS	Testing Required Before Return to Service

East Middle School

BRTWD-1354	1006A1	Auditorium Lobby Men's Bathroom	Bathroom Faucet	Non-Potable	5/7/2021	4.5	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1355	1006A1	Auditorium Lobby Men's Bathroom	Bathroom Faucet	Non-Potable	8/24/2022	6.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1356	1006A2	Auditorium Lobby Women's Bathroom	Bathroom Faucet	Non-Potable	5/7/2021	61	Replaced by Outlet 3013
BRTWD-1357	1006A2	Auditorium Lobby Women's Bathroom	Bathroom Faucet	Non-Potable	5/7/2021	3.6	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1361	1023	Corridor Near Room 124 (1014)	Water Fountain-No Chiller	Potable	11/20/2020	23	Replaced by Outlet 3016/3017
BRTWD-1362	1023	Corridor Near Room 124 (1014)	Water Fountain-No Chiller	Potable	11/20/2020	5.3	Replaced by Outlet 3016/3017
BRTWD-1365	1015	Room 121	Classroom Faucet	Non-Potable	11/20/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-1367	1009	Boutique (Former Bathroom)	Bathroom Faucet	Non-Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-1368	1009	Boutique (Former Bathroom)	Bathroom Faucet	Non-Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-1371	N/A	Corridor Near Bathrooms (New Construction)	Water Cooler	Potable	11/20/2020	<3.0 ND	Replaced by Outlet 3018/3019
BRTWD-1375	N/A	Room 143	Classroom Faucet	Non-Potable	11/20/2020	1.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1376	N/A	Room 142	Classroom Faucet	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1377	N/A	Corridor Near Basement Stairwell	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1378	N/A	Corridor Near Basement Stairwell	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1384	N/A	Corridor Near Bathrooms	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1385	N/A	Corridor Near Bathrooms	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1390	1026B	Faculty Room Womens Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1391	1026A	Faculty Room	Classroom Faucet	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1392	1027A	Faculty Room Men's Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-1393	1056	Corridor Near Faculty Room (1026A)	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1394	1056	Corridor Near Faculty Room (1026A)	Bottle Fill Station	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1395	1028	Boys Bathroom (Across Faculty Room)	Bathroom Faucet	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1396	1029C	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1397	1029	Nurse's Office	Nurse's Office Sink	Potable	11/20/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-1399	1030	Girls Bathroom (Across Faculty Lounge)	Bathroom Faucet	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1400	1056	Corridor Near Girls Locker Room (1033A)	Water Fountain-No Chiller	Potable	11/20/2020	1.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1401	1033B1	Girls Coach's Office Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-1404	1033A	Girls Locker Room	Water Fountain-No Chiller	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1405	1056	Corridor Near Boiler Room (0001)	Water Fountain-No Chiller	Potable	11/20/2020	33	Replaced by Outlet 3014/3015
BRTWD-1406	1041A	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	2	Result Below Action Level, Continue O&M
BRTWD-1407	1042A1	Boys Coach's Office Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-1408	1042B	Boys Locker Room	Water Fountain-No Chiller	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1411	1056	Corridor Near Room 110 (1044)	Water Fountain-No Chiller	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1414	1048	Room 106	Home Economics Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1415	1048	Room 106	Home Economics Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1416	1048	Room 106	Home Economics Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1417	1048A	Room 106 Laundry Room	Home Economics Faucet (Cold)	Potable	5/7/2021	3.5	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1419	1052	Room 104	Home Economics Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1420	1052	Room 104	Home Economics Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1421	1052	Room 104	Home Economics Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1422	1052	Room 104	Home Economics Faucet (Cold)	Potable	11/20/2020	2.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1423	1051	Storage (Former Boys Bathroom)	Bathroom Faucet	Non-Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-1424	1051	Storage (Former Boys Bathroom)	Bathroom Faucet	Non-Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-1425	1051	Storage (Former Boys Bathroom)	Bathroom Faucet	Non-Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-1426	1056	Corridor Near Room 104 (1052)	Water Fountain-No Chiller	Potable	11/20/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1431	2000	Boys Bathroom (Across Art Room 202)	Bathroom Faucet	Non-Potable	11/20/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-1432	2000	Boys Bathroom (Across Art Room 202)	Bathroom Faucet	Non-Potable	11/20/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-1434	2021	Corridor Near Room 202 (2002)	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1435	2003	Girls Bathroom (Across Art Room 202)	Bathroom Faucet	Non-Potable	11/20/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-1436	2003	Girls Bathroom (Across Art Room 202)	Bathroom Faucet	Non-Potable	11/20/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-1445	2021	Corridor Near Room 210 (2010)	Water Fountain-No Chiller	Potable	11/20/2020	300	Removed From Service, Pending Remediation
BRTWD-1446	2017A	Library Work Room	Classroom Faucet	Non-Potable	11/20/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-1447	2021	Corridor Near Room 216 (2019)	Water Fountain-No Chiller	Potable	11/20/2020	<3.0 ND	Replaced by Outlet 3020/3021
BRTWD-1450	N/A	Corridor Near Faculty Bathrooms	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1454	N/A	Corridor Near Room 246	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1455	N/A	Corridor Near Room 246	Water Cooler	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1456	2041	Corridor Near Room 218 (2024)	Water Fountain-No Chiller	Potable	11/20/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-1457	2030	Room 221	Classroom Faucet	Non-Potable	11/20/2020	7.2	Result Below Action Level, Continue O&M
BRTWD-1458	2032	Room 223	Classroom Faucet	Non-Potable	11/20/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-1462	2041	Corridor Near Room 226 (2033)	Water Fountain-No Chiller	Potable	11/20/2020	15	Result Below Action Level, Continue O&M
BRTWD-1463	2041	Corridor Near Room 226 (2033)	Bottle Fill Station	Potable	11/20/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-1467	2035	Boys Bathroom (Across Room 228)	Bathroom Faucet	Non-Potable	11/20/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-1468	2035	Boys Bathroom (Across Room 228)	Bathroom Faucet	Non-Potable	6/16/2021	3.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1469	2035	Boys Bathroom (Across Room 228)	Bathroom Faucet	Non-Potable	11/20/2020	7.0	Result Below Action Level, Continue O&M
BRTWD-1471	2037	Girls Bathroom (Across Room 228)	Bathroom Faucet	Non-Potable	11/20/2020	15	Result Below Action Level, Continue O&M
BRTWD-1472	2037	Girls Bathroom (Across Room 228)	Bathroom Faucet	Non-Potable	6/16/2021	30	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-1473	2037	Girls Bathroom (Across Room 228)	Bathroom Faucet	Non-Potable	11/20/2020	5.6	Result Below Action Level, Continue O&M
BRTWD-1474	N/A	Basement Technology Suite Break Room	Bottled Water Dispenser	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1475	N/A	Basement Technology Suite Break Room	Water Cooler	Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-1476	1036	Kitchen	Hand Wash Only	Non-Potable	11/20/2020	7.6	Result Below Action Level, Continue O&M
BRTWD-1477	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1478	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/20/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1479	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/20/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-1480	1036	Kitchen	Spray Nozzle	Non-Potable	11/20/2020	7.1	Result Below Action Level, Continue O&M
BRTWD-1481	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/20/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-1482	1036	Kitchen	Hand Wash Only	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1483	1036	Kitchen	Pasta Pot/Steam Kettle	Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1484	1036	Kitchen	Hand Wash Only	Non-Potable	11/20/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1486	1036D	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/20/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2986	1006A	Auditorium Lobby	Water Fountain-No Chiller	Potable	11/20/2020	OOS	Testing Required Before Return to Service
BRTWD-3014	1056	Corridor Near Boiler Room (1001)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3015	1056	Corridor Near Boiler Room (1001)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3016	1023	Corridor Near Room 124 (1014)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3017	1023	Corridor Near Room 124 (1014)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3018	N/A	Corridor Near Bathrooms (New Construction)	Water Cooler	Potable	10/18/2022	OOS	Testing Required Before Return to Service
BRTWD-3019	N/A	Corridor Near Bathrooms (New Construction)	Bottle Fill Station	Potable	10/18/2022	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-3020	2021	Corridor Near Room 216 (2019)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3021	2021	Corridor Near Room 216 (2019)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M

Freshman Center

BRTWD-1501	1010	Health Suite	Nurse's Office Sink	Potable	12/10/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1503	1010C	Health Suite Bathroom	Bathroom Faucet	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1504	1020	Womens Bathroom (Adjacent to Room 54)	Bathroom Faucet	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1505	1021	Mens Bathroom (Adjacent to Room 54)	Bathroom Faucet	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1506	1015	Principal's Office	Bottled Water Dispenser	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1508	1034	Faculty Room	Classroom Faucet	Non-Potable	12/10/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-1509	1034	Faculty Room	Spray Nozzle	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1510	1034	Faculty Room	Classroom Faucet	Non-Potable	12/10/2020	8.5	Result Below Action Level, Continue O&M
BRTWD-1511	1034	Faculty Room	Spray Nozzle	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1512	1034	Faculty Room	Classroom Faucet	Non-Potable	12/10/2020	3.7	Result Below Action Level, Continue O&M
BRTWD-1513	1034	Faculty Room	Spray Nozzle	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1514	1034	Faculty Room	Classroom Faucet	Non-Potable	12/10/2020	2.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1515	1034	Faculty Room	Spray Nozzle	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1516	1042	Corridor Near Room 48 (1034)	Water Fountain-No Chiller	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1517	1036	Cafeteria (Area Reconstructed)	Hand Wash Only	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1518	1036	Cafeteria (Area Reconstructed)	Kitchen Faucet (Cold)	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1519	1036	Cafeteria (Area Reconstructed)	Hand Wash Only	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1520	1038	Kitchen	Hand Wash Only	Non-Potable	12/10/2020	10	Result Below Action Level, Continue O&M
BRTWD-1521	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1522	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1523	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1524	1038	Kitchen	Spray Nozzle	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1525	1038	Kitchen	Pasta Pot/Steam Kettle	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1526	1038	Kitchen	Hand Wash Only	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1527	1039	Kitchen Bathroom	Bathroom Faucet	Non-Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1536	1065	Mens Bathroom (Near Library)	Bathroom Faucet	Non-Potable	12/10/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-1537	1065	Mens Bathroom (Near Library)	Bathroom Faucet	Non-Potable	12/10/2020	4.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1540	1073B1	Girls Coach's Office Bathroom	Bathroom Faucet	Non-Potable	12/10/2020	13	Result Below Action Level, Continue O&M
BRTWD-1541	1073	Girls Locker Room	Water Cooler	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1542	1073A1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	5/6/2021	2.8	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1543	1075	Gymnasium	Water Fountain-No Chiller	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1544	1075	Gymnasium	Water Fountain-No Chiller	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1545	1071A1	Boys Coach's Office Bathroom	Bathroom Faucet	Non-Potable	12/10/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1546	1071	Boys Locker Room	Water Fountain-No Chiller	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1547	1071B1	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/10/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-1548	1068C	Library Work Room	Classroom Faucet	Non-Potable	12/10/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-1549	1068C	Library Work Room	Spray Nozzle	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1550	1069	Womens Faculty Bathroom (Near Library)	Bathroom Faucet	Non-Potable	12/10/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-1551	1069	Womens Faculty Bathroom (Near Library)	Bathroom Faucet	Non-Potable	12/10/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1554	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1558	1081	Storage (Former Bathroom)	Bathroom Faucet	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1559	1081	Storage (Former Bathroom)	Bathroom Faucet	Non-Potable	12/10/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1561	1083	Girls Bathroom (Near Room 9)	Bathroom Faucet	Non-Potable	8/24/2022	13	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1565	N/A	Corridor Near Women's Faculty Bathroom	Water Cooler	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1602	2003A	Room 204 Prep Room	Bottled Water Dispenser	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1614	2014	Corridor Near Room 209 (2008)	Water Fountain-No Chiller	Potable	12/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1629	2010	Girls Bathroom (Near Room 204)	Bathroom Faucet	Non-Potable	12/10/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-1630	2012	Faculty Bathroom (Near Room 209)	Bathroom Faucet	Non-Potable	12/10/2020	3.8	Result Below Action Level, Continue O&M
BRTWD-2993	1036	Cafeteria (Expanded in 2012)	Bottle Fill Station	Potable	12/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2994	1076	Corridor Between Library & Gym	Bottle Fill Station	Potable	12/10/2020	7.5	Result Below Action Level, Continue O&M

Hemlock Park Elementary School

BRTWD-2204	1001	Room 2	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2205	1001	Room 2	Water Fountain-No Chiller	Potable	12/8/2020	5.1	Result Below Action Level, Continue O&M
BRTWD-2206	1001C	Room 2 Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	OOS	Testing Required Before Return to Service
BRTWD-2207	1000	Room 1	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2208	1000	Room 1	Water Fountain-No Chiller	Potable	12/8/2020	4.8	Result Below Action Level, Continue O&M
BRTWD-2210	1003	Room 3	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2211	1003	Room 3	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2212	1004	Room 4	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2213	1004	Room 4	Water Fountain-No Chiller	Potable	12/8/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-2214	1004B	Room 4 Bathroom	Bathroom Faucet	Non-Potable	8/23/2022	7.2	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2215	1005	Room 5	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2216	1005	Room 5	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2217	1007	Room 6	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2218	1007	Room 6	Water Fountain-No Chiller	Potable	12/8/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-2219	1007B	Room 6 Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2220	1008	Room 7	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2221	1008	Room 7	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2222	1009	Room 8	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2223	1009	Room 8	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2224	1010	Room 9	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2225	1010	Room 9	Water Fountain-No Chiller	Potable	12/8/2020	5.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2226	1011	Room 10	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2227	1011	Room 10	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2228	1012	Room 11	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2229	1012	Room 11	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2230	1013	Room 12	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2231	1013	Room 12	Water Fountain-No Chiller	Potable	12/8/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-2232	1014	Room 13	Classroom Faucet	Non-Potable	6/17/2021	<3.0 ND	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2233	1014	Room 13	Water Fountain-No Chiller	Potable	3/25/2021	3.7	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2234	1015	Room 14	Classroom Faucet	Non-Potable	12/8/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2235	1015	Room 14	Water Fountain-No Chiller	Potable	8/23/2022	5.8	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2236	1016	Room 15	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2237	1016	Room 15	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2238	1017	Room 16	Classroom Faucet	Non-Potable	12/8/2020	4.7	Result Below Action Level, Continue O&M
BRTWD-2239	1017	Room 16	Water Fountain-No Chiller	Potable	3/25/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2240	1021	Men's Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2242	1023	Women's Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2243	1024D1	Girls Locker Room Toilet	Bathroom Faucet	Non-Potable	12/8/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-2244	1025	Nurse's Office	Nurse's Office Sink	Potable	12/8/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-2245	1025B	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2246	1025A	Nurse Sick Room	Nurse's Office Sink	Potable	12/8/2020	3	Result Below Action Level, Continue O&M
BRTWD-2247	1054	Corridor Near Gym (1024)	Water Cooler	Potable	12/8/2020	3.4	Replaced by Outlet 3081/3082
BRTWD-2248	1030	Faculty Room	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2249	1054	Corridor Near Custodial Office (1034A)	Water Fountain-No Chiller	Potable	12/8/2020	130	Replaced by Outlet 3079/3080
BRTWD-2250	1035	Music Room	Classroom Faucet	Non-Potable	12/8/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-2258	1040	Room 18	Classroom Faucet	Non-Potable	6/17/2021	7.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2259	1040	Room 18	Water Fountain-No Chiller	Potable	3/25/2021	10	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2260	1041	Room 17	Classroom Faucet	Non-Potable	8/23/2022	6.1	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2261	1041	Room 17	Water Fountain-No Chiller	Potable	12/8/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-2262	1043	Room 19	Classroom Faucet	Non-Potable	12/8/2020	9.8	Result Below Action Level, Continue O&M
BRTWD-2263	1043	Room 19	Water Fountain-No Chiller	Potable	8/23/2022	6.6	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2264	1044	Room 21	Classroom Faucet	Non-Potable	12/8/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2265	1044	Room 21	Water Fountain-No Chiller	Potable	12/8/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2266	1045	Room 24	Classroom Faucet	Non-Potable	12/8/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-2267	1045	Room 24	Water Fountain-No Chiller	Potable	12/8/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-2268	1046	Room 23	Classroom Faucet	Non-Potable	12/8/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-2269	1046	Room 23	Water Fountain-No Chiller	Potable	12/8/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-2270	1047	Room 26	Classroom Faucet	Non-Potable	12/8/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-2271	1047	Room 26	Water Fountain-No Chiller	Potable	12/8/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-2272	1048	Room 25	Classroom Faucet	Non-Potable	12/8/2020	13	Result Below Action Level, Continue O&M
BRTWD-2273	1048	Room 25	Water Fountain-No Chiller	Potable	12/8/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-2274	1049	Room 28	Classroom Faucet	Non-Potable	6/17/2021	7.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2275	1049	Room 28	Water Fountain-No Chiller	Potable	12/8/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2276	1050	Room 27	Classroom Faucet	Non-Potable	12/8/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-2277	1050	Room 27	Water Fountain-No Chiller	Potable	12/8/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2278	1052	Room 29	Classroom Faucet	Non-Potable	12/8/2020	1.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2279	1052	Room 29	Water Fountain-No Chiller	Potable	12/8/2020	8.1	Result Below Action Level, Continue O&M
BRTWD-2280	1051	Room 30	Classroom Faucet	Non-Potable	12/8/2020	5.1	Result Below Action Level, Continue O&M
BRTWD-2281	1051	Room 30	Water Fountain-No Chiller	Potable	12/8/2020	1	Result Below Action Level, Continue O&M
BRTWD-2282	N/A	Room 31	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2283	N/A	Room 31	Water Fountain-No Chiller	Potable	3/25/2021	2.7	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2284	N/A	Room 32	Classroom Faucet	Non-Potable	12/8/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2285	N/A	Room 32	Water Fountain-No Chiller	Potable	12/8/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-2290	N/A	Corridor Near Faculty Bathroom	Water Cooler	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2291	N/A	Faculty Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2294	N/A	Room 33	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2295	N/A	Room 33	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2296	N/A	Room 35	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2297	N/A	Room 35	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2298	N/A	Room 34	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2299	N/A	Room 34	Water Fountain-No Chiller	Potable	12/8/2020	2.1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2300	N/A	Room 37	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2301	N/A	Room 37	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2302	N/A	Room 36	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2303	N/A	Room 36	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2304	N/A	Room 39	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2305	N/A	Room 39	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2306	N/A	Room 38	Classroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2307	N/A	Room 38	Water Fountain-No Chiller	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2308	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/8/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2309	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2310	1033	Kitchen	Hand Wash Only	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2311	1033	Kitchen	Pasta Pot/Steam Kettle	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2312	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2313	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/8/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2314	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2315	1033	Kitchen	Hand Wash Only	Non-Potable	12/8/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2316	1033A	Kitchen Bathroom	Bathroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2992	1029B	Boys Locker Room	Bathroom Faucet	Non-Potable	12/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3079	1054	Corridor Near Custodial Office (1034A)	Water Cooler	Potable	12/8/2022	<6.0 ND	Result Below Action Level, Continue O&M
BRTWD-3080	1054	Corridor Near Custodial Office (1034A)	Bottle Fill Station	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3081	1054	Corridor Near Gym (1024)	Water Cooler	Potable	12/8/2022	1.6	Result Below Action Level, Continue O&M
BRTWD-3082	1054	Corridor Near Gym (1024)	Bottle Fill Station	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M

Instructional Media Center

BRTWD-1652	N/A	Corridor Near Room 43	Water Cooler	Potable	12/16/2020	<3.0 ND	Result Below Action Level, Continue O&M
-------------------	-----	-----------------------	--------------	---------	------------	---------	---

Laurel Park Elementary School

BRTWD-2441	1001A	Room 1A Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2442	1002A	Room 2A Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2443	1003	Room 1	Classroom Faucet	Non-Potable	11/24/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-2444	1003	Room 1	Water Fountain-No Chiller	Potable	11/24/2020	OOS	Testing Required Before Return to Service
BRTWD-2445	1003B	Room 1 Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	1.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2446	1004	Room 2	Classroom Faucet	Non-Potable	11/24/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-2447	1004	Room 2	Water Fountain-No Chiller	Potable	3/26/2021	3.7	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2449	1006	Room 4	Classroom Faucet	Non-Potable	11/24/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2450	1006	Room 4	Water Fountain-No Chiller	Potable	11/24/2020	6.7	Result Below Action Level, Continue O&M
BRTWD-2451	1007	Room 3	Classroom Faucet	Non-Potable	11/24/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-2452	1007	Room 3	Water Fountain-No Chiller	Potable	11/24/2020	8.1	Result Below Action Level, Continue O&M
BRTWD-2453	1007B	Room 3 Bathroom	Bathroom Faucet	Non-Potable	5/5/2021	2.8	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2454	1008	Room 6	Classroom Faucet	Non-Potable	8/24/2022	8.6	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2455	1008	Room 6	Water Fountain-No Chiller	Potable	11/24/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-2456	1010	Room 5	Classroom Faucet	Non-Potable	11/24/2020	15	Result Below Action Level, Continue O&M
BRTWD-2457	1010	Room 5	Water Fountain-No Chiller	Potable	8/24/2022	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2458	1010B	Room 5 Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2459	1011	Room 8	Classroom Faucet	Non-Potable	11/24/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2460	1011	Room 8	Water Fountain-No Chiller	Potable	11/24/2020	6.5	Result Below Action Level, Continue O&M
BRTWD-2461	1012	Room 7	Classroom Faucet	Non-Potable	11/24/2020	9.0	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2462	1012	Room 7	Water Fountain-No Chiller	Potable	11/24/2020	7.4	Result Below Action Level, Continue O&M
BRTWD-2463	1013	Room 10	Classroom Faucet	Non-Potable	11/24/2020	11	Result Below Action Level, Continue O&M
BRTWD-2464	1013	Room 10	Water Fountain-No Chiller	Potable	11/24/2020	12	Result Below Action Level, Continue O&M
BRTWD-2465	1014	Room 9	Classroom Faucet	Non-Potable	11/24/2020	5.4	Result Below Action Level, Continue O&M
BRTWD-2466	1014	Room 9	Water Fountain-No Chiller	Potable	3/26/2021	5.1	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2467	1015	Room 12	Classroom Faucet	Non-Potable	11/24/2020	9.5	Result Below Action Level, Continue O&M
BRTWD-2468	1015	Room 12	Water Fountain-No Chiller	Potable	3/26/2021	9.9	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2469	1016	Room 11	Classroom Faucet	Non-Potable	5/5/2021	4.0	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2470	1016	Room 11	Water Fountain-No Chiller	Potable	3/26/2021	13	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2471	1017	Room 14	Classroom Faucet	Non-Potable	11/24/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2472	1017	Room 14	Water Fountain-No Chiller	Potable	11/24/2020	13	Result Below Action Level, Continue O&M
BRTWD-2473	1018	Room 13	Classroom Faucet	Non-Potable	11/24/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2474	1018	Room 13	Water Fountain-No Chiller	Potable	11/24/2020	14	Result Below Action Level, Continue O&M
BRTWD-2475	1019	Room 16	Classroom Faucet	Non-Potable	11/24/2020	12	Result Below Action Level, Continue O&M
BRTWD-2476	1019	Room 16	Water Fountain-No Chiller	Potable	3/26/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2477	1020	Room 15	Classroom Faucet	Non-Potable	11/24/2020	6.4	Result Below Action Level, Continue O&M
BRTWD-2478	1020	Room 15	Water Fountain-No Chiller	Potable	11/24/2020	11	Result Below Action Level, Continue O&M
BRTWD-2479	1026	Mens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/24/2020	9.1	Result Below Action Level, Continue O&M
BRTWD-2480	1026	Mens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/24/2020	6.6	Result Below Action Level, Continue O&M
BRTWD-2482	1028	Womens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2483	1028	Womens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/24/2020	3	Result Below Action Level, Continue O&M
BRTWD-2484	1031C1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-2485	1029	Nurse's Office	Nurse's Office Sink	Potable	11/24/2020	5.1	Result Below Action Level, Continue O&M
BRTWD-2486	1029A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-2487	1030A	Speech Therapist Office	Classroom Faucet	Non-Potable	11/24/2020	14	Result Below Action Level, Continue O&M
BRTWD-2488	1040	Corridor Near Gymnasium (1031B)	Water Cooler	Potable	11/24/2020	7.3	Replaced by Outlet 3061/3062
BRTWD-2489	1035	Faculty Room	Classroom Faucet	Non-Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2490	1035	Faculty Room	Bottled Water Dispenser	Potable	11/24/2020	OOS	Testing Required Before Return to Service
BRTWD-2491	1040	Corridor Near Kitchen (1038)	Water Fountain-No Chiller	Potable	11/24/2020	19	Replaced by Outlet 3059/3060
BRTWD-2492	1040	Corridor Near Kitchen (1038)	Bottle Fill Station	Potable	11/24/2020	7.6	Replaced by Outlet 3059/3060

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2493	1038	Kitchen	Kitchen Faucet (Cold)	Potable	11/24/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-2494	1038	Kitchen	Kitchen Faucet (Cold)	Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2495	1038	Kitchen	Pasta Pot/Steam Kettle	Potable	11/24/2020	14	Result Below Action Level, Continue O&M
BRTWD-2496	1038	Kitchen	Hand Wash Only	Non-Potable	11/24/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2497	1038	Kitchen	Kitchen Faucet (Cold)	Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2498	1038	Kitchen	Spray Nozzle	Non-Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2499	1038	Kitchen	Kitchen Faucet (Cold)	Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2500	1038	Kitchen	Kitchen Faucet (Cold)	Potable	11/24/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-2501	1038	Kitchen	Hand Wash Only	Non-Potable	6/16/2021	11	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2502	1038A1	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-2504	1041	Room 20	Classroom Faucet	Non-Potable	11/24/2020	15	Result Below Action Level, Continue O&M
BRTWD-2505	1041	Room 20	Water Fountain-No Chiller	Potable	11/24/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-2513	1047	Room 17	Classroom Faucet	Non-Potable	5/5/2021	4.3	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2514	1047	Room 17	Water Fountain-No Chiller	Potable	11/24/2020	7.1	Result Below Action Level, Continue O&M
BRTWD-2515	1048	Room 19	Classroom Faucet	Non-Potable	11/24/2020	6.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2516	1048	Room 19	Water Fountain-No Chiller	Potable	11/24/2020	OOS	Testing Required Before Return to Service
BRTWD-2517	1049	Room 22	Classroom Faucet	Non-Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2518	1049	Room 22	Water Fountain-No Chiller	Potable	11/24/2020	OOS	Testing Required Before Return to Service
BRTWD-2519	1051	Room 24	Classroom Faucet	Non-Potable	11/24/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2520	1051	Room 24	Water Fountain-No Chiller	Potable	11/24/2020	6.0	Result Below Action Level, Continue O&M
BRTWD-2521	1052	Room 23	Classroom Faucet	Non-Potable	11/24/2020	5.2	Result Below Action Level, Continue O&M
BRTWD-2522	1052	Room 23	Water Fountain-No Chiller	Potable	11/24/2020	8.7	Result Below Action Level, Continue O&M
BRTWD-2523	1053	Room 26	Classroom Faucet	Non-Potable	11/24/2020	6.5	Result Below Action Level, Continue O&M
BRTWD-2524	1053	Room 26	Water Fountain-No Chiller	Potable	11/24/2020	12	Result Below Action Level, Continue O&M
BRTWD-2525	1054	Room 25	Classroom Faucet	Non-Potable	11/24/2020	8.8	Result Below Action Level, Continue O&M
BRTWD-2526	1054	Room 25	Water Fountain-No Chiller	Potable	8/24/2022	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2527	1055	Room 28	Classroom Faucet	Non-Potable	11/24/2020	2	Result Below Action Level, Continue O&M
BRTWD-2528	1055	Room 28	Water Fountain-No Chiller	Potable	11/24/2020	11	Result Below Action Level, Continue O&M
BRTWD-2529	1056	Room 27	Classroom Faucet	Non-Potable	11/24/2020	5.7	Result Below Action Level, Continue O&M
BRTWD-2530	1056	Room 27	Water Fountain-No Chiller	Potable	3/26/2021	1.3	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2531	1057	Room 30	Classroom Faucet	Non-Potable	5/5/2021	3.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2532	1057	Room 30	Water Fountain-No Chiller	Potable	3/26/2021	1.7	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2533	1058	Room 29	Classroom Faucet	Non-Potable	8/24/2022	99	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-2534	1058	Room 29	Water Fountain-No Chiller	Potable	3/26/2021	5.5	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2535	N/A	Room 31	Classroom Faucet	Non-Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2536	N/A	Room 31	Water Fountain-No Chiller	Potable	11/24/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2537	N/A	Room 34	Water Fountain-No Chiller	Potable	11/24/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-2538	N/A	Room 34	Classroom Faucet	Non-Potable	11/24/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-2987	1034A1	Stage Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/24/2020	3.7	Result Below Action Level, Continue O&M
BRTWD-3059	1040	Corridor Near Kitchen (1038)	Water Cooler	Potable	12/7/2022	3.0	Result Below Action Level, Continue O&M
BRTWD-3060	1040	Corridor Near Kitchen (1038)	Bottle Fill Station	Potable	12/7/2022	2.9	Result Below Action Level, Continue O&M
BRTWD-3061	1040	Corridor Near Gymnasium (1031B)	Water Cooler	Potable	12/7/2022	1	Result Below Action Level, Continue O&M
BRTWD-3062	1040	Corridor Near Gymnasium (1031B)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M

Loretta Park Elementary School

BRTWD-2328	N/A	Room 5A	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
------------	-----	---------	---------------------------	---------	------------	---------	---

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2329	N/A	Room 5A	Classroom Faucet	Non-Potable	11/25/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-2330	N/A	Room 6A	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2331	N/A	Room 6A	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2332	N/A	Room 4A	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2333	N/A	Room 4A	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2334	N/A	Room 3A	Water Fountain-No Chiller	Potable	11/25/2020	OOS	Testing Required Before Return to Service
BRTWD-2335	N/A	Room 3A	Classroom Faucet	Non-Potable	11/25/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-2336	N/A	Room 2A	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2337	N/A	Room 2A	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2338	N/A	Room 1A	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2339	N/A	Room 1A	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2344	N/A	Corridor Near Faculty Bathroom	Water Cooler	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2345	N/A	Faculty Bathroom (Near Room 1)	Bathroom Faucet	Non-Potable	11/25/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-2348	1000	Room 1	Classroom Faucet	Non-Potable	11/25/2020	6.3	Result Below Action Level, Continue O&M
BRTWD-2349	1000	Room 1	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2350	1000A	Room 1 Bathroom	Bathroom Faucet	Non-Potable	5/5/2021	12	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2351	1001	Room 2	Classroom Faucet	Non-Potable	11/25/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-2352	1001	Room 2	Water Fountain-No Chiller	Potable	11/25/2020	10	Result Below Action Level, Continue O&M
BRTWD-2353	1001A	Room 2 Bathroom	Bathroom Faucet	Non-Potable	8/25/2022	3.6	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2354	1002	Room 3	Classroom Faucet	Non-Potable	11/25/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2355	1002	Room 3	Water Fountain-No Chiller	Potable	11/25/2020	13	Result Below Action Level, Continue O&M
BRTWD-2356	1003	Room 4	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2357	1003	Room 4	Water Fountain-No Chiller	Potable	11/25/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-2358	1004	Room 5	Classroom Faucet	Non-Potable	11/25/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-2359	1004	Room 5	Water Fountain-No Chiller	Potable	3/26/2021	4.4	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2360	1005	Room 6	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2361	1005	Room 6	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2362	1006	Room 7	Classroom Faucet	Non-Potable	11/25/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2363	1006	Room 7	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2364	1007	Room 8	Classroom Faucet	Non-Potable	11/25/2020	5.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2365	1007	Room 8	Water Fountain-No Chiller	Potable	11/25/2020	8.9	Result Below Action Level, Continue O&M
BRTWD-2366	1008	Room 9	Classroom Faucet	Non-Potable	11/25/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2367	1008	Room 9	Water Fountain-No Chiller	Potable	3/26/2021	4.2	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2368	1009	Room 10	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2369	1009	Room 10	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2370	1010	Room 11	Classroom Faucet	Non-Potable	11/25/2020	13	Result Below Action Level, Continue O&M
BRTWD-2371	1010	Room 11	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2372	1011	Room 12	Classroom Faucet	Non-Potable	11/25/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-2373	1011	Room 12	Water Fountain-No Chiller	Potable	3/26/2021	8.7	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2374	1013	Room 14	Classroom Faucet	Non-Potable	11/25/2020	2	Result Below Action Level, Continue O&M
BRTWD-2375	1013	Room 14	Water Fountain-No Chiller	Potable	3/26/2021	4.0	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2376	1014	Faculty Room	Classroom Faucet	Non-Potable	11/25/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-2377	1016	Womens Bathroom (Across Main Office)	Bathroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2378	1038	Corridor Near Men's Bathroom (1020)	Water Cooler	Potable	11/25/2020	<3.0 ND	Replaced by Outlet 3065/3066
BRTWD-2379	1020	Mens Bathroom (Across Main Office)	Bathroom Faucet	Non-Potable	11/25/2020	1.8	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2380	1022	Nurse's Office	Nurse's Office Sink	Potable	11/25/2020	4.8	Result Below Action Level, Continue O&M
BRTWD-2381	1022C	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/25/2020	14	Result Below Action Level, Continue O&M
BRTWD-2383	1038	Corridor Near Room 17 (1026)	Water Cooler	Potable	11/25/2020	<3.0 ND	Replaced by Outlet 3063/3064
BRTWD-2384	1035	Kitchen	Kitchen Faucet (Cold)	Potable	11/25/2020	6.6	Result Below Action Level, Continue O&M
BRTWD-2385	1035	Kitchen	Kitchen Faucet (Cold)	Potable	11/25/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-2386	1035	Kitchen	Hand Wash Only	Non-Potable	11/25/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2387	1035	Kitchen	Pasta Pot/Steam Kettle	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2388	1035	Kitchen	Kitchen Faucet (Cold)	Potable	11/25/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-2390	1035	Kitchen	Kitchen Faucet (Cold)	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2391	1035	Kitchen	Kitchen Faucet (Cold)	Potable	11/25/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-2392	1035	Kitchen	Hand Wash Only	Non-Potable	11/25/2020	9.3	Result Below Action Level, Continue O&M
BRTWD-2393	1035A1	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/25/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2402	1045	Room 16	Classroom Faucet	Non-Potable	11/25/2020	5.0	Result Below Action Level, Continue O&M
BRTWD-2403	1045	Room 16	Water Fountain-No Chiller	Potable	11/25/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2404	1047	Room 18	Classroom Faucet	Non-Potable	11/25/2020	2.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2405	1047	Room 18	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2406	1048	Room 20	Classroom Faucet	Non-Potable	11/25/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2407	1048	Room 20	Water Fountain-No Chiller	Potable	11/25/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-2408	1049	Room 21	Classroom Faucet	Non-Potable	11/25/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-2409	1049	Room 21	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2410	1050	Room 22	Classroom Faucet	Non-Potable	11/25/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-2411	1050	Room 22	Water Fountain-No Chiller	Potable	3/26/2021	4.4	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2412	1051	Room 23	Classroom Faucet	Non-Potable	11/25/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-2413	1051	Room 23	Water Fountain-No Chiller	Potable	3/26/2021	1.2	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2414	1052	Room 24	Classroom Faucet	Non-Potable	11/25/2020	3	Result Below Action Level, Continue O&M
BRTWD-2415	1052	Room 24	Water Fountain-No Chiller	Potable	3/26/2021	7.4	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2416	1053	Room 25	Classroom Faucet	Non-Potable	11/25/2020	9.1	Result Below Action Level, Continue O&M
BRTWD-2417	1053	Room 25	Water Fountain-No Chiller	Potable	11/25/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-2418	1054	Room 26	Classroom Faucet	Non-Potable	11/25/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-2419	1054	Room 26	Water Fountain-No Chiller	Potable	3/26/2021	1.6	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2420	1055	Room 27	Classroom Faucet	Non-Potable	11/25/2020	12	Result Below Action Level, Continue O&M
BRTWD-2421	1055	Room 27	Water Fountain-No Chiller	Potable	11/25/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-2422	1056	Room 28	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2423	1056	Room 28	Water Fountain-No Chiller	Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2424	1057	Room 29	Classroom Faucet	Non-Potable	11/25/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2425	1057	Room 29	Water Fountain-No Chiller	Potable	11/25/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-3063	1038	Corridor Near Room 17 (1026)	Water Cooler	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3064	1038	Corridor Near Room 17 (1026)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3065	1038	Corridor Near Men's Bathroom (1020)	Water Cooler	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3066	1038	Corridor Near Men's Bathroom (1020)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M

Loretta Park Warehouse

BRTWD-2972	1001	Warehouse Garage	Water Cooler	Potable	11/25/2020	OOS	Testing Required Before Return to Service
BRTWD-2974	1001B	Warehouse Bathroom	Bathroom Faucet	Non-Potable	11/25/2020	4.3	Result Below Action Level, Continue O&M

North Elementary School

BRTWD-1038	1004	Room A-11	Classroom Faucet	Non-Potable	11/6/2020	2	Result Below Action Level, Continue O&M
-------------------	------	-----------	------------------	-------------	-----------	---	---

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1039	1004	Room A-11	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1040	1004B	Room A-11 Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	OOS	Testing Required Before Return to Service
BRTWD-1041	1005	Room A-10	Classroom Faucet	Non-Potable	11/6/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-1042	1005	Room A-10	Water Fountain-No Chiller	Potable	5/6/2021	2.4	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1043	1005A	Room A-10 Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	4.6	Result Below Action Level, Continue O&M
BRTWD-1044	1006	Room A-9	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1045	1006	Room A-9	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1046	1007	Room A-8	Classroom Faucet	Non-Potable	11/6/2020	5.0	Result Below Action Level, Continue O&M
BRTWD-1047	1007	Room A-8	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1048	1008	Room A-7	Classroom Faucet	Non-Potable	11/6/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-1049	1008	Room A-7	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1050	1009	Room A-6	Classroom Faucet	Non-Potable	11/6/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-1051	1009	Room A-6	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1052	1010	Room A-5	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1053	1010	Room A-5	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1054	1011	Room A-4	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1055	1011	Room A-4	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1056	1012	Room A-3	Classroom Faucet	Non-Potable	11/6/2020	7.7	Result Below Action Level, Continue O&M
BRTWD-1057	1012	Room A-3	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1058	1013	Room A-2	Classroom Faucet	Non-Potable	11/6/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-1059	1013	Room A-2	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1060	1015	Room A-1	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1061	1015	Room A-1	Water Fountain-No Chiller	Potable	11/6/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1062	1018	Womens Bathroom (Near Room A1)	Bathroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1063	1019	Student Bathroom (Near Room A1)	Bathroom Faucet	Non-Potable	11/6/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1064	1017	Corridor Near Annex Office (1021)	Water Cooler	Potable	5/6/2021	25	Replaced by Outlet 3053/3054
BRTWD-1066	2019	Corridor Near Stairwell (2001)	Water Fountain-No Chiller	Potable	11/6/2020	OOS	Testing Required Before Return to Service
BRTWD-1067	2002	Ladies Bathroom (Near Faculty Lounge)	Bathroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1068	2003	Mens Bathroom (Near Faculty Room)	Bathroom Faucet	Non-Potable	11/6/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1069	2005	Room A-12	Classroom Faucet	Non-Potable	11/6/2020	1.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1070	2005	Room A-12	Water Fountain-No Chiller	Potable	11/6/2020	5.5	Result Below Action Level, Continue O&M
BRTWD-1071	2007	Room A-13	Classroom Faucet	Non-Potable	11/6/2020	14	Result Below Action Level, Continue O&M
BRTWD-1072	2007	Room A-13	Water Fountain-No Chiller	Potable	6/17/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1073	2008	Room A-14	Classroom Faucet	Non-Potable	11/6/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1074	2008	Room A-14	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1075	2009	Room A-15	Classroom Faucet	Non-Potable	11/6/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1076	2009	Room A-15	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1077	2010	Room A-16	Classroom Faucet	Non-Potable	11/6/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-1078	2010	Room A-16	Water Fountain-No Chiller	Potable	11/6/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1079	2011	Room A-17	Classroom Faucet	Non-Potable	11/6/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-1080	2011	Room A-17	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1081	2012	Room A-18	Classroom Faucet	Non-Potable	11/6/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-1082	2012	Room A-18	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1083	2013	Room A-19	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1084	2013	Room A-19	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1085	2014	Room A-20	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1086	2014	Room A-20	Water Fountain-No Chiller	Potable	11/6/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-1087	2015	Room A-21	Classroom Faucet	Non-Potable	11/6/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1088	2015	Room A-21	Water Fountain-No Chiller	Potable	11/6/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1089	2016	Room A-22	Classroom Faucet	Non-Potable	11/6/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-1090	2016	Room A-22	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1091	1023B1	All Purpose Room Storage 2 Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1092	1023C2	All Purpose Room Reading Office Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-1093	1026	Kitchen (Annex)	Hand Wash Only	Non-Potable	11/6/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-1094	1026	Kitchen (Annex)	Kitchen Faucet (Cold)	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1095	1026	Kitchen (Annex)	Kitchen Faucet (Cold)	Potable	8/23/2022	26	Removed From Service, Pending Remediation
BRTWD-1097	1031	Room 1	Classroom Faucet	Non-Potable	11/6/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-1098	1031	Room 1	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1099	1031B	Room 1 Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1100	1033A	Library Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	1.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1101	1035	Room 3	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1102	1035	Room 3	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1103	1036	Room 5	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1104	1036	Room 5	Water Fountain-No Chiller	Potable	11/6/2020	OOS	Testing Required Before Return to Service
BRTWD-1105	1037	Room 6	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1106	1037	Room 6	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1107	1038	Room 7	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1108	1038	Room 7	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1109	1039	Room 8	Classroom Faucet	Non-Potable	11/6/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-1110	1039	Room 8	Water Fountain-No Chiller	Potable	11/6/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-1111	1040	Room 9	Classroom Faucet	Non-Potable	11/6/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1112	1040	Room 9	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1113	1041	Room 10	Classroom Faucet	Non-Potable	11/6/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1114	1041	Room 10	Water Fountain-No Chiller	Potable	11/6/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-1115	1042	Room 11	Classroom Faucet	Non-Potable	11/6/2020	2.6	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1116	1042	Room 11	Water Fountain-No Chiller	Potable	11/6/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-1117	1043	Room 12	Classroom Faucet	Non-Potable	11/6/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1118	1043	Room 12	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1119	1044	Room 13	Classroom Faucet	Non-Potable	11/6/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-1120	1044	Room 13	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1121	1045	Room 14	Classroom Faucet	Non-Potable	11/6/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1122	1045	Room 14	Water Fountain-No Chiller	Potable	11/6/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1123	1047	Room 15	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1124	1047	Room 15	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1125	1050C	Conference Room	Bottled Water Dispenser	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1126	1052	Womens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/6/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1127	1053	Mens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1128	1056	Nurse's Office	Nurse's Office Sink	Potable	11/6/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1130	1056A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-1132	1057A	Faculty Room	Classroom Faucet	Non-Potable	11/6/2020	2.1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1133	1086	Corridor Near Cafeteria (1063)	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Replaced by Outlet 3051/3052
BRTWD-1134	1065	Kitchen	Kitchen Faucet (Cold)	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1135	1065	Kitchen	Pasta Pot/Steam Kettle	Potable	11/6/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-1136	1065	Kitchen	Hand Wash Only	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1137	1065	Kitchen	Kitchen Faucet (Cold)	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1138	1065	Kitchen	Kitchen Faucet (Cold)	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1139	1065	Kitchen	Kitchen Faucet (Cold)	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1140	1065C	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1149	1073	Room 16	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1150	1073	Room 16	Water Fountain-No Chiller	Potable	11/6/2020	7.3	Result Below Action Level, Continue O&M
BRTWD-1151	1074	Room 17	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1152	1074	Room 17	Water Fountain-No Chiller	Potable	11/6/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-1153	1075	Room 18	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1154	1075	Room 18	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1155	1076	Room 19	Classroom Faucet	Non-Potable	11/6/2020	1.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1156	1076	Room 19	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1157	1077	Room 20	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1158	1077	Room 20	Water Fountain-No Chiller	Potable	11/6/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-1159	1078	Room 21	Classroom Faucet	Non-Potable	6/17/2021	1	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1160	1078	Room 21	Water Fountain-No Chiller	Potable	11/6/2020	OOS	Testing Required Before Return to Service
BRTWD-1161	1079	Room 22	Classroom Faucet	Non-Potable	11/6/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1162	1079	Room 22	Water Fountain-No Chiller	Potable	11/6/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1163	1080	Room 23	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1164	1080	Room 23	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1165	1081	Room 24	Classroom Faucet	Non-Potable	11/6/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1166	1081	Room 24	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1167	1082	Room 25	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1168	1082	Room 25	Water Fountain-No Chiller	Potable	11/6/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-1169	1083	Room 26	Classroom Faucet	Non-Potable	11/6/2020	3.8	Result Below Action Level, Continue O&M
BRTWD-1170	1083	Room 26	Water Fountain-No Chiller	Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1171	1084	Room 27	Classroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1172	1084	Room 27	Water Fountain-No Chiller	Potable	11/6/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-3051	1086	Main Corridor Near Cafeteria (1063)	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3052	1086	Main Corridor Near Cafeteria (1063)	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3053	1017	Corridor Near Annex Office (1021)	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3054	1017	Corridor Near Annex Office (1021)	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M

North Middle School

BRTWD-1664	1008A	Auditorium Lobby Men's Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-1665	1008A	Auditorium Lobby Men's Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	14	Result Below Action Level, Continue O&M
BRTWD-1666	1008B	Auditorium Lobby Women's Bathroom	Bathroom Faucet	Non-Potable	5/6/2021	26	Outlet Replaced by 3011
BRTWD-1667	1008B	Auditorium Lobby Women's Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	6.4	Result Below Action Level, Continue O&M
BRTWD-1668	1008	Corridor Near Auditorium (1005)	Water Fountain-No Chiller	Potable	11/18/2020	13	Replaced by Outlet 3032/3033
BRTWD-1671	1023	Corridor Near Room 123 (1013)	Water Fountain-No Chiller	Potable	11/18/2020	OOS	Testing Required Before Return to Service
BRTWD-1675	1015	Room 121	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1676	1016	Room 122	Classroom Faucet	Non-Potable	11/18/2020	15	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1677	1023	Corridor Near Room 116 (1021)	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1678	1024	Room 114	Bottled Water Dispenser	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1683	N/A	Corridor Near Bathrooms (New Construction)	Water Cooler	Potable	11/18/2020	<3.0 ND	Replaced by Outlet 3030/3031
BRTWD-1689	N/A	Room 143	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1690	N/A	Room 142	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1691	N/A	Corridor Near Room 146	Water Cooler	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1692	N/A	Corridor Near Room 146	Water Cooler	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1693	1025	Womens Faculty Bathroom (Near Faculty Room)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1694	1026	Faculty Room	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1695	1027	Mens Faculty Bathroom (Near Faculty Lounge)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1696	1058	Corridor Near Faculty Lounge (1026)	Water Cooler	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1697	1058	Corridor Near Faculty Lounge (1026)	Bottle Fill Station	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1698	1028	Boys Bathroom (Across Faculty Room)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1699	1029A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1700	1029	Nurse's Office	Nurse's Office Sink	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1701	1029C	Nurse's Office - Inner Room 2	Nurse's Office Sink	Potable	11/18/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-1704	1058	Corridor Near Girls Locker Room (1033)	Water Fountain-No Chiller	Potable	11/18/2020	7.9	Result Below Action Level, Continue O&M
BRTWD-1707	1033	Girls Locker Room	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1708	1033A1	Girls Coach's Office Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-1709	1034	Kitchen	Kitchen Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1710	1034	Kitchen	Kitchen Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1711	1034	Kitchen	Kitchen Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1712	1034	Kitchen	Spray Nozzle	Non-Potable	11/18/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-1713	1034	Kitchen	Kitchen Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1714	1034	Kitchen	Pasta Pot/Steam Kettle	Potable	11/18/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-1715	1034	Kitchen	Hand Wash Only	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1719	1057	Corridor Near Elevator	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Replaced by Outlet 3028/3029
BRTWD-1720	1039A	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1721	1041	Boys Locker Room	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1724	1041A1	Boys Coach's Office Bathroom	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1725	1057	Corridor Near Room 110 (1044)	Water Fountain-No Chiller	Potable	11/18/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-1726	1046	Room 108	Classroom Faucet	Non-Potable	11/18/2020	8.7	Result Below Action Level, Continue O&M
BRTWD-1727	1048	Room 106	Home Economics Faucet (Cold)	Potable	11/18/2020	8.6	Result Below Action Level, Continue O&M
BRTWD-1728	1048	Room 106	Home Economics Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1729	1048	Room 106	Home Economics Faucet (Cold)	Potable	11/18/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-1734	1051	Room 104	Home Economics Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1735	1051	Room 104	Home Economics Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1736	1051	Room 104	Home Economics Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1737	1051	Room 104	Home Economics Faucet (Cold)	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1738	1051A	Room 104 Storage	Classroom Faucet	Non-Potable	5/7/2021	9.4	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1739	1057	Corridor Near Room 104 (1051)	Water Fountain-No Chiller	Potable	11/18/2020	OOS	Testing Required Before Return to Service
BRTWD-1748	2003	Girls Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1749	2003	Girls Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1750	2003	Girls Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1752	2005	Boys Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1753	2005	Boys Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1754	2005	Boys Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	11/18/2020	OOS	Testing Required Before Return to Service
BRTWD-1756	2018	Corridor Near Room 228 (2008)	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1758	2009	Room 223	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1759	2010	Room 226	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1761	2018	Corridor Near Room 220 (2016)	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1766	N/A	Corridor Near Faculty Bathrooms	Water Cooler	Potable	11/18/2020	<3.0 ND	Replaced by Outlet 3036/3037
BRTWD-1767	N/A	Corridor Near Faculty Bathrooms	Water Cooler	Potable	11/18/2020	<3.0 ND	Replaced by Outlet 3036/3037
BRTWD-1773	N/A	Corridor Near Room 246	Water Cooler	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1774	N/A	Corridor Near Room 246	Water Cooler	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1775	2043	Corridor Near Room 216 (2021)	Water Fountain-No Chiller	Potable	11/18/2020	1.8	Replaced by Outlet 3034/3035
BRTWD-1776	2023A	Library Work Room	Classroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1777	2043	Corridor Near Stairwell (2030)	Water Fountain-No Chiller	Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1783	2038	Womens Faculty Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1784	2038	Womens Faculty Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	11/18/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1788	2043	Corridor Near Art Room 202 (2041)	Water Fountain-No Chiller	Potable	11/18/2020	OOS	Testing Required Before Return to Service
BRTWD-3005	2019	Room 218 Life Skills	Home Economics Faucet (Cold)	Potable	10/28/2021	2.8	Result Below Action Level, Continue O&M
BRTWD-3028	1057	Corridor Near Elevator	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3029	1057	Corridor Near Elevator	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3030	N/A	Corridor Near Bathrooms (New Construction)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3031	N/A	Corridor Near Bathrooms (New Construction)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3032	1008	Corridor Near Auditorium (1005)	Water Cooler	Potable	10/18/2022	2.1	Result Below Action Level, Continue O&M
BRTWD-3033	1008	Corridor Near Auditorium (1005)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3034	2043	Corridor Near Room 216 (2021)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3035	2043	Corridor Near Room 216 (2021)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3036	N/A	Corridor Near Faculty Bathrooms (New Construction)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3037	N/A	Corridor Near Faculty Bathrooms (New Construction)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M

Northeast Elementary School

BRTWD-1187	1001	Room 32	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1188	1001	Room 32	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1189	1002	Room 33	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1190	1002	Room 33	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1191	1003	Room 30	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1192	1003	Room 30	Water Fountain-No Chiller	Potable	11/10/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-1193	1004	Room 31	Classroom Faucet	Non-Potable	11/10/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1194	1004	Room 31	Water Fountain-No Chiller	Potable	3/26/2021	2.2	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1195	1005	Room 28	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1196	1005	Room 28	Water Fountain-No Chiller	Potable	11/10/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1197	1006	Room 29	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1198	1006	Room 29	Water Fountain-No Chiller	Potable	3/26/2021	13	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1199	1007	Room 27	Classroom Faucet	Non-Potable	11/10/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1200	1007	Room 27	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1201	1012	Faculty Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/10/2020	2	Result Below Action Level, Continue O&M
BRTWD-1202	1013	Student Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	11/10/2020	2	Result Below Action Level, Continue O&M
BRTWD-1204	1030C	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/10/2020	8.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1205	1024A	Principal's Office	Bottled Water Dispenser	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1206	1025	Mens Bathroom (Near Main Office)	Bathroom Faucet	Non-Potable	11/10/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1208	1028	Womens Bathroom (Near Main Office)	Bathroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1209	1032	Corridor Near Custodial Closet 10A (1027)	Water Cooler	Potable	11/10/2020	<3.0 ND	Replaced by Outlet 3057/3058
BRTWD-1210	1031	Nurse's Office	Nurse's Office Sink	Potable	11/10/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1211	1031A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1218	1037	Room 15	Classroom Faucet	Non-Potable	11/10/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-1219	1037	Room 15	Water Fountain-No Chiller	Potable	11/10/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-1220	1038	Room 16	Classroom Faucet	Non-Potable	11/10/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1221	1038	Room 16	Water Fountain-No Chiller	Potable	11/10/2020	1	Result Below Action Level, Continue O&M
BRTWD-1222	1039	Room 17	Classroom Faucet	Non-Potable	11/10/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1223	1039	Room 17	Water Fountain-No Chiller	Potable	11/10/2020	5.7	Result Below Action Level, Continue O&M
BRTWD-1224	1040	Room 18	Classroom Faucet	Non-Potable	11/10/2020	8.5	Result Below Action Level, Continue O&M
BRTWD-1225	1040	Room 18	Water Fountain-No Chiller	Potable	11/10/2020	2	Result Below Action Level, Continue O&M
BRTWD-1226	1041	Room 19	Classroom Faucet	Non-Potable	11/10/2020	1.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1227	1041	Room 19	Water Fountain-No Chiller	Potable	11/10/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1228	1042	Room 20	Classroom Faucet	Non-Potable	11/10/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1229	1042	Room 20	Water Fountain-No Chiller	Potable	11/10/2020	4.4	Result Below Action Level, Continue O&M
BRTWD-1230	1045A	Room 20A Bathroom	Bathroom Faucet	Non-Potable	11/10/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-1231	1047	Room 21	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1232	1047	Room 21	Water Fountain-No Chiller	Potable	11/10/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-1233	1048	Room 22	Classroom Faucet	Non-Potable	11/10/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-1234	1048	Room 22	Water Fountain-No Chiller	Potable	11/10/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-1235	1049	Room 23	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1236	1049	Room 23	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1237	1050	Room 24	Classroom Faucet	Non-Potable	11/10/2020	7.2	Result Below Action Level, Continue O&M
BRTWD-1238	1050	Room 24	Water Fountain-No Chiller	Potable	11/10/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-1239	1051	Room 25	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1240	1051	Room 25	Water Fountain-No Chiller	Potable	11/10/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1241	1052	Room 26	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1242	1052	Room 26	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1243	N/A	Room 410	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1244	N/A	Room 410	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1245	N/A	Room 412	Classroom Faucet	Non-Potable	11/10/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1246	N/A	Room 412	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1251	N/A	Corridor Near Bathrooms	Water Cooler	Potable	11/10/2020	<3.0 ND	Replaced by Outlet 3055/3056
BRTWD-1252	N/A	Faculty Bathroom (Near Faculty Room)	Bathroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1255	N/A	Room 414	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1256	N/A	Room 414	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1257	N/A	Room 416	Water Fountain-No Chiller	Potable	11/10/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1258	N/A	Room 416	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1259	1055	Faculty Room 8	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1260	1055	Faculty Room 8	Bottled Water Dispenser	Potable	11/10/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1261	1056	Room 6	Water Fountain-No Chiller	Potable	11/10/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1262	1056	Room 6	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1263	1057	Room 5	Classroom Faucet	Non-Potable	11/10/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-1264	1057	Room 5	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1265	1058	Room 4	Classroom Faucet	Non-Potable	11/10/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-1266	1058	Room 4	Water Fountain-No Chiller	Potable	11/10/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-1267	1060	Room 1	Classroom Faucet	Non-Potable	11/10/2020	3.7	Result Below Action Level, Continue O&M
BRTWD-1268	1060	Room 1	Water Fountain-No Chiller	Potable	11/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1269	1061	Room 2	Classroom Faucet	Non-Potable	11/10/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1270	1061	Room 2	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1271	1067	Annex Kitchen	Hand Wash Only	Non-Potable	6/17/2021	10	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1272	1067	Annex Kitchen	Kitchen Faucet (Cold)	Potable	11/10/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-1273	1067	Annex Kitchen	Spray Nozzle	Non-Potable	6/17/2021	<3.0 ND	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1274	1067	Annex Kitchen	Kitchen Faucet (Cold)	Potable	8/24/2022	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1275	1065	Annex Student Bathroom (Across Copy Room)	Bathroom Faucet	Non-Potable	11/10/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-1276	1066	Annex Faculty Bathroom (Across Copy Room)	Bathroom Faucet	Non-Potable	11/10/2020	1	Result Below Action Level, Continue O&M
BRTWD-1278	1085	Corridor Near Speech Room (1070)	Water Cooler	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1279	1071	Room 9A	Classroom Faucet	Non-Potable	11/10/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-1280	1071	Room 9A	Water Fountain-No Chiller	Potable	11/10/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-1281	1072	Room 12A	Classroom Faucet	Non-Potable	11/10/2020	2	Result Below Action Level, Continue O&M
BRTWD-1282	1072	Room 12A	Water Fountain-No Chiller	Potable	11/10/2020	2	Result Below Action Level, Continue O&M
BRTWD-1283	1073	Room 7A	Classroom Faucet	Non-Potable	6/17/2021	12	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1284	1073	Room 7A	Water Fountain-No Chiller	Potable	11/10/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-1285	1074	Room 10A	Classroom Faucet	Non-Potable	11/10/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-1286	1074	Room 10A	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1287	1075	Room 5A	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1288	1075	Room 5A	Water Fountain-No Chiller	Potable	11/10/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-1289	1075B	Room 5A Bathroom	Bathroom Faucet	Non-Potable	11/10/2020	15	Result Below Action Level, Continue O&M
BRTWD-1290	1077	Room 8A	Classroom Faucet	Non-Potable	11/10/2020	11	Result Below Action Level, Continue O&M
BRTWD-1291	1077	Room 8A	Water Fountain-No Chiller	Potable	11/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1292	1078	Room 6A	Classroom Faucet	Non-Potable	11/10/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1293	1078	Room 6A	Water Fountain-No Chiller	Potable	11/10/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1294	1079	Room 3A	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1295	1079	Room 3A	Water Fountain-No Chiller	Potable	11/10/2020	7.8	Result Below Action Level, Continue O&M
BRTWD-1296	1079A	Room 3A Bathroom	Bathroom Faucet	Non-Potable	8/24/2022	510 D	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-1298	1081	Room 4A	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1299	1081	Room 4A	Water Fountain-No Chiller	Potable	11/10/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1300	1082	Room 2A	Classroom Faucet	Non-Potable	11/10/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1301	1082	Room 2A	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1302	1083	Room 1A	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1303	1083	Room 1A	Water Fountain-No Chiller	Potable	11/10/2020	3	Result Below Action Level, Continue O&M
BRTWD-1304	1083B	Room 1A Bathroom	Bathroom Faucet	Non-Potable	8/24/2022	12	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1305	1018	Cafeteria	Water Cooler	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1306	1018B	Kitchen	Kitchen Faucet (Cold)	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1307	1018B	Kitchen	Spray Nozzle	Non-Potable	11/10/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1308	1018B	Kitchen	Kitchen Faucet (Cold)	Potable	11/10/2020	OOS	Testing Required Before Return to Service
BRTWD-1309	1018B	Kitchen	Kitchen Faucet (Cold)	Potable	11/10/2020	1.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1310	1018B	Kitchen	Hand Wash Only	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1311	1018B	Kitchen	Pasta Pot/Steam Kettle	Potable	5/7/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1312	1018B	Kitchen	Kitchen Faucet (Cold)	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1313	1018B2	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/10/2020	5.2	Result Below Action Level, Continue O&M
BRTWD-1317	2009	Room 34	Classroom Faucet	Non-Potable	11/10/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-1318	2009	Room 34	Water Fountain-No Chiller	Potable	11/10/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-1319	2010	Room 35	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1320	2010	Room 35	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1321	2008	Room 37	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1322	2008	Room 37	Water Fountain-No Chiller	Potable	3/26/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1323	2007	Room 36	Classroom Faucet	Non-Potable	3/26/2021	21	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-1324	2007	Room 36	Water Fountain-No Chiller	Potable	6/17/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-1325	2006	Room 39	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1326	2006	Room 39	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1327	2005	Room 38	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1328	2005	Room 38	Water Fountain-No Chiller	Potable	11/10/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-1329	2003	Room 40	Classroom Faucet	Non-Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1330	2003	Room 40	Water Fountain-No Chiller	Potable	11/10/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3055	N/A	Corridor Near Bathrooms (New Construction)	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3056	N/A	Corridor Near Bathrooms (New Construction)	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3057	1032	Corridor Between Gym & Library	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3058	1032	Corridor Between Gym & Library	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M

Oak Park Elementary School

BRTWD-2753	1001	Room 1	Classroom Faucet	Non-Potable	12/3/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-2754	1001	Room 1	Water Fountain-No Chiller	Potable	12/3/2020	OOS	Testing Required Before Return to Service
BRTWD-2755	1003	Room 2	Classroom Faucet	Non-Potable	12/3/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-2756	1003	Room 2	Water Fountain-No Chiller	Potable	12/3/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-2757	1003B	Room 2 Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	28	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-2758	1001B	Room 1 Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	19	Placarded for Non-Drinking Use, Pending Remediation
BRTWD-2759	1004	Room 3	Classroom Faucet	Non-Potable	12/3/2020	2.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2760	1004	Room 3	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2761	1005	Room 4	Classroom Faucet	Non-Potable	12/3/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-2762	1005	Room 4	Water Fountain-No Chiller	Potable	12/3/2020	7.5	Result Below Action Level, Continue O&M
BRTWD-2763	1006	Room 5	Classroom Faucet	Non-Potable	12/3/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-2764	1006	Room 5	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2765	1007	Room 6	Classroom Faucet	Non-Potable	12/3/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-2766	1007	Room 6	Water Fountain-No Chiller	Potable	12/3/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-2767	1008	Room 7	Classroom Faucet	Non-Potable	12/3/2020	8.3	Result Below Action Level, Continue O&M
BRTWD-2768	1008	Room 7	Water Fountain-No Chiller	Potable	12/3/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2769	1009	Room 8	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2770	1009	Room 8	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2771	1010	Room 9	Classroom Faucet	Non-Potable	12/3/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2772	1010	Room 9	Water Fountain-No Chiller	Potable	12/3/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-2773	1011	Room 10	Classroom Faucet	Non-Potable	12/3/2020	3.8	Result Below Action Level, Continue O&M
BRTWD-2774	1011	Room 10	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2775	1012	Room 11	Classroom Faucet	Non-Potable	12/3/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-2776	1012	Room 11	Water Fountain-No Chiller	Potable	12/3/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-2777	1013	Room 12	Classroom Faucet	Non-Potable	12/3/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2778	1013	Room 12	Water Fountain-No Chiller	Potable	12/3/2020	5.5	Result Below Action Level, Continue O&M
BRTWD-2779	1015	Room 14	Classroom Faucet	Non-Potable	12/3/2020	8.5	Result Below Action Level, Continue O&M
BRTWD-2780	1015	Room 14	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2781	1017	Room 15	Classroom Faucet	Non-Potable	12/3/2020	7.7	Result Below Action Level, Continue O&M
BRTWD-2782	1017	Room 15	Water Fountain-No Chiller	Potable	12/3/2020	OOS	Testing Required Before Return to Service
BRTWD-2783	1023	Women's Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2784	1040	Corridor Outside Bathrooms (1023/1024)	Water Cooler	Potable	12/3/2020	<3.0 ND	Replaced by Outlet 3085/3086
BRTWD-2785	1024	Men's Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-2787	1026	Nurse's Office	Nurse's Office Sink	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2788	1026B	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2789	1026A	Nurse's Office Exam Room	Nurse's Office Sink	Potable	8/24/2022	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2790	1033	Faculty Room 31	Classroom Faucet	Non-Potable	12/3/2020	1.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2791	1035	Room 30	Classroom Faucet	Non-Potable	12/3/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2792	1035	Room 30	Classroom Faucet	Non-Potable	12/3/2020	OOS	Testing Required Before Return to Service
BRTWD-2793	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/3/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-2794	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/3/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2795	1038	Kitchen	Hand Wash Only	Non-Potable	12/3/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2796	1038	Kitchen	Pasta Pot/Steam Kettle	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2797	1038	Kitchen	Spray Nozzle	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2798	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2799	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/3/2020	OOS	Testing Required Before Return to Service
BRTWD-2800	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/3/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2801	1038	Kitchen	Kitchen Faucet (Cold)	Potable	12/3/2020	8.4	Result Below Action Level, Continue O&M
BRTWD-2802	1038	Kitchen	Hand Wash Only	Non-Potable	12/3/2020	6.6	Result Below Action Level, Continue O&M
BRTWD-2803	1038A1	Kitchen Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-2812	1047	Room 16	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2813	1047	Room 16	Water Fountain-No Chiller	Potable	12/3/2020	5.0	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2814	1049	Room 18	Classroom Faucet	Non-Potable	12/3/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2815	1049	Room 18	Water Fountain-No Chiller	Potable	12/3/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-2816	1050	Room 20	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2817	1050	Room 20	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2818	1051	Room 21	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2819	1051	Room 21	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2820	1052	Room 22	Classroom Faucet	Non-Potable	12/3/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-2821	1052	Room 22	Water Fountain-No Chiller	Potable	12/3/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-2822	1053	Room 23	Classroom Faucet	Non-Potable	12/3/2020	6.7	Result Below Action Level, Continue O&M
BRTWD-2823	1053	Room 23	Water Fountain-No Chiller	Potable	3/25/2021	3.7	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2824	1054	Room 24	Classroom Faucet	Non-Potable	12/3/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2825	1054	Room 24	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2826	1055	Room 25	Classroom Faucet	Non-Potable	12/3/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-2827	1055	Room 25	Water Fountain-No Chiller	Potable	12/3/2020	8.2	Result Below Action Level, Continue O&M
BRTWD-2828	1056	Room 26	Classroom Faucet	Non-Potable	12/3/2020	2.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2829	1056	Room 26	Water Fountain-No Chiller	Potable	12/3/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2830	1059	Room 29	Classroom Faucet	Non-Potable	12/3/2020	5.5	Result Below Action Level, Continue O&M
BRTWD-2831	1059	Room 29	Water Fountain-No Chiller	Potable	12/3/2020	8.7	Result Below Action Level, Continue O&M
BRTWD-2832	1057	Room 27	Classroom Faucet	Non-Potable	12/3/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-2833	1057	Room 27	Water Fountain-No Chiller	Potable	12/3/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2834	1058	Room 28	Classroom Faucet	Non-Potable	12/3/2020	2.3	Result Below Action Level, Continue O&M
BRTWD-2835	1058	Room 28	Water Fountain-No Chiller	Potable	6/16/2021	7.2	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2836	N/A	Room 52	Classroom Faucet	Non-Potable	12/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2837	N/A	Room 52	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2838	N/A	Room 53	Water Fountain-No Chiller	Potable	12/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2839	N/A	Room 53	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2840	N/A	Room 54	Classroom Faucet	Non-Potable	12/3/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2841	N/A	Room 54	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2842	N/A	Room 55	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2843	N/A	Room 55	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2852	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2853	N/A	Faculty Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2856	N/A	Room 56	Classroom Faucet	Non-Potable	12/3/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2857	N/A	Room 56	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2858	N/A	Room 57	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2859	N/A	Room 57	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2860	N/A	Room 58	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2861	N/A	Room 58	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2862	N/A	Room 59	Classroom Faucet	Non-Potable	12/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2863	N/A	Room 59	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2864	N/A	Room 60	Classroom Faucet	Non-Potable	12/3/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2865	N/A	Room 60	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2866	N/A	Room 61	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2867	N/A	Room 61	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2869	N/A	Faculty Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	1.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2873	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2874	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2877	N/A	Room 66	Classroom Faucet	Non-Potable	12/3/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2878	N/A	Room 66	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2879	N/A	Room 67	Water Fountain-No Chiller	Potable	12/3/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2880	N/A	Room 67	Classroom Faucet	Non-Potable	12/3/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-2881	N/A	Room 68	Water Fountain-No Chiller	Potable	12/3/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2882	N/A	Room 68	Classroom Faucet	Non-Potable	12/3/2020	2	Result Below Action Level, Continue O&M
BRTWD-2883	N/A	Room 69	Classroom Faucet	Non-Potable	12/3/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-2884	N/A	Room 69	Water Fountain-No Chiller	Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2885	1040	Corridor Near Cafeteria (1036)	Water Fountain-No Chiller	Potable	12/3/2020	2.7	Replaced by Outlet 3083/3084
BRTWD-3083	1040	Corridor Near Cafeteria (1036)	Water Cooler	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3084	1040	Corridor Near Cafeteria (1036)	Bottle Fill Station	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3085	1040	Corridor Outside Bathrooms (1023/1024)	Water Cooler	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3086	1040	Corridor Outside Bathrooms (1023/1024)	Bottle Fill Station	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
Pine Park Elementary School							
BRTWD-2085	2000	Room 33Room 33	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2086	2000	Room 33	Water Fountain-No Chiller	Potable	11/13/2020	3.0	Result Below Action Level, Continue O&M
BRTWD-2087	2000A	Room 33 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2088	2001A	Faculty Room	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2089	2002	Room 35	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2090	2002	Room35	Water Fountain-No Chiller	Potable	11/13/2020	2	Result Below Action Level, Continue O&M
BRTWD-2091	2002A	Room 35 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2092	2003	Room 36Room 36	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2093	2003	Room 36	Water Fountain-No Chiller	Potable	11/13/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2094	2003A	Room 36 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2096	2004	Room 34	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2097	2004	Room 34	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2098	2004A	Room 34 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2099	2005	Room 32	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2100	2005	Room 32	Water Fountain-No Chiller	Potable	11/13/2020	7.8	Result Below Action Level, Continue O&M
BRTWD-2101	2005A	Room 32 Bathroom	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2102	1001	Room 1	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2103	1001	Room 1	Water Fountain-No Chiller	Potable	11/13/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2104	1001B	Room 1 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-2105	1003	Room 2	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2106	1003	Room 2	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2107	1003A	Room 2 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-2108	1004	Room 3	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2109	1004	Room 3	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2110	1005	Room 4	Classroom Faucet	Non-Potable	11/13/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2111	1005	Room 4	Water Fountain-No Chiller	Potable	11/13/2020	6.7	Result Below Action Level, Continue O&M
BRTWD-2112	1006	Room 5	Classroom Faucet	Non-Potable	11/13/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2113	1006	Room 5	Water Fountain-No Chiller	Potable	11/13/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2114	1007	Room 6	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2115	1007	Room 6	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2116	1003	Room 7	Classroom Faucet	Non-Potable	11/13/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-2117	1003	Room 7	Water Fountain-No Chiller	Potable	11/13/2020	6.2	Result Below Action Level, Continue O&M
BRTWD-2118	1009	Room 8	Classroom Faucet	Non-Potable	11/13/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2119	1009	Room 8	Water Fountain-No Chiller	Potable	11/13/2020	4.8	Result Below Action Level, Continue O&M
BRTWD-2120	1010	Room 9	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2121	1010	Room 9	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2122	1011	Room 10	Classroom Faucet	Non-Potable	11/13/2020	1	Result Below Action Level, Continue O&M
BRTWD-2123	1011	Room 10	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2124	1012	Room 11	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2125	1012	Room 11	Water Fountain-No Chiller	Potable	11/13/2020	1	Result Below Action Level, Continue O&M
BRTWD-2126	1013	Room 12	Classroom Faucet	Non-Potable	11/13/2020	11	Result Below Action Level, Continue O&M
BRTWD-2127	1013	Room 12	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2128	1014	Room 13	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2129	1014	Room 13	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2130	1015	Room 14	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2131	1015	Room 14	Water Fountain-No Chiller	Potable	11/13/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2132	1016	Room 15	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2133	1016	Room 15	Water Fountain-No Chiller	Potable	11/13/2020	6.0	Result Below Action Level, Continue O&M
BRTWD-2134	1022	Women's Faculty Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2135	1061	Corridor Adjacent Women's Bathroom (1022)	Water Cooler	Potable	11/13/2020	<3.0 ND	Replaced by Outlet 3049/3050
BRTWD-2136	1023	Men's Faculty Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2137	1024B	Rear Psychologist Office	Classroom Faucet	Non-Potable	8/23/2022	1.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2138	1025A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2139	1025	Nurse's Office	Nurse's Office Sink	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2141	1033	Faculty Room	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2142	1033	Faculty Room	Bottled Water Dispenser	Potable	11/13/2020	OOS	Testing Required Before Return to Service
BRTWD-2143	1061	Corridor Near Faculty Room (1033)	Water Cooler	Potable	11/13/2020	3.1	Replaced by Outlet 3047/3048
BRTWD-2144	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/13/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2145	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2146	1036	Kitchen	Hand Wash Only	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2147	1036	Kitchen	Pasta Pot/Steam Kettle	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2148	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2149	1036	Kitchen	Spray Nozzle	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2150	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/13/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2151	1036	Kitchen	Kitchen Faucet (Cold)	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2152	1036	Kitchen	Hand Wash Only	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2153	1036A3	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2162	1044	Room 16	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2163	1044	Room 16	Water Fountain-No Chiller	Potable	11/13/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2164	1045	Room 17	Classroom Faucet	Non-Potable	11/13/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2165	1045	Room 17	Water Fountain-No Chiller	Potable	11/13/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2166	1046	Room 18	Classroom Faucet	Non-Potable	11/13/2020	15	Result Below Action Level, Continue O&M
BRTWD-2167	1046	Room 18	Water Fountain-No Chiller	Potable	11/13/2020	8.0	Result Below Action Level, Continue O&M
BRTWD-2168	1047	Room 19	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2169	1047	Room 19	Water Fountain-No Chiller	Potable	11/13/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2170	1048	Room 20	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2171	1048	Room 20	Water Fountain-No Chiller	Potable	11/13/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-2172	1049	Room 21	Classroom Faucet	Non-Potable	11/13/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2173	1049	Room 21	Water Fountain-No Chiller	Potable	11/13/2020	OOS	Testing Required Before Return to Service
BRTWD-2174	1050	Room 22	Classroom Faucet	Non-Potable	11/13/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2175	1050	Room 22	Water Fountain-No Chiller	Potable	11/13/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2176	1052	Room 24	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2177	1052	Room 24	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2178	1053	Room 25	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2179	1053	Room 25	Water Fountain-No Chiller	Potable	11/13/2020	6.3	Result Below Action Level, Continue O&M
BRTWD-2180	1055	Room 27	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2181	1055	Room 27	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2182	1054	Room 26	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2183	1054	Room 26	Water Fountain-No Chiller	Potable	11/13/2020	6.0	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2184	1057	Room 29	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2185	1057	Room 29	Water Fountain-No Chiller	Potable	11/13/2020	4.1	Result Below Action Level, Continue O&M
BRTWD-2186	1056	Room 28	Classroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2187	1056	Room 28	Water Fountain-No Chiller	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2188	1059	Room 31 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2189	1058	Room 30 Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2985	1019A	Main Office Copy Room	Bottled Water Dispenser	Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3047	1061	Corridor Near Faculty Room (1033)	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3048	1061	Corridor Near Faculty Room (1033)	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3049	1061	Corridor Adjacent Women's Bathroom (1022)	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3050	1061	Corridor Adjacent Women's Bathroom (1022)	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M

Pine Park Warehouse

BRTWD-2980	1003	Men's Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	11	Result Below Action Level, Continue O&M
BRTWD-2981	1004	Women's Bathroom	Bathroom Faucet	Non-Potable	11/13/2020	<3.0 ND	Result Below Action Level, Continue O&M

South Middle School

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1799	1050	Corridor Near Auditorium (1051)	Water Fountain-No Chiller	Potable	12/2/2020	<3.0 ND	Replaced by Outlet 3022/3023
BRTWD-1809	1047	Corridor Near Room 123 (1042)	Water Fountain-No Chiller	Potable	12/2/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-1812	1032A	Guidance Office Conference Room	Bottled Water Dispenser	Potable	12/2/2020	OOS	Testing Required Before Return to Service
BRTWD-1813	1047	Corridor Near Room 116 (1036)	Water Fountain-No Chiller	Potable	12/2/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-1818	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1827	N/A	Corridor Near Room 146	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1828	N/A	Corridor Near Room 146	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1829	1028B	Faculty Room Women's Bathroom	Bathroom Faucet	Non-Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1830	1028	Faculty Room	Classroom Faucet	Non-Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1831	1028A	Faculty Room Men's Bathroom	Bathroom Faucet	Non-Potable	12/2/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-1832	1029	Corridor Near Faculty Room (1028)	Water Fountain-No Chiller	Potable	12/2/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1833	1027	Boys Bathroom (Near Cafeteria)	Bathroom Faucet	Non-Potable	12/2/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-1834	1025	Nurse's Office	Nurse's Office Sink	Potable	12/2/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-1835	1025B	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1838	1029	Corridor Near Girls Locker Room (1022)	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1839	1029	Corridor Near Girls Locker Room (1022)	Bottle Fill Station	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1842	1022	Girls Locker Room	Water Fountain-No Chiller	Potable	12/2/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-1843	1022A1	Girls Coach's Office Bathroom	Bathroom Faucet	Non-Potable	5/5/2021	3.9	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1844	1021	Kitchen	Kitchen Faucet (Cold)	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1845	1021	Kitchen	Pasta Pot/Steam Kettle	Potable	12/2/2020	9.7	Result Below Action Level, Continue O&M
BRTWD-1846	1021	Kitchen	Kitchen Faucet (Cold)	Potable	12/2/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1847	1021	Kitchen	Hand Wash Only	Non-Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1848	1021	Kitchen	Kitchen Faucet (Cold)	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1849	1021	Kitchen	Spray Nozzle	Non-Potable	3/25/2021	3.5	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1850	1021	Kitchen	Kitchen Faucet (Cold)	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1853	1021A	Kitchen Locker Room	Bathroom Faucet	Non-Potable	12/2/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-1854	1029	Corridor Near Cafeteria A (1020)	Water Fountain-No Chiller	Potable	12/2/2020	3.2	Replaced by Outlet 3026/3027
BRTWD-1855	1015A	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	12/2/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-1856	1014	Weight Room	Water Fountain-No Chiller	Potable	12/2/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-1859	1014A1	Weight Room Coach's Office Bathroom	Bathroom Faucet	Non-Potable	5/5/2021	18	Outlet Replaced by 3012

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1860	1029	Corridor Near Room 110 (1011)	Water Fountain-No Chiller	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1861	1007	Room 106	Home Economics Faucet (Cold)	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1862	1007	Room 106	Home Economics Faucet (Cold)	Potable	12/2/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1863	1007	Room 106	Home Economics Faucet (Cold)	Potable	12/2/2020	1	Result Below Action Level, Continue O&M
BRTWD-1868	1004	Room 104	Home Economics Faucet (Cold)	Potable	12/2/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-1869	1004	Room 104	Home Economics Faucet (Cold)	Potable	12/2/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-1870	1004	Room 104	Home Economics Faucet (Cold)	Potable	12/2/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-1871	1004	Room 104	Home Economics Faucet (Cold)	Potable	12/2/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-1872	1004A	Room 104 Laundry Room/Storage	Classroom Faucet	Non-Potable	12/2/2020	13	Result Below Action Level, Continue O&M
BRTWD-1873	1029	Corridor Near Room 104 (1004)	Water Fountain-No Chiller	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1883	2042	Corridor Near Room 202 (2038)	Water Fountain-No Chiller	Potable	12/2/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-1895	2042	Corridor Near Stairwell (2029)	Water Fountain-No Chiller	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1896	2021A	Library Work Room	Classroom Faucet	Non-Potable	12/2/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1897	2042	Corridor Near Room 216 (2020)	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1898	2042	Corridor Near Room 216 (2020)	Bottle Fill Station	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1903	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/2/2020	OOS	Testing Required Before Return to Service
BRTWD-1904	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1910	N/A	Corridor Near Room 248	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1911	N/A	Corridor Near Room 248	Water Cooler	Potable	12/2/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1912	2025	Corridor Near Room 218 (2016)	Water Fountain-No Chiller	Potable	12/2/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-1916	2025	Corridor Near Room 226 (2008)	Water Fountain-No Chiller	Potable	12/2/2020	10	Replaced by Outlet 3024/3025
BRTWD-3002	1042	Room 123 Life Skills	Home Economics Faucet (Cold)	Potable	10/28/2021	2.7	Result Below Action Level, Continue O&M
BRTWD-3012	1014A1	Weight Room Office Bathroom	Bathroom Faucet	Non-Potable	8/24/2022	6.5	Result Below Action Level, Continue O&M
BRTWD-3022	1050	Auditorium Lobby	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3023	1050	Auditorium Lobby	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3024	2025	Corridor Near Room 226 (2008)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3025	2025	Corridor Near Room 226 (2008)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3026	1029	Corridor Near Cafeteria A (1020)	Water Cooler	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3027	1029	Corridor Near Cafeteria A (1020)	Bottle Fill Station	Potable	10/18/2022	<3.0 ND	Result Below Action Level, Continue O&M

Southeast Elementary School

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2664	1001	Room 101	Classroom Faucet	Non-Potable	12/1/2020	8.1	Result Below Action Level, Continue O&M
BRTWD-2665	1001	Room 101	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2666	1001B	Room 101 Bathroom	Bathroom Faucet	Non-Potable	6/16/2021	8.8	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2667	1002	Room 102	Classroom Faucet	Non-Potable	12/1/2020	6.6	Result Below Action Level, Continue O&M
BRTWD-2668	1002	Room 102	Water Fountain-No Chiller	Potable	12/1/2020	6.8	Result Below Action Level, Continue O&M
BRTWD-2669	1002B	Room 102 Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	7.5	Result Below Action Level, Continue O&M
BRTWD-2670	1004	Room 11	Classroom Faucet	Non-Potable	12/1/2020	5.1	Result Below Action Level, Continue O&M
BRTWD-2671	1004	Room 11	Water Fountain-No Chiller	Potable	12/1/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-2672	1005	Room 12	Classroom Faucet	Non-Potable	5/7/2021	3.8	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2673	1005	Room 12	Water Fountain-No Chiller	Potable	12/1/2020	7.2	Result Below Action Level, Continue O&M
BRTWD-2674	1006	Room 9	Classroom Faucet	Non-Potable	12/1/2020	7.2	Result Below Action Level, Continue O&M
BRTWD-2675	1006	Room 9	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2676	1007	Room 10	Classroom Faucet	Non-Potable	12/1/2020	5.1	Result Below Action Level, Continue O&M
BRTWD-2677	1007	Room 10	Water Fountain-No Chiller	Potable	12/1/2020	6.0	Result Below Action Level, Continue O&M
BRTWD-2678	1008	Room 7	Classroom Faucet	Non-Potable	12/1/2020	6.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2679	1008	Room 7	Water Fountain-No Chiller	Potable	12/1/2020	7.0	Result Below Action Level, Continue O&M
BRTWD-2680	1009	Room 8	Classroom Faucet	Non-Potable	12/1/2020	4.7	Result Below Action Level, Continue O&M
BRTWD-2681	1009	Room 8	Water Fountain-No Chiller	Potable	12/1/2020	8.3	Result Below Action Level, Continue O&M
BRTWD-2682	1010	Room 5	Classroom Faucet	Non-Potable	12/1/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-2683	1010	Room 5	Water Fountain-No Chiller	Potable	12/1/2020	OOS	Testing Required Before Return to Service
BRTWD-2684	1011	Room 6	Classroom Faucet	Non-Potable	12/1/2020	6.8	Result Below Action Level, Continue O&M
BRTWD-2685	1011	Room 6	Water Fountain-No Chiller	Potable	12/1/2020	11	Result Below Action Level, Continue O&M
BRTWD-2686	1012	Room 3	Classroom Faucet	Non-Potable	12/1/2020	5.0	Result Below Action Level, Continue O&M
BRTWD-2687	1012	Room 3	Water Fountain-No Chiller	Potable	12/1/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-2688	1013	Room 4	Classroom Faucet	Non-Potable	12/1/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2689	1013	Room 4	Water Fountain-No Chiller	Potable	12/1/2020	9.5	Result Below Action Level, Continue O&M
BRTWD-2690	1014	Room 1	Classroom Faucet	Non-Potable	12/1/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-2691	1014	Room 1	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2692	1017	Mens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	12/1/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2694	1020	Womens Bathroom (Near Gym)	Bathroom Faucet	Non-Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2695	1000	Nurse's Office	Nurse's Office Sink	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2696	1000B	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	8.8	Result Below Action Level, Continue O&M
BRTWD-2697	1032	Corridor Near Gymnasium (1025)	Water Fountain-No Chiller	Potable	12/1/2020	4.2	Replaced by Outlet 3069/3070
BRTWD-2698	1025A1	Coach's Office	Bottled Water Dispenser	Potable	12/1/2020	OOS	Testing Required Before Return to Service
BRTWD-2699	1032	Corridor Near Cafeteria (1028)	Water Fountain-No Chiller	Potable	12/1/2020	7.8	Replaced by Outlet 3067/3068
BRTWD-2700	1029	Kitchen	Hand Wash Only	Non-Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2701	1029	Kitchen	Pasta Pot/Steam Kettle	Potable	12/1/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2702	1029	Kitchen	Kitchen Faucet (Cold)	Potable	12/1/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-2704	1029	Kitchen	Kitchen Faucet (Cold)	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2705	1029	Kitchen	Hand Wash Only	Non-Potable	5/7/2021	12	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2707	1030A	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-2708	1035	Faculty Room	Classroom Faucet	Non-Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2716	1040	Room 16	Classroom Faucet	Non-Potable	12/1/2020	15	Result Below Action Level, Continue O&M
BRTWD-2717	1040	Room 16	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2718	1041	Room 13	Classroom Faucet	Non-Potable	12/1/2020	5.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2719	1041	Room 13	Water Fountain-No Chiller	Potable	12/1/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-2720	1042	Room 18	Classroom Faucet	Non-Potable	5/7/2021	2	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2721	1042	Room 18	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2722	1043	Room 15	Classroom Faucet	Non-Potable	5/7/2021	3.3	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2723	1043	Room 15	Water Fountain-No Chiller	Potable	12/1/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-2724	1044	Room 20	Classroom Faucet	Non-Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2725	1044	Room 20	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2726	1045	Room 17	Classroom Faucet	Non-Potable	12/1/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-2727	1045	Room 17	Water Fountain-No Chiller	Potable	12/1/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-2728	1046	Room 22	Classroom Faucet	Non-Potable	12/1/2020	12	Result Below Action Level, Continue O&M
BRTWD-2729	1046	Room 22	Water Fountain-No Chiller	Potable	8/24/2022	20	Removed From Service, Pending Remediation
BRTWD-2730	1047	Room 19	Classroom Faucet	Non-Potable	12/1/2020	14	Result Below Action Level, Continue O&M
BRTWD-2731	1047	Room 19	Water Fountain-No Chiller	Potable	12/1/2020	6.5	Result Below Action Level, Continue O&M
BRTWD-2732	1048	Room 24	Classroom Faucet	Non-Potable	12/1/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2733	1048	Room 24	Water Fountain-No Chiller	Potable	12/1/2020	7.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2734	1054	Room 25	Classroom Faucet	Non-Potable	12/1/2020	6.0	Result Below Action Level, Continue O&M
BRTWD-2735	1055	Room 26	Classroom Faucet	Non-Potable	12/1/2020	12	Result Below Action Level, Continue O&M
BRTWD-2736	1055	Room 26	Water Fountain-No Chiller	Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2737	N/A	Room 27 Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	6.9	Result Below Action Level, Continue O&M
BRTWD-2738	N/A	Room 28 Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	OOS	Testing Required Before Return to Service
BRTWD-2739	N/A	Room 29 Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-2740	N/A	Room 30 Bathroom	Bathroom Faucet	Non-Potable	12/1/2020	5.4	Result Below Action Level, Continue O&M
BRTWD-2988	1029	Kitchen	Hand Wash Only	Non-Potable	12/1/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3067	1032	Corridor Near Cafeteria (1028)	Water Cooler	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3068	1032	Corridor Near Cafeteria (1028)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3069	1032	Corridor Near Gymnasium (1025)	Water Cooler	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3070	1032	Corridor Near Gymnasium (1025)	Bottle Fill Station	Potable	12/7/2022	<3.0 ND	Result Below Action Level, Continue O&M

Southwest Elementary School

BRTWD-0713	1005	Kindergarten Room 2A	Classroom Faucet	Non-Potable	11/5/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-0714	1005	Kindergarten Room 2A	Water Fountain-No Chiller	Potable	11/5/2020	2.1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0715	1005A	Kindergarten Room 2A Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0716	1006	Kindergarten Room 1A	Classroom Faucet	Non-Potable	11/5/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-0717	1006	Kindergarten Room 1A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0718	1006A	Kindergarten Room 1A Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0719	1007	Room 3A	Classroom Faucet	Non-Potable	11/5/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-0720	1007	Room 3A	Water Fountain-No Chiller	Potable	11/5/2020	5.2	Result Below Action Level, Continue O&M
BRTWD-0721	1008	Room 4A	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0722	1008	Room 4A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0723	1009	Room 5A	Classroom Faucet	Non-Potable	11/5/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-0724	1009	Room 5A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0725	1010	Room 6A	Classroom Faucet	Non-Potable	11/5/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-0726	1010	Room 6A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0727	1011	Room 7A	Classroom Faucet	Non-Potable	11/5/2020	3.7	Result Below Action Level, Continue O&M
BRTWD-0728	1011	Room 7A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0729	1012	Room 8A	Classroom Faucet	Non-Potable	11/5/2020	9.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0730	1012	Room 8A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0731	1013	Room 9A	Classroom Faucet	Non-Potable	11/5/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0732	1013	Room 9A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0733	1014	Room 10A	Classroom Faucet	Non-Potable	11/5/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-0734	1014	Room 10A	Water Fountain-No Chiller	Potable	11/5/2020	2.4	Result Below Action Level, Continue O&M
BRTWD-0735	1016	Room 11A	Classroom Faucet	Non-Potable	6/17/2021	12	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0736	1016	Room 11A	Water Fountain-No Chiller	Potable	11/5/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-0737	1017	Men's Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	5.2	Result Below Action Level, Continue O&M
BRTWD-0738	1018	Women's Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	5.7	Result Below Action Level, Continue O&M
BRTWD-0739	1021	Corridor Near Main Office (1020)	Water Cooler	Potable	11/5/2020	<3.0 ND	Replaced by Outlet 3077/3078
BRTWD-0740	1022B	Cafeteria Nurse's Office	Nurse's Office Sink	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0741	1022B2	Cafeteria Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-0742	1022A2B	Gym Activities Room Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0743	1022D	Kitchen	Hand Wash Only	Non-Potable	11/5/2020	6.0	Result Below Action Level, Continue O&M
BRTWD-0744	1022D	Kitchen	Spray Nozzle	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0745	1022D	Kitchen	Kitchen Faucet (Cold)	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0748	1025	Math Lab (Room 2)	Classroom Faucet	Non-Potable	11/5/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-0749	1025	Math Lab (Room 2)	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0750	1026	Library	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0751	1027	Room 4	Classroom Faucet	Non-Potable	11/5/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0752	1027	Room 4	Water Fountain-No Chiller	Potable	11/5/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0753	1029B	Speech Room 6 Work Room 2	Classroom Faucet	Non-Potable	11/5/2020	3.3	Result Below Action Level, Continue O&M
BRTWD-0754	1029B	Speech Room 6 Work Room 2	Water Fountain-No Chiller	Potable	11/5/2020	12	Result Below Action Level, Continue O&M
BRTWD-0755	1030	Math Lab Room 7	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0756	1031	Room 8	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0757	1034	Men's Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0758	1041	Room 31	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0759	1041	Room 31	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0760	1042	Room 33	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0761	1042	Room 33	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0762	1043	Room 35	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0763	1043	Room 35	Water Fountain-No Chiller	Potable	11/5/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-0764	1045	Room 34	Classroom Faucet	Non-Potable	11/5/2020	6.8	Result Below Action Level, Continue O&M
BRTWD-0765	1045	Room 34	Water Fountain-No Chiller	Potable	11/5/2020	3.1	Result Below Action Level, Continue O&M
BRTWD-0766	1046	Room 32	Classroom Faucet	Non-Potable	11/5/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-0767	1046	Room 32	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0768	1047	Room 32	Classroom Faucet	Non-Potable	11/5/2020	1	Result Below Action Level, Continue O&M
BRTWD-0769	1047	Room 30	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0770	1048	Women's Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0772	1051	Men's Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0773	1058	Cafeteria	Water Cooler	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0775	1066	Corridor Near Custodial Closet (1059)	Water Fountain-No Chiller	Potable	11/5/2020	15	Replaced by Outlet 3075/3076
BRTWD-0776	1060	Women's Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0777	1063	Faculty Room	Kitchen Faucet (Cold)	Potable	11/5/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-0778	1063	Faculty Room	Bottled Water Dispenser	Potable	11/5/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0779	1065	Nurse's Office	Nurse's Office Sink	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0780	1065A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	3.0	Result Below Action Level, Continue O&M
BRTWD-0786	1071	Room 15	Classroom Faucet	Non-Potable	11/5/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-0787	1071	Room 15	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0788	1072	Room 16	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0789	1072	Room 16	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0790	1073	Room 17	Classroom Faucet	Non-Potable	11/5/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-0791	1073	Room 17	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0792	1074	Room 18	Classroom Faucet	Non-Potable	11/5/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0793	1074	Room 18	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0794	1075	Room 19	Classroom Faucet	Non-Potable	11/5/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-0795	1075	Room 19	Water Fountain-No Chiller	Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0796	1076	Room 20	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0797	1076	Room 20	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0798	1077A1	Room 20X Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	2.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0799	1077A3	Room 20X Psychologist Office	Bottled Water Dispenser	Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0800	1079	Room 21	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0801	1079	Room 21	Water Fountain-No Chiller	Potable	11/5/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0802	1080	Room 22	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0803	1080	Room 22	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0804	1081	Room 23	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0805	1081	Room 23	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0806	1082	Room 24	Classroom Faucet	Non-Potable	11/5/2020	4.2	Result Below Action Level, Continue O&M
BRTWD-0807	1082	Room 24	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0808	1083	Room 25	Classroom Faucet	Non-Potable	11/5/2020	3.9	Result Below Action Level, Continue O&M
BRTWD-0809	1083	Room 25	Water Fountain-No Chiller	Potable	11/5/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0810	1084	Room 26	Classroom Faucet	Non-Potable	11/5/2020	4.5	Result Below Action Level, Continue O&M
BRTWD-0811	1084	Room 26	Water Fountain-No Chiller	Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0815	3008	Corridor Near Room 32	Water Cooler	Potable	11/5/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-0818	3004	Room 36	Classroom Faucet	Non-Potable	11/5/2020	1.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0819	3004	Room36	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0820	3006	Room38	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0821	3006	Room38	Classroom Faucet	Non-Potable	11/5/2020	1	Result Below Action Level, Continue O&M
BRTWD-0822	3005	Room37	Classroom Faucet	Non-Potable	11/5/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-0823	3005	Room37	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0824	3007	Room39	Classroom Faucet	Non-Potable	11/5/2020	1	Result Below Action Level, Continue O&M
BRTWD-0825	3007	Room 39	Water Fountain-No Chiller	Potable	11/5/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-0826	2003	Room 13A	Classroom Faucet	Non-Potable	11/5/2020	5.6	Result Below Action Level, Continue O&M
BRTWD-0827	2003	Room 13A	Water Fountain-No Chiller	Potable	11/5/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-0828	2004	Room 12A	Classroom Faucet	Non-Potable	11/5/2020	7.2	Result Below Action Level, Continue O&M
BRTWD-0829	2004	Room 12A	Water Fountain-No Chiller	Potable	11/5/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0830	2005	Room 15A	Classroom Faucet	Non-Potable	11/5/2020	7.8	Result Below Action Level, Continue O&M
BRTWD-0831	2005	Room 15A	Water Fountain-No Chiller	Potable	11/5/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0832	2006	Room 14A	Classroom Faucet	Non-Potable	11/5/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-0833	2006	Room 14A	Water Fountain-No Chiller	Potable	11/5/2020	1.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0834	2007	Room 17A	Classroom Faucet	Non-Potable	11/5/2020	9.8	Result Below Action Level, Continue O&M
BRTWD-0835	2007	Room 17A	Water Fountain-No Chiller	Potable	11/5/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-0836	2008	Room 16A	Classroom Faucet	Non-Potable	11/5/2020	8.5	Result Below Action Level, Continue O&M
BRTWD-0837	2008	Room 16A	Water Fountain-No Chiller	Potable	11/5/2020	3.2	Result Below Action Level, Continue O&M
BRTWD-0838	2009	Room 19A	Classroom Faucet	Non-Potable	11/5/2020	6.1	Result Below Action Level, Continue O&M
BRTWD-0839	2009	Room 19A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0840	2010	Room 18A	Classroom Faucet	Non-Potable	11/5/2020	6.4	Result Below Action Level, Continue O&M
BRTWD-0841	2010	Room 18A	Water Fountain-No Chiller	Potable	11/5/2020	1	Result Below Action Level, Continue O&M
BRTWD-0842	2011	Room 21A	Classroom Faucet	Non-Potable	8/23/2022	3.8	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0843	2011	Room 21A	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0844	2012	Room 20A	Classroom Faucet	Non-Potable	11/5/2020	4.9	Result Below Action Level, Continue O&M
BRTWD-0845	2012	Room 20A	Water Fountain-No Chiller	Potable	11/5/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0846	2014	Room 22A	Classroom Faucet	Non-Potable	11/5/2020	12	Result Below Action Level, Continue O&M
BRTWD-0847	2014	Room 22A	Water Fountain-No Chiller	Potable	11/5/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-0848	2015B	ESL Room 23A Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	6.7	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0849	2015C	ESL Room 23A Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-0850	2018	Corridor Near Custodial Closet (2016)	Water Cooler	Potable	11/5/2020	OOS	Testing Required Before Return to Service
BRTWD-0851	2021	Room 46	Classroom Faucet	Non-Potable	11/5/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0852	2021	Room 46	Water Fountain-No Chiller	Potable	11/5/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0853	2022	Room 45	Classroom Faucet	Non-Potable	11/5/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-0854	2022	Room 45	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0855	2023	Room 44	Classroom Faucet	Non-Potable	11/5/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-0856	2023	Room 44	Water Fountain-No Chiller	Potable	11/5/2020	2	Result Below Action Level, Continue O&M
BRTWD-0857	2024	Room 43	Classroom Faucet	Non-Potable	8/23/2022	1.8	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-0858	2024	Room 43	Water Fountain-No Chiller	Potable	11/5/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-0859	2025	Room 42	Classroom Faucet	Non-Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0860	2025	Room 42	Water Fountain-No Chiller	Potable	11/5/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-0861	2026	Room 41	Classroom Faucet	Non-Potable	11/5/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0862	2026	Room 41	Water Fountain-No Chiller	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0870	2028	Room 40	Classroom Faucet	Non-Potable	11/5/2020	2.6	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0871	2028	Room 40	Water Fountain-No Chiller	Potable	11/5/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-0872	1058A	Kitchen	Hand Wash Only	Non-Potable	11/5/2020	8.2	Result Below Action Level, Continue O&M
BRTWD-0873	1058A	Kitchen	Spray Nozzle	Non-Potable	11/5/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0874	1058A	Kitchen	Kitchen Faucet (Cold)	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0875	1058A	Kitchen	Pasta Pot/Steam Kettle	Potable	11/5/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0876	1058A	Kitchen	Kitchen Faucet (Cold)	Potable	11/5/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0877	1058A	Kitchen	Spray Nozzle	Non-Potable	11/5/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-0878	1058A	Kitchen	Kitchen Faucet (Cold)	Potable	11/5/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-0879	1058A	Kitchen	Kitchen Faucet (Cold)	Potable	11/5/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0880	1058A	Kitchen	Hand Wash Only	Non-Potable	11/5/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0884	1058F	Kitchen Bathroom	Bathroom Faucet	Non-Potable	11/5/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0885	1028	Room 5	Classroom Faucet	Non-Potable	11/5/2020	2.9	Result Below Action Level, Continue O&M
BRTWD-0886	1028	Room 5	Water Fountain-No Chiller	Potable	11/5/2020	3.6	Result Below Action Level, Continue O&M
BRTWD-3075	1066	Corridor Near Custodial Closet (1059)	Water Cooler	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3076	1066	Corridor Near Custodial Closet (1059)	Bottle Fill Station	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-3077	1021	Corridor Near Main Office (1020)	Water Cooler	Potable	12/8/2022	1.2	Result Below Action Level, Continue O&M
BRTWD-3078	1021	Corridor Near Main Office (1020)	Bottle Fill Station	Potable	12/8/2022	<3.0 ND	Result Below Action Level, Continue O&M

Special Services Building

BRTWD-2945	1021A	Offices Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2946	1015	Women's Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2947	1014	Unisex Bathroom	Bathroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2948	1011	Faculty Room	Classroom Faucet	Non-Potable	12/3/2020	<3.0 ND	Outlet Permanently Removed
BRTWD-2949	1011	Faculty Room	Water Cooler	Potable	12/3/2020	OOS	Testing Required Before Return to Service
BRTWD-2950	1011	Faculty Room	Bottled Water Dispenser	Potable	12/3/2020	<3.0 ND	Outlet Permanently Removed
BRTWD-3003	1011	Faculty Room	Kitchen Faucet (Cold)	Potable	10/28/2021	<3.0 ND	Result Below Action Level, Continue O&M

Twin Pines Elementary School

BRTWD-0902	N/A	Room 1A	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0903	N/A	Room 1A	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0904	N/A	Room 2A	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0905	N/A	Room 2A	Classroom Faucet	Non-Potable	11/17/2020	4.3	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0906	1001	Kindergarten Room 2	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0907	1001	Kindergarten Room 2	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0908	1000	Room 1	Classroom Faucet	Non-Potable	11/17/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0909	1000	Room 1	Water Fountain-No Chiller	Potable	11/17/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0911	1003	Room 3	Classroom Faucet	Non-Potable	11/17/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-0912	1003	Room 3	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0913	1004	Room 4	Classroom Faucet	Non-Potable	11/17/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0914	1004	Room 4	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0915	1004C	Room 4 Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-0916	1005	Room 5	Classroom Faucet	Non-Potable	11/17/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0917	1005	Room 5	Water Fountain-No Chiller	Potable	11/17/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-0918	1007	Kindergarten Room 6	Bottled Water Dispenser	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0919	1007	Kindergarten Room 6	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0920	1007	Kindergarten Room 6	Water Fountain-No Chiller	Potable	6/17/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-0921	1007C	Kindergarten Room 6 Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	8.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0922	1008	Room 7	Classroom Faucet	Non-Potable	11/17/2020	5.3	Result Below Action Level, Continue O&M
BRTWD-0923	1008	Room 7	Water Fountain-No Chiller	Potable	11/17/2020	3	Result Below Action Level, Continue O&M
BRTWD-0924	1009	Room 8	Classroom Faucet	Non-Potable	11/17/2020	2.1	Result Below Action Level, Continue O&M
BRTWD-0925	1009	Room 8	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0926	1010	Room 9	Classroom Faucet	Non-Potable	11/17/2020	2	Result Below Action Level, Continue O&M
BRTWD-0927	1010	Room 9	Water Fountain-No Chiller	Potable	11/17/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-0928	1011	Room 10	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0929	1011	Room 10	Water Fountain-No Chiller	Potable	11/17/2020	3	Result Below Action Level, Continue O&M
BRTWD-0930	1012	Room 11	Classroom Faucet	Non-Potable	11/17/2020	1.1	Result Below Action Level, Continue O&M
BRTWD-0931	1012	Room 11	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0932	1013	Room 12	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0933	1013	Room 12	Water Fountain-No Chiller	Potable	11/17/2020	1.7	Result Below Action Level, Continue O&M
BRTWD-0934	1014	Room 13	Classroom Faucet	Non-Potable	11/17/2020	1.8	Result Below Action Level, Continue O&M
BRTWD-0935	1014	Room 13	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0936	1016	Room 15A	Classroom Faucet	Non-Potable	11/17/2020	6.1	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0937	1016	Room 15A	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0938	1015	Computer Room 14	Classroom Faucet	Non-Potable	11/17/2020	7.5	Result Below Action Level, Continue O&M
BRTWD-0939	1015	Computer Room 14	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0940	1019	Room 16	Classroom Faucet	Non-Potable	11/17/2020	1.4	Result Below Action Level, Continue O&M
BRTWD-0941	1019	Room 16	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0947	1036	Nurse's Office	Nurse's Office Sink	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0948	1038	Nurse's Office Back Office	Nurse's Office Sink	Potable	11/17/2020	280	Replaced by Outlet 2999
BRTWD-0949	1036A	Nurse Office Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0950	1032A	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-0951	1044	Corridor Near Gymnasium (1033)	Water Cooler	Potable	11/17/2020	OOS	Replaced by Outlet 3043/3044
BRTWD-0952	1034A	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	6.0	Result Below Action Level, Continue O&M
BRTWD-0953	1044	Corridor Near Custodial Office	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Replaced by Outlet 3045/3046
BRTWD-0954	1045	Maintenance Room	Bottled Water Dispenser	Potable	11/17/2020	OOS	Testing Required Before Return to Service
BRTWD-0955	1048	Music Room	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0963	1052	Room 18	Classroom Faucet	Non-Potable	6/17/2021	1.1	Outlet Remediated Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0964	1052	Room 18	Water Fountain-No Chiller	Potable	6/17/2021	<3.0 ND	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-0965	1053	Room 17	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0966	1053	Room 17	Water Fountain-No Chiller	Potable	11/17/2020	6.4	Result Below Action Level, Continue O&M
BRTWD-0967	1054	Room 20	Classroom Faucet	Non-Potable	11/17/2020	8.3	Result Below Action Level, Continue O&M
BRTWD-0968	1054	Room 20	Water Fountain-No Chiller	Potable	11/17/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-0969	1055	Room 19	Classroom Faucet	Non-Potable	11/17/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-0970	1055	Room 19	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0971	1056	Room 22	Classroom Faucet	Non-Potable	11/17/2020	4.4	Result Below Action Level, Continue O&M
BRTWD-0972	1056	Room 22	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0973	1057	Room 21	Classroom Faucet	Non-Potable	11/17/2020	8.1	Result Below Action Level, Continue O&M
BRTWD-0974	1057	Room 21	Water Fountain-No Chiller	Potable	11/17/2020	2	Result Below Action Level, Continue O&M
BRTWD-0975	1058	Room 24	Classroom Faucet	Non-Potable	11/17/2020	3.5	Result Below Action Level, Continue O&M
BRTWD-0976	1058	Room 24	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0977	1059	Room 23	Classroom Faucet	Non-Potable	11/17/2020	5.5	Result Below Action Level, Continue O&M
BRTWD-0978	1059	Room 23	Water Fountain-No Chiller	Potable	11/17/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-0979	1060	Room 26	Classroom Faucet	Non-Potable	11/17/2020	10	Result Below Action Level, Continue O&M
BRTWD-0980	1060	Room 26	Water Fountain-No Chiller	Potable	11/17/2020	6.6	Result Below Action Level, Continue O&M
BRTWD-0981	1061	Room 25	Classroom Faucet	Non-Potable	11/17/2020	11	Result Below Action Level, Continue O&M
BRTWD-0982	1061	Room 25	Water Fountain-No Chiller	Potable	11/17/2020	9.2	Result Below Action Level, Continue O&M
BRTWD-0983	1062	Room 28	Classroom Faucet	Non-Potable	11/17/2020	4.0	Result Below Action Level, Continue O&M
BRTWD-0984	1062	Room 28	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0985	1063	Room 27	Classroom Faucet	Non-Potable	11/17/2020	8.5	Result Below Action Level, Continue O&M
BRTWD-0986	1063	Room 27	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0987	1064	Room 30	Classroom Faucet	Non-Potable	11/17/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-0988	1064	Room 30	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0989	1064	Room 30	Bottled Water Dispenser	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0990	1065	Room 29	Classroom Faucet	Non-Potable	11/17/2020	7.6	Result Below Action Level, Continue O&M
BRTWD-0991	1065	Room 29	Water Fountain-No Chiller	Potable	11/17/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-0996	N/A	Corridor Near Bathrooms	Water Cooler	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-0997	N/A	Unisex Bathroom (Near Room 31)	Bathroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1000	N/A	Room 31	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1001	N/A	Room 31	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1002	N/A	Room 32	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1003	N/A	Room 32	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1004	N/A	Room 33	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1005	N/A	Room 33	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1006	N/A	Room 34	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1007	N/A	Room 34	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1008	N/A	Room 35	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1009	N/A	Room 35	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1010	N/A	Room 36	Classroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1011	N/A	Room 36	Water Fountain-No Chiller	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1012	1043	Kitchen	Kitchen Faucet (Cold)	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1013	1043	Kitchen	Kitchen Faucet (Cold)	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1014	1043	Kitchen	Pasta Pot/Steam Kettle	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1015	1043	Kitchen	Kitchen Faucet (Cold)	Potable	11/17/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1016	1043	Kitchen	Spray Nozzle	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1017	1043	Kitchen	Kitchen Faucet (Cold)	Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1018	1043	Kitchen	Kitchen Faucet (Cold)	Potable	11/17/2020	9.0	Result Below Action Level, Continue O&M
BRTWD-1019	1043	Kitchen	Hand Wash Only	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1020	1043	Kitchen	Hand Wash Only	Non-Potable	11/17/2020	11	Result Below Action Level, Continue O&M
BRTWD-1021	1043A	Kitchen Locker Room	Bathroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1023	N/A	Music Room Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1024	N/A	Art Room Bathroom	Bathroom Faucet	Non-Potable	11/17/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2999	1038	Nurse's Office Back Office	Nurse's Office Sink	Potable	3/26/2021	2.8	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-3043	1044	Corridor Kitchen to Faculty Bathrooms	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3044	1044	Corridor Kitchen to Faculty Bathrooms	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3045	1044	Corridor Kitchen to Faculty Bathrooms	Water Cooler	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3046	1044	Corridor Kitchen to Faculty Bathrooms	Bottle Fill Station	Potable	12/6/2022	<3.0 ND	Result Below Action Level, Continue O&M

West Middle School

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1938	1000	Auditorium Lobby Mens Bathroom	Bathroom Faucet	Non-Potable	5/6/2021	9.1	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1939	1000	Auditorium Lobby Mens Bathroom	Bathroom Faucet	Non-Potable	5/6/2021	14	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1940	1001	Auditorium Lobby Womens Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	OOS	Testing Required Before Return to Service
BRTWD-1941	1001	Auditorium Lobby Womens Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	5.0	Result Below Action Level, Continue O&M
BRTWD-1942	1002	Corridor Near Auditorium	Water Fountain-No Chiller	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1947	1026	Corridor Near Room 124 (1016)	Water Fountain-No Chiller	Potable	12/9/2020	16	Replaced by Outlet 3009/3010
BRTWD-1953	1017	Room 121	Classroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1954	1018	Room 122	Classroom Faucet	Non-Potable	12/9/2020	8.0	Result Below Action Level, Continue O&M
BRTWD-1955	1019	Guidance Office	Bottled Water Dispenser	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1956	1026	Corridor Near Student Management Office (1023)	Water Fountain-No Chiller	Potable	12/9/2020	37	Replaced by Outlet 3008
BRTWD-1961	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/9/2020	2.4	Replaced by Outlet 3087/3088
BRTWD-1962	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/9/2020	6.5	Replaced by Outlet 3087/3088
BRTWD-1970	N/A	Corridor Near Room 148	Water Cooler	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1971	N/A	Corridor Near Room 148	Water Cooler	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1972	1027B	Faculty Room Womens Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	1.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1973	1027	Faculty Room	Classroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1974	1027A	Faculty Room Men's Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1975	1050	Corridor Near Faculty Room (1027)	Water Fountain-No Chiller	Potable	12/9/2020	14	Result Below Action Level, Continue O&M
BRTWD-1976	1028	Boys Bathroom (Across Faculty Room)	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1977	1029	Nurse's Office	Nurse's Office Sink	Potable	12/9/2020	2.6	Result Below Action Level, Continue O&M
BRTWD-1978	1029C	Nurse's Office - Inner Office	Nurse's Office Sink	Potable	12/9/2020	15	Result Below Action Level, Continue O&M
BRTWD-1979	1029A	Nurse's Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	8.3	Result Below Action Level, Continue O&M
BRTWD-1982	1050	Corridor Near Girls Locker Room (1030)	Water Fountain-No Chiller	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1985	1035B	Girls Locker Room	Water Fountain-No Chiller	Potable	12/9/2020	4.3	Result Below Action Level, Continue O&M
BRTWD-1986	1035B1A	Girls Coach's Office Bathroom	Bathroom Faucet	Non-Potable	5/6/2021	4.3	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-1987	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/9/2020	5.8	Result Below Action Level, Continue O&M
BRTWD-1988	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1989	1033	Kitchen	Hand Wash Only	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1990	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/9/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-1991	1033	Kitchen	Spray Nozzle	Non-Potable	12/9/2020	13	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-1992	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/9/2020	2.2	Result Below Action Level, Continue O&M
BRTWD-1993	1033	Kitchen	Pasta Pot/Steam Kettle	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1994	1033	Kitchen	Kitchen Faucet (Cold)	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1995	1033	Kitchen	Hand Wash Only	Non-Potable	12/9/2020	1.3	Result Below Action Level, Continue O&M
BRTWD-1997	1033B	Kitchen Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-1998	1050	Corridor Near Cafeteria (1034)	Water Fountain-No Chiller	Potable	12/9/2020	11	Replaced by Outlet 3038/3039
BRTWD-1999	1036A	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2000	1035A	Boys Locker Room	Water Fountain-No Chiller	Potable	12/9/2020	6.8	Result Below Action Level, Continue O&M
BRTWD-2003	1035A4A	Boys Coach's Office Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	3.4	Result Below Action Level, Continue O&M
BRTWD-2004	1050	Corridor Near Room 110 (1039)	Water Fountain-No Chiller	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2005	1043	Room 106	Home Economics Faucet (Cold)	Potable	12/9/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2006	1043	Room 106	Home Economics Faucet (Cold)	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2007	1043	Room 106	Home Economics Faucet (Cold)	Potable	12/9/2020	2.5	Result Below Action Level, Continue O&M
BRTWD-2012	1047	Room 104	Home Economics Faucet (Cold)	Potable	12/9/2020	5.9	Result Below Action Level, Continue O&M
BRTWD-2013	1047	Room 104	Home Economics Faucet (Cold)	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2014	1047	Room 104	Home Economics Faucet (Cold)	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2015	1047	Room 104	Home Economics Faucet (Cold)	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2016	1043A	Room 104/106 Laundry Room	Home Economics Faucet (Cold)	Potable	5/6/2021	2.5	Outlet Remediated and Returned to Service, Continue O&M
BRTWD-2017	1050	Corridor Near Room 104 (1047)	Water Fountain-No Chiller	Potable	12/9/2020	1.2	Result Below Action Level, Continue O&M
BRTWD-2026	2040	Mens Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	12/9/2020	27	Replaced by Outlet 3001
BRTWD-2027	2040	Mens Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	12/9/2020	1.6	Result Below Action Level, Continue O&M
BRTWD-2028	2043	Corridor Near Room 202 (2041)	Water Fountain-No Chiller	Potable	12/9/2020	1.9	Result Below Action Level, Continue O&M
BRTWD-2032	2038	Womens Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	12/9/2020	OOS	Testing Required Before Return to Service
BRTWD-2033	2038	Womens Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2039	2043	Corridor Near Room 210 (2031)	Water Fountain-No Chiller	Potable	12/9/2020	8.4	Result Below Action Level, Continue O&M
BRTWD-2040	2022A	Library Work Room	Classroom Faucet	Non-Potable	12/9/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-2041	2043	Corridor Near Room 216 (2021)	Water Fountain-No Chiller	Potable	12/9/2020	<3.0 ND	Replaced by Outlet 3040
BRTWD-2042	2019	Corridor Near Room 220 (2016)	Water Fountain-No Chiller	Potable	12/9/2020	4.8	Result Below Action Level, Continue O&M
BRTWD-2043	2010	Room 226	Classroom Faucet	Non-Potable	5/6/2021	1.3	Outlet Remediated Result Below Action Level, Continue O&M
BRTWD-2044	2009	Room 223	Classroom Faucet	Non-Potable	12/9/2020	2.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-2047	2019	Corridor Near Room 228 (2008)	Water Fountain-No Chiller	Potable	12/9/2020	6.8	Replaced by Outlet 3041/3042
BRTWD-2049	2005	Boys Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	12/9/2020	2.7	Result Below Action Level, Continue O&M
BRTWD-2050	2005	Boys Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	12/9/2020	2.8	Result Below Action Level, Continue O&M
BRTWD-2051	2005	Boys Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	12/9/2020	6.3	Result Below Action Level, Continue O&M
BRTWD-2053	2003	Girls Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2054	2003	Girls Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2055	2003	Girls Bathroom (Across Room 230)	Bathroom Faucet	Non-Potable	12/9/2020	OOS	Testing Required Before Return to Service
BRTWD-2060	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2061	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2067	N/A	Corridor Near Room 248	Water Cooler	Potable	12/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-2068	N/A	Corridor Near Room 248	Water Cooler	Potable	12/9/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-2081	N/A	Wrestling Room	Water Fountain-No Chiller	Potable	12/9/2020	25	Outlet Permanently Removed
BRTWD-2082	N/A	Wrestling Room Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	1.5	Result Below Action Level, Continue O&M
BRTWD-3001	2040	Mens Bathroom (Across Room 202)	Bathroom Faucet	Non-Potable	6/17/2021	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3004	2023	Room 214 Life Skills	Home Economics Faucet (Cold)	Potable	10/28/2021	2.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
BRTWD-3008	1026	Corridor Near Student Management Office (1023)	Bottle Fill Station	Potable	8/23/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3009	1026	Corridor Near Room 124 (1016)	Bottle Fill Station	Potable	10/19/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3010	1026	Corridor Near Room 124 (1016)	Water Cooler	Potable	10/19/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3038	1050	Corridor Near Cafeteria (1034)	Water Cooler	Potable	10/19/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3039	1050	Corridor Near Cafeteria (1034)	Bottle Fill Station	Potable	10/19/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3040	2043	Corridor Near Room 216 (2021)	Bottle Fill Station	Potable	10/19/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3041	2019	Corridor Near Room 228 (2008)	Water Cooler	Potable	10/19/2022	<3.0 ND	Result Below Action Level, Continue O&M
BRTWD-3042	2019	Corridor Near Room 228 (2008)	Bottle Fill Station	Potable	10/19/2022	1.1	Result Below Action Level, Continue O&M
BRTWD-3087	N/A	Corridor Near Bathrooms	Water Cooler	Potable	12/16/2022	OOS	Testing Required Before Return to Service
BRTWD-3088	N/A	Corridor Near Bathrooms	Bottle Fill Station	Potable	12/16/2022	OOS	Testing Required Before Return to Service

Attachment 2:

Chain of Custody
&
Laboratory Analysis


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

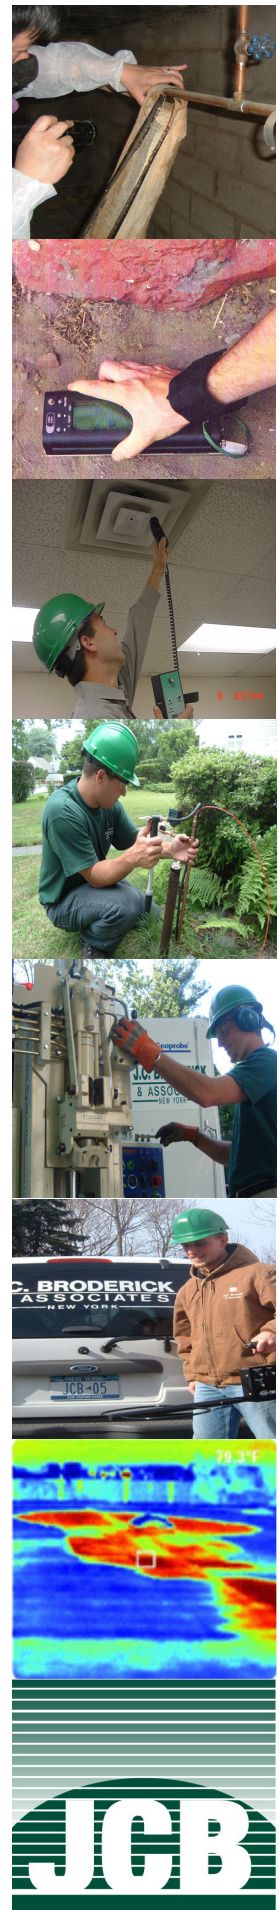



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Anthony Felicio Administration Building

AFA

0620 23180

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 2

OrderID: 062023180

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2904	Hallway	1013	Corridor Near IT Room (1006C)	BF	12/11/2020	5:47:00 AM
BRTWD-2905	Bathroom	1005	Men's Bathroom	BF	12/11/2020	5:48:00 AM
BRTWD-2906	Bathroom	1005	Men's Bathroom	BF	12/11/2020	5:48:00 AM
BRTWD-2908	Faculty Lounge	1004	Faculty Room	CF	12/11/2020	5:50:00 AM
BRTWD-2909	Bathroom	1002D1	Custodial Office Bathroom	BF	12/11/2020	5:56:00 AM
BRTWD-2910	Hallway	1039	Corridor Near Women's Bathroom (1017)	DW	12/11/2020	5:57:00 AM
BRTWD-2911	Bathroom	1017	Women's Bathroom	BF	12/11/2020	5:58:00 AM
BRTWD-2912	Bathroom	1017	Women's Bathroom	BF	12/11/2020	5:58:00 AM
BRTWD-2914	Bathroom	1032	Men's Bathroom	BF	12/11/2020	6:01:00 AM
BRTWD-2915	Bathroom	1032	Men's Bathroom	BF	12/11/2020	6:01:00 AM
BRTWD-2916	Hallway	1033	Corridor Near Men's Bathroom (1032)	WC	12/11/2020	6:02:00 AM
BRTWD-2918	Bathroom	1030	Women's Bathroom	BF	12/11/2020	6:03:00 AM
BRTWD-2919	Bathroom	1030	Women's Bathroom	BF	12/11/2020	6:03:00 AM
BRTWD-2920	Bathroom	2005	Women's Bathroom	BF	12/11/2020	6:20:00 AM
BRTWD-2921	Bathroom	2005	Women's Bathroom	BF	12/11/2020	6:20:00 AM
BRTWD-2923	Hallway	2011	Corridor Near Custodial Closet (2007)	WC	12/11/2020	6:21:00 AM
BRTWD-2924	Bathroom	2008	Men's Bathroom	BF	12/11/2020	6:22:00 AM
BRTWD-2925	Bathroom	2008	Men's Bathroom	BF	12/11/2020	6:22:00 AM

Building Address

52 3rd Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Ailing Castelli 11/11/20

Samplers Signature: Ailing Castelli

JCB Project Manager: Meghan Gwinn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Anthony Felicio Administration Building

AFA

062 023180

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 2 of 2

OrderID: 062023180

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2926	Faculty Lounge	2009D1	Health Benefits Suite Kitchen Area Office	CF	12/11/2020	6:24:00 AM
BRTWD-2927	Faculty Lounge	2009D1	Health Benefits Suite Kitchen Area Office	BW	12/11/2020	6:24:00 AM
BRTWD-2929	Faculty Lounge	3002M	Main Office Suite Kitchen	WC	12/11/2020	6:29:00 AM
BRTWD-2930	Faculty Lounge	3002M	Main Office Suite Kitchen	CF	12/11/2020	6:29:00 AM
BRTWD-2931	Bathroom	3002J	Women's Bathroom	BF	12/11/2020	6:32:00 AM
BRTWD-2932	Bathroom	3002J	Women's Bathroom	BF	12/11/2020	6:32:00 AM
BRTWD-2933	Bathroom	3002J	Women's Bathroom	BF	12/11/2020	6:32:00 AM
BRTWD-2934	Bathroom	3002I	Men's Bathroom	BF	12/11/2020	6:33:00 AM
BRTWD-2935	Office	1026	Performing Arts Room	BW	12/11/2020	6:06:00 AM
BRTWD-2936	Office	1007C	Maureen Belanger Board Room Kitchen	CF	12/11/2020	5:46:00 AM
BRTWD-2995	BR	1004	East Wing Conference Room Bathroom	BF	12/11/2020	5:54:00 AM
BRTWD-2996	OF	1036	Human Resources Department	BW	12/11/2020	6:11:00 AM
BRTWD-2997	OF	1040	Transportation/Security Office	BW	12/11/2020	6:14:00 AM
BRTWD-2998	FL	3002M	Main Office Suite Kitchen	BW	12/11/2020	6:30:00 AM

Samples Submitted 32

PM 4:15

Building Address

52 3rd Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alina Castellano

Samplers Signature: Alina Castellano

JCB Project Manager: Meghan Gwyn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/11/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45270, Anthony Felicio Administration Building, Brentwood
Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062023180. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023180

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/11/2020 04:15 PM
 Collected: 12/11/2020

Project: #19-45270, Anthony Felicio Administration Building, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2904 **Collected:** 12/11/2020 **Lab ID:** 062023180-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2905 **Collected:** 12/11/2020 **Lab ID:** 062023180-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2906 **Collected:** 12/11/2020 **Lab ID:** 062023180-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2908 **Collected:** 12/11/2020 **Lab ID:** 062023180-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2909 **Collected:** 12/11/2020 **Lab ID:** 062023180-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2910 **Collected:** 12/11/2020 **Lab ID:** 062023180-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	46	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2911 **Collected:** 12/11/2020 **Lab ID:** 062023180-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023180

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/11/2020 04:15 PM
 Collected: 12/11/2020

Project: #19-45270, Anthony Felicio Administration Building, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2912 **Collected:** 12/11/2020 **Lab ID:** 062023180-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2914 **Collected:** 12/11/2020 **Lab ID:** 062023180-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2915 **Collected:** 12/11/2020 **Lab ID:** 062023180-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2916 **Collected:** 12/11/2020 **Lab ID:** 062023180-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2918 **Collected:** 12/11/2020 **Lab ID:** 062023180-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2919 **Collected:** 12/11/2020 **Lab ID:** 062023180-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2920 **Collected:** 12/11/2020 **Lab ID:** 062023180-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023180

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/11/2020 04:15 PM
 Collected: 12/11/2020

Project: #19-45270, Anthony Felicio Administration Building, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2921 **Collected:** 12/11/2020 **Lab ID:** 062023180-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2923 **Collected:** 12/11/2020 **Lab ID:** 062023180-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2924 **Collected:** 12/11/2020 **Lab ID:** 062023180-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2925 **Collected:** 12/11/2020 **Lab ID:** 062023180-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.3	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2926 **Collected:** 12/11/2020 **Lab ID:** 062023180-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2927 **Collected:** 12/11/2020 **Lab ID:** 062023180-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2929 **Collected:** 12/11/2020 **Lab ID:** 062023180-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023180

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/11/2020 04:15 PM
 Collected: 12/11/2020

Project: #19-45270, Anthony Felicio Administration Building, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2930 **Collected:** 12/11/2020 **Lab ID:** 062023180-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2931 **Collected:** 12/11/2020 **Lab ID:** 062023180-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2932 **Collected:** 12/11/2020 **Lab ID:** 062023180-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	420 D	12 µg/L	1/13/2021	OR	1/15/2021	AL

Client Sample Description BRTWD-2933 **Collected:** 12/11/2020 **Lab ID:** 062023180-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	59	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2934 **Collected:** 12/11/2020 **Lab ID:** 062023180-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	67	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2935 **Collected:** 12/11/2020 **Lab ID:** 062023180-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2936 **Collected:** 12/11/2020 **Lab ID:** 062023180-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2995 **Collected:** 12/11/2020 **Lab ID:** 062023180-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023180

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/11/2020 04:15 PM
 Collected: 12/11/2020

Project: #19-45270, Anthony Felicio Administration Building, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2995 **Collected:** 12/11/2020 **Lab ID:** 062023180-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/13/2021	OR	1/14/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2996 **Collected:** 12/11/2020 **Lab ID:** 062023180-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2997 **Collected:** 12/11/2020 **Lab ID:** 062023180-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Client Sample Description BRTWD-2998 **Collected:** 12/11/2020 **Lab ID:** 062023180-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	OR	1/14/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Anthony Felicio Administration Building

AFA

062110615

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2932	Bathroom	3002J	Women's Bathroom	BF	6/16/2021	7:22:00 AM
BRTWD-2933	Bathroom	3002J	Women's Bathroom	BF	6/16/2021	7:22:00 AM
BRTWD-2934	Bathroom	3002I	Men's Bathroom	BF	6/16/2021	7:21:00 AM

Samples Submitted 3

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 P 3:15

Building Address

52 3rd Avenue

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: Alyssa McDonald

Signature: Alyssa McDonald

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Anthony Felicio Administration Building, Brentwood
Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110615. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110615

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/16/21 3:15 PM
Collected: 6/16/2021

Project: #21-48246, Anthony Felicio Administration Building, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2932 **Collected:** 6/16/2021 **Lab ID:** 062110615-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2933 **Collected:** 6/16/2021 **Lab ID:** 062110615-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2934 **Collected:** 6/16/2021 **Lab ID:** 062110615-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.0	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

Building: Anthony Felicio Administration Building

AFA

062210095

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3006	HA	1033	West Corridor	WC	5/25/2022	7:27:00 AM
BRTWD-3007	HA	1033	West Corridor	WF	5/25/2022	7:28:00 AM

Samples Submitted 2

Pb 200.5

[Signature]

5/27/22

RECEIVED
ENSL. ANALYTICAL, INC.
CARLE PLACE, NY
2022 MAY 25 P 8:55

Building Address

52 3rd Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Recieved: 5/25/22 @ 8:55pm

Signature: *[Signature]*

Samplers Name: Kyrce Kraus

Samplers Signature: *[Signature]*

JCB Project Manager: Meghan Finnegan



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/27/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/26/2022. The results are tabulated on the attached data pages for the following client designated project:

Anthony Felicio Administration Building, AFA, Brentwood Union
Free School District, 52 3rd Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062210095. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062210095

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 5/26/2022 08:55 PM
Collected: 5/25/2022

Project: **Anthony Felicio Administration Building, AFA, Brentwood Union Free School District, 52 3rd Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-3006 **Collected:** 5/25/2022 **Lab ID:** 062210095-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/27/2022	DI	5/27/2022	DI

Client Sample Description BRTWD-3007 **Collected:** 5/25/2022 **Lab ID:** 062210095-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/27/2022	DI	5/27/2022	DI

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Ross High School

ROSS

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0353	Special	1001	Industrial Arts Room - Auto Shop	HW	12/4/2020	6:13:00 AM
BRTWD-0354	Special	1001	Industrial Arts Room - Auto Shop	HW	12/4/2020	6:13:00 AM
BRTWD-0355	Special	1001	Industrial Arts Room - Auto Shop	HW	12/4/2020	6:13:00 AM
BRTWD-0356	Classroom	1002	Room 1170	CF	12/4/2020	6:19:00 AM
BRTWD-0357	Hallway	1025	Corridor Near Shop Storage Room (1004)	DW	12/4/2020	6:21:00 AM
BRTWD-0358	Classroom	1006	Room 1165	CF	12/4/2020	6:23:00 AM
BRTWD-0359	Classroom	1006	Room 1165	CF	12/4/2020	6:23:00 AM
BRTWD-0369	Classroom	1017	Room 1160	HW	12/4/2020	6:29:00 AM
BRTWD-0370	Hallway	1025	Corridor Near Room 1157 (1018)	DW	12/4/2020	6:30:00 AM
BRTWD-0403	Hallway	N/A	Music Hallway	WC	12/4/2020	6:35:00 AM
BRTWD-0404	Hallway	N/A	Music Hallway	WC	12/4/2020	6:36:00 AM
BRTWD-0405	Classroom	N/A	Band Room	CF	12/4/2020	6:39:00 AM
BRTWD-0406	Classroom	N/A	Orchestra Room	CF	12/4/2020	6:41:00 AM
BRTWD-0414	Hallway	1064	Corridor Near Room 1103 (1060)	DW	12/4/2020	7:01:00 AM
BRTWD-0415	Hallway	1064	Corridor Near Room 1110 (1057)	DW	12/4/2020	7:03:00 AM
BRTWD-0449	Hallway	N/A	Corridor Near Room 1117	WC	12/4/2020	7:05:00 AM
BRTWD-0450	Hallway	N/A	Corridor Near Room 1117	WC	12/4/2020	7:06:00 AM
BRTWD-0517	Custodial Closet	1088	Custodial Closet	IM	12/5/2020	6:57:00 AM

Building Address

1 South Fifth Avenue

Brentwood, NY 11717

062022894

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Brentwood Ross High School
ROSS

Client: Brentwood Union Free School District
Retest/New Install ☒
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0519	Bathroom	1087A	Team Locker Room Bathroom	BF	12/5/2020	7:01:00 AM
BRTWD-0520	Hallway	1086	Corridor to Locker Room	WC	12/5/2020	7:04:00 AM
BRTWD-0521	Hallway	1086	Corridor to Locker Room	WC	12/5/2020	7:04:00 AM
BRTWD-0522	Bathroom	1084A	Boys Locker Room Bathroom	BF	12/5/2020	7:08:00 AM
BRTWD-0523	Bathroom	1084A	Boys Locker Room Bathroom	BF	12/5/2020	7:08:00 AM
BRTWD-0525	Bathroom	1081A1	Girls Locker Room Bathroom	BF	12/5/2020	7:15:00 AM
BRTWD-0526	Bathroom	1081A1	Girls Locker Room Bathroom	BF	12/5/2020	7:15:00 AM
BRTWD-0527	Locker Room	1081A	Girls Locker Room	DW	12/5/2020	7:15:00 AM
BRTWD-0529	Hallway	1099	Corridor Across from Gymnasium	WF	12/5/2020	7:17:00 AM
BRTWD-0531	Bathroom	1076A	Custodial Office Bathroom	BF	12/5/2020	7:20:00 AM
BRTWD-0532	Cafeteria	1075	Cafeteria	WC	12/5/2020	7:22:00 AM
BRTWD-0533	Bathroom	1070	Women's Bathroom	BF	12/5/2020	7:24:00 AM
BRTWD-0534	Bathroom	1070	Women's Bathroom	BF	12/5/2020	7:24:00 AM
BRTWD-0535	Bathroom	1070	Women's Bathroom	BF	12/5/2020	7:24:00 AM
BRTWD-0536	Bathroom	1071	Men's Bathroom	BF	12/5/2020	7:26:00 AM
BRTWD-0537	Bathroom	1071	Men's Bathroom	BF	12/5/2020	7:26:00 AM
BRTWD-0538	Office	1073	Main Office	BW	12/5/2020	7:32:00 AM
BRTWD-0539	Hallway	1099	Corridor Near Nurse's Office	DW	12/5/2020	7:35:00 AM

Building Address

1 South Fifth Avenue

Brentwood, NY 11717

Pb 200.5 -

A. J. J. 12/19/21

062022894

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Nichelle DeVito
12/7/20 4:37 PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

Ariana Castelluzzo
Ariana Castelluzzo
Meghan Gwynn

RECEIVED
LAB
FILE



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Ross High School

ROSS

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal Push

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0540	Nurse Office	1066B	Health Office Suite Nurse's Office	NS	12/5/2020	7:41:00 AM
BRTWD-0541	Bathroom	1066B1	Health Office Suite Nurse's Office Bathroom	BF	12/5/2020	7:41:00 AM
BRTWD-0542	Hallway	1037	Corridor Near Room 1125 (1033)	DW	12/5/2020	7:42:00 AM
BRTWD-0547	Bathroom	N/A	Faculty Bathroom Near Faculty Room	BF	12/5/2020	7:46:00 AM
BRTWD-0548	Bathroom	N/A	Faculty Bathroom Near Faculty Room	BF	12/5/2020	7:47:00 AM
BRTWD-0549	Bathroom	N/A	Faculty Bathroom Near Faculty Room	BF	12/5/2020	7:48:00 AM
BRTWD-0574	Hallway	N/A	Corridor Near Girls Bathroom	WC	12/5/2020	7:54:00 AM
BRTWD-0575	Hallway	N/A	Corridor Near Girls Bathroom	WC	12/5/2020	7:54:00 AM
BRTWD-0581	Faculty Lounge	1044	Room 1128 Faculty Lounge	CF	12/5/2020	7:59:00 AM
BRTWD-0587	Kitchen	1074	Kitchen	HW	12/4/2020	5:40:00 AM
BRTWD-0588	Kitchen	1074	Kitchen	KC	12/4/2020	5:43:00 AM
BRTWD-0589	Kitchen	1074	Kitchen	SN	12/4/2020	5:42:00 AM
BRTWD-0590	Kitchen	1074	Kitchen	PK	12/4/2020	5:44:00 AM
BRTWD-0591	Kitchen	1074	Kitchen	HW	12/4/2020	5:45:00 AM
BRTWD-0592	Kitchen	1074	Kitchen	KC	12/4/2020	5:47:00 AM
BRTWD-0593	Kitchen	N/A	Kitchen	HW	12/4/2020	5:49:00 AM
BRTWD-0595	Bathroom	N/A	Kitchen Women's Bathroom	BF	12/4/2020	5:53:00 AM
BRTWD-0596	Bathroom	N/A	Kitchen Bathroom	BF	12/4/2020	5:55:00 AM

Building Address

1 South Fifth Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alicia Castell / 11/27/20Samplers Signature: Alicia CastellJCB Project Manager: Meghan Gwynn

062022894

12/7/20 4:37 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Ross High School

ROSS

Client:

Brentwood Union Free School District

Retest/New Install ☐ Normal

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0598	Kitchen	1074	Kitchen	HW	12/4/2020	5:54:00 AM
BRTWD-0599	Kitchen	1074	Kitchen	KC	12/4/2020	5:54:00 AM
BRTWD-0600	Kitchen	1074	Kitchen	SN	12/4/2020	6:00:00 AM
BRTWD-0601	Kitchen	1074	Kitchen	KC	12/4/2020	6:00:00 AM
BRTWD-0602	Kitchen	1074	Kitchen	KC	12/4/2020	6:02:00 AM
BRTWD-0604	Bathroom	N/A	Pool Girls Locker Room Bathroom	BF	12/5/2020	8:13:00 AM
BRTWD-0605	Special	N/A	Pool	WC	12/5/2020	8:14:00 AM
BRTWD-0607	Bathroom	N/A	Pool Boys Locker Room Bathroom	BF	12/5/2020	8:15:00 AM
BRTWD-0610	Bathroom	2005	Girls Bathroom	BF	12/5/2020	8:25:00 AM
BRTWD-0611	Bathroom	2005	Girls Bathroom	BF	12/5/2020	8:25:00 AM
BRTWD-0612	Bathroom	2005	Girls Bathroom	BF	12/5/2020	8:26:00 AM
BRTWD-0613	Bathroom	2005	Girls Bathroom	BF	12/5/2020	8:26:00 AM
BRTWD-0614	Bathroom	2005	Girls Bathroom	BF	12/5/2020	8:26:00 AM
BRTWD-0616	Bathroom	2008	Boys Bathroom	BF	12/5/2020	8:30:00 AM
BRTWD-0617	Bathroom	2008	Boys Bathroom	BF	12/5/2020	8:30:00 AM
BRTWD-0618	Bathroom	2008	Boys Bathroom	BF	12/5/2020	8:30:00 AM
BRTWD-0679	Bathroom	N/A	Faculty Bathroom	BF	12/5/2020	8:34:00 AM
BRTWD-0685	Hallway	N/A	Vestibule Near Storage Room	WC	12/5/2020	8:36:00 AM

Building Address

1 South Fifth Avenue

Brentwood, NY 11717

Do 200.5 -

062022894

Analysis Type: ELAP 200.5

Lab Received: Michelle DeVito

Signature: M DeVito 12/7/20 4:37 PM

Samplers Name: Alinea Castelluzzo

Samplers Signature: Alinea Castelluzzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Ross High School

ROSS

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: (Normal 1 wk - Rush)

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0686	Hallway	N/A	Vestibule Near Storage Room	WC	12/5/2020	8:36:00 AM
BRTWD-2991	HA	N/A	Corridor Near Stairwell	WF	12/4/2020	6:59:00 AM

Samples Submitted 74

062022894

20 DEC - 7 PM 4:37
 3100 ROUTE 11
 SUITE 100
 SUITE PLACE, NY

Building Address

1 South Fifth Avenue

Brentwood, NY 11717

Pb200.5-

A. J. J. 12/19/21

Analysis Type: ELAP 200.5 (M) (AU)

Lab Received: *Michelle DeVito*Signature: *M. DeVito 12/7/20 4:37 PM*Samplers Name: *Alicia Castell 114220*Samplers Signature: *Alicia Castell*JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/7/2020. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District, Brentwood Ross High
School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY
11717

The reference number for these samples is EMSL Order #062022894. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0353 **Collected:** 12/4/2020 **Lab ID:** 062022894-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0354 **Collected:** 12/4/2020 **Lab ID:** 062022894-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0355 **Collected:** 12/4/2020 **Lab ID:** 062022894-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0356 **Collected:** 12/4/2020 **Lab ID:** 062022894-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0357 **Collected:** 12/4/2020 **Lab ID:** 062022894-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0358 **Collected:** 12/4/2020 **Lab ID:** 062022894-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0359 **Collected:** 12/4/2020 **Lab ID:** 062022894-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0369 **Collected:** 12/4/2020 **Lab ID:** 062022894-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0370 **Collected:** 12/4/2020 **Lab ID:** 062022894-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0403 **Collected:** 12/4/2020 **Lab ID:** 062022894-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0404 **Collected:** 12/4/2020 **Lab ID:** 062022894-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0405 **Collected:** 12/4/2020 **Lab ID:** 062022894-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0406 **Collected:** 12/4/2020 **Lab ID:** 062022894-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0414 **Collected:** 12/4/2020 **Lab ID:** 062022894-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.8	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0415 **Collected:** 12/4/2020 **Lab ID:** 062022894-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0415 **Collected:** 12/4/2020 **Lab ID:** 062022894-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0449 **Collected:** 12/4/2020 **Lab ID:** 062022894-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0450 **Collected:** 12/4/2020 **Lab ID:** 062022894-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0517 **Collected:** 12/4/2020 **Lab ID:** 062022894-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0519 **Collected:** 12/4/2020 **Lab ID:** 062022894-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0520 **Collected:** 12/4/2020 **Lab ID:** 062022894-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0521 **Collected:** 12/4/2020 **Lab ID:** 062022894-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0522 **Collected:** 12/4/2020 **Lab ID:** 062022894-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0523 **Collected:** 12/4/2020 **Lab ID:** 062022894-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0525 **Collected:** 12/4/2020 **Lab ID:** 062022894-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0526 **Collected:** 12/4/2020 **Lab ID:** 062022894-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0527 **Collected:** 12/4/2020 **Lab ID:** 062022894-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0529 **Collected:** 12/4/2020 **Lab ID:** 062022894-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0531 **Collected:** 12/4/2020 **Lab ID:** 062022894-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0532 **Collected:** 12/4/2020 **Lab ID:** 062022894-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0532 **Collected:** 12/4/2020 **Lab ID:** 062022894-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0533 **Collected:** 12/4/2020 **Lab ID:** 062022894-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0534 **Collected:** 12/4/2020 **Lab ID:** 062022894-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0535 **Collected:** 12/4/2020 **Lab ID:** 062022894-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0536 **Collected:** 12/4/2020 **Lab ID:** 062022894-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0537 **Collected:** 12/4/2020 **Lab ID:** 062022894-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0538 **Collected:** 12/4/2020 **Lab ID:** 062022894-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0539 **Collected:** 12/4/2020 **Lab ID:** 062022894-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	37	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0540 **Collected:** 12/4/2020 **Lab ID:** 062022894-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0541 **Collected:** 12/4/2020 **Lab ID:** 062022894-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0542 **Collected:** 12/4/2020 **Lab ID:** 062022894-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0547 **Collected:** 12/4/2020 **Lab ID:** 062022894-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0548 **Collected:** 12/4/2020 **Lab ID:** 062022894-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0549 **Collected:** 12/4/2020 **Lab ID:** 062022894-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description		BRTWD-0574		Collected:	12/4/2020	Lab ID:	062022894-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0575		Collected:	12/4/2020	Lab ID:	062022894-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0581		Collected:	12/4/2020	Lab ID:	062022894-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0587		Collected:	12/4/2020	Lab ID:	062022894-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0588		Collected:	12/4/2020	Lab ID:	062022894-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0589		Collected:	12/4/2020	Lab ID:	062022894-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0590		Collected:	12/4/2020	Lab ID:	062022894-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	1/15/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0591		Collected:	12/4/2020	Lab ID:	062022894-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0591 **Collected:** 12/4/2020 **Lab ID:** 062022894-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0592 **Collected:** 12/4/2020 **Lab ID:** 062022894-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0593 **Collected:** 12/4/2020 **Lab ID:** 062022894-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0595 **Collected:** 12/4/2020 **Lab ID:** 062022894-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0596 **Collected:** 12/4/2020 **Lab ID:** 062022894-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0598 **Collected:** 12/4/2020 **Lab ID:** 062022894-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0599 **Collected:** 12/4/2020 **Lab ID:** 062022894-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0600 **Collected:** 12/4/2020 **Lab ID:** 062022894-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0601 **Collected:** 12/4/2020 **Lab ID:** 062022894-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0602 **Collected:** 12/4/2020 **Lab ID:** 062022894-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0604 **Collected:** 12/4/2020 **Lab ID:** 062022894-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	1/15/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0605 **Collected:** 12/4/2020 **Lab ID:** 062022894-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0607 **Collected:** 12/4/2020 **Lab ID:** 062022894-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0610 **Collected:** 12/4/2020 **Lab ID:** 062022894-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0611 **Collected:** 12/4/2020 **Lab ID:** 062022894-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description		BRTWD-0611	Collected:	12/4/2020	Lab ID:	062022894-0064		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0612	Collected:	12/4/2020	Lab ID:	062022894-0065		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0613	Collected:	12/4/2020	Lab ID:	062022894-0066		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0614	Collected:	12/4/2020	Lab ID:	062022894-0067		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0616	Collected:	12/4/2020	Lab ID:	062022894-0068		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-0617	Collected:	12/4/2020	Lab ID:	062022894-0069		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0618	Collected:	12/4/2020	Lab ID:	062022894-0070		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022894

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2020 04:37 PM
 Collected: 12/4/2020

Project: **Brentwood Union Free School District, Brentwood Ross High School, ROSS, #:19-45270, 1 South Fifth Avenue, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-0679 **Collected:** 12/4/2020 **Lab ID:** 062022894-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0685 **Collected:** 12/4/2020 **Lab ID:** 062022894-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-0686 **Collected:** 12/4/2020 **Lab ID:** 062022894-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-2991 **Collected:** 12/4/2020 **Lab ID:** 062022894-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Brentwood Ross High School

ROSS

062110607

Page 1 of 1

Client:

Brentwood Union Free School District

Retest New Install []

Turn Around: Normal 1wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3000	Classroom	1006	Room 1165	CF	6/16/2021	7:04:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 P 3:14

Building Address

1 South Fifth Avenue

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Sampler's Name: *Alexandria Orlass*

Sampler's Signature: *Alex Orlass*

JCB Project Manager: *Meghan Guynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, Brentwood Ross High School, Brentwood Union Free
School District, 1 South Fifth Avenue, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062110607. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110607

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/16/21 3:14 PM
Collected: 6/16/2021

Project: #21-48246, Brentwood Ross High School, Brentwood Union Free School District, 1 South Fifth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-3000 **Collected:** 6/16/2021 **Lab ID:** 062110607-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Sonderling High School

SON

Client:

Brentwood Union Free School District

Retest/New Install ☐ ☒

Turn Around: Normal 1 wk Rush _____

Page 1 of 4

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0001	Kitchen	1031	Kitchen	KC	11/3/2020	5:46:00 AM
BRTWD-0002	Kitchen	1031	Kitchen	KC	11/3/2020	5:48:00 AM
BRTWD-0003	Kitchen	1031	Kitchen	HW	11/3/2020	5:49:00 AM
BRTWD-0004	Kitchen	1031	Kitchen	PK	11/3/2020	5:50:00 AM
BRTWD-0005	Kitchen	1031	Kitchen	KC	11/3/2020	5:52:00 AM
BRTWD-0006	Kitchen	1031	Kitchen	SN	11/3/2020	5:53:00 AM
BRTWD-0007	Kitchen	1031	Kitchen	KC	11/3/2020	5:54:00 AM
BRTWD-0008	Kitchen	1031	Kitchen	HW	11/3/2020	5:55:00 AM
BRTWD-0010	Bathroom	1031C	Kitchen Locker Room	BF	11/3/2020	5:57:00 AM
BRTWD-0017	Bathroom	N/A	Women's Faculty Bathroom	BF	11/3/2020	6:02:00 AM
BRTWD-0018	Bathroom	N/A	Men's Faculty Bathroom	BF	11/3/2020	6:03:00 AM
BRTWD-0019	Bathroom	N/A	Asst. Principal's Bathroom	BF	11/3/2020	6:05:00 AM
BRTWD-0038	Home Economics	N/A	Room 1831 Home Economics	EC	11/3/2020	6:09:00 AM
BRTWD-0043	Kitchen	N/A	Kitchen (New Construction)	HW	11/3/2020	6:11:00 AM
BRTWD-0044	Kitchen	N/A	Kitchen (New Construction)	KC	11/3/2020	6:12:00 AM
BRTWD-0045	Kitchen	N/A	Kitchen (New Construction)	KC	11/3/2020	6:13:00 AM
BRTWD-0046	Kitchen	N/A	Kitchen (New Construction)	HW	11/3/2020	6:13:00 AM
BRTWD-0047	Kitchen	N/A	Kitchen (New Construction)	KC	11/3/2020	6:15:00 AM

Building Address

2 Sixth Avenue

Brentwood, NY 11717

PB 200.5-

062020548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Sonderling High School

SON

Client:

Brentwood Union Free School District

Retest/New Install ☒ 1 wk

Turn Around: ☒ Normal ☐ Rush

Page 2 of 4

OrderID: 062020548

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0048	Kitchen	N/A	Kitchen (New Construction)	KC	11/3/2020	6:15:00 AM
BRTWD-0049	Kitchen	N/A	Kitchen (New Construction)	PK	11/3/2020	6:16:00 AM
BRTWD-0050	Kitchen	N/A	Kitchen (New Construction)	HW	11/3/2020	6:17:00 AM
BRTWD-0051	Kitchen	N/A	Kitchen (New Construction)	HW	11/3/2020	6:17:00 AM
BRTWD-0055	Bathroom	N/A	Kitchen Girls Bathroom	BF	11/3/2020	6:19:00 AM
BRTWD-0056	Bathroom	N/A	Kitchen Boys Bathroom	BF	11/3/2020	6:21:00 AM
BRTWD-0064	Nurse's Office	1022	Nurse's Office	NS	11/3/2020	6:25:00 AM
BRTWD-0065	Bathroom	1022A1	Nurse's Office Bathroom	BF	11/3/2020	6:26:00 AM
BRTWD-0068	Hallway	1027	Corridor Near Boiler Room (0001)	WF	11/3/2020	6:33:00 AM
BRTWD-0072	Custodial Closet	1027A	Closet in Corridor Outside Boiler Room	IM	11/3/2020	6:34:00 AM
BRTWD-0073	Bathroom	1021E1A	Girls Coaches Office Bathroom	BF	11/3/2020	6:36:00 AM
BRTWD-0075	Bathroom	1021E2B	Girls Locker Room Bathroom	BF	11/3/2020	6:39:00 AM
BRTWD-0076	Bathroom	1021E2B	Girls Locker Room Bathroom	BF	11/3/2020	6:39:00 AM
BRTWD-0077	Bathroom	1021E2B	Girls Locker Room Bathroom	BF	11/3/2020	6:40:00 AM
BRTWD-0078	Hallway	1021B	Gym Vestibule to Aux. Gym & Girls Locker Room	WC	11/3/2020	6:44:00 AM
BRTWD-0079	Hallway	1021B	Gym Vestibule to Aux. Gym & Girls Locker Room	WC	11/3/2020	6:45:00 AM
BRTWD-0080	Bathroom	1020C	Boys Locker Room Bathroom	BF	11/3/2020	6:48:00 AM
BRTWD-0081	Bathroom	1020C	Boys Locker Room Bathroom	BF	11/3/2020	6:49:00 AM

Building Address

2 Sixth Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alina Castellano

Samplers Signature: Alina Castellano

JCB Project Manager: Meghan Gwinn

062020548

2:55 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Sonderling High School

SON

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal wk Rush

Page 3 of 4

OrderID: 062020548

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0082	Bathroom	1019A	Gym Coach's Office Bathroom	BF	11/3/2020	6:51:00 AM
BRTWD-0086	Bathroom	1018A	Team Locker Room Bathroom	BF	11/3/2020	6:54:00 AM
BRTWD-0089	Bathroom	1035	Faculty Men's Bathroom	BF	11/3/2020	7:00:00 AM
BRTWD-0090	Bathroom	1036	Faculty Women's Bathroom	BF	11/3/2020	7:03:00 AM
BRTWD-0093	Bathroom	1045	Men's Faculty Bathroom	BF	11/3/2020	7:05:00 AM
BRTWD-0095	Hallway	1051	Corridor Near Men's Faculty Bathroom (1045)	WF	11/3/2020	7:06:00 AM
BRTWD-0096	Bathroom	1047	Women's Faculty Bathroom	BF	11/3/2020	7:07:00 AM
BRTWD-0097	Bathroom	1053B	Faculty Lounge Women's Bathroom	BF	11/3/2020	7:10:00 AM
BRTWD-0098	Bathroom	1053B	Faculty Lounge Women's Bathroom	BF	11/3/2020	7:10:00 AM
BRTWD-0099	Faculty Lounge	1053	Faculty Lounge	CF	11/3/2020	7:11:00 AM
BRTWD-0100	Bathroom	1053A	Faculty Lounge Men's Bathroom	BF	11/3/2020	7:12:00 AM
BRTWD-0101	Home Economics	1054	Room 1410 Home Economics	EC	11/3/2020	7:13:00 AM
BRTWD-0102	Home Economics	1054	Room 1410 Home Economics	EC	11/3/2020	7:13:00 AM
BRTWD-0103	Home Economics	1054	Room 1410 Home Economics	EC	11/3/2020	7:14:00 AM
BRTWD-0104	Home Economics	1054	Room 1410 Home Economics	EC	11/3/2020	7:14:00 AM
BRTWD-0105	Home Economics	1054	Room 1410 Home Economics	EC	11/3/2020	7:15:00 AM
BRTWD-0166	Bathroom	N/A	Handicap Bathroom	BF	11/3/2020	7:45:00 AM
BRTWD-0167	Office	N/A	Library Workroom	CF	11/3/2020	7:46:00 AM

Building Address

2 Sixth Avenue

Brentwood, NY 11717

pb 200.5

062020548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn

11/3/20
2:15 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Sonderling High School

SON

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal wk Rush _____

Page 4 of 4

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0207	Bathroom	N/A	Men's Faculty Bathroom	BF	11/3/2020	7:49:00 AM
BRTWD-0234	Hallway	2054	Corridor Near Room 2520 Book Room (2023)	DW	11/3/2020	7:54:00 AM
BRTWD-0235	Bathroom	2026	Faculty Women's Bathroom	BF	11/3/2020	7:55:00 AM
BRTWD-0236	Bathroom	2026	Faculty Women's Bathroom	BF	11/3/2020	7:55:00 AM
BRTWD-0237	Bathroom	2027	Faculty Men's Bathroom	BF	11/3/2020	7:57:00 AM
BRTWD-0238	Hallway	2054	Corridor Room 2500 To Room 2537	DW	11/3/2020	7:59:00 AM
BRTWD-0371	Bathroom	1080A	Boys Locker Room Bathroom	BF	11/3/2020	7:28:00 AM
BRTWD-0376	Bathroom	1079A	Girls Locker Room Bathroom	BF	11/3/2020	7:24:00 AM
BRTWD-0377	Bathroom	1079A	Girls Locker Room Bathroom	BF	11/3/2020	7:25:00 AM
BRTWD-0408	Office	1089B6	Library Annex Break Room	CF	11/3/2020	7:40:00 AM
BRTWD-0410	Bathroom	1087	Men's Bathroom	BF	11/3/2020	7:37:00 AM
BRTWD-0411	Bathroom	1085	Women's Bathroom	BF	11/3/2020	7:36:00 AM
BRTWD-0412	Bathroom	1085	Women's Bathroom	BF	11/3/2020	7:36:00 AM

Samples Submitted 67

ANALYTICAL
CARLE PLACE, NY
20 NOV - 3 PM 2:15

062020548

Building Address

2 Sixth Avenue

Brentwood, NY 11717

PB 200.5-
A. Long 11/30/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Michelle DeVito
11/3/20 2:15pm

Samplers Name: Arika Castellano

Samplers Signature: Arika Castellano

JCB Project Manager: Meghan Swynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/3/2020. The results are tabulated on the attached data pages for the following client designated project:

#:19-45270, Brentwood Union Free School District, Brentwood
Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY
11717

The reference number for these samples is EMSL Order #062020548. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0001 **Collected:** 11/3/2020 **Lab ID:** 062020548-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0002 **Collected:** 11/3/2020 **Lab ID:** 062020548-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	39	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0003 **Collected:** 11/3/2020 **Lab ID:** 062020548-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0004 **Collected:** 11/3/2020 **Lab ID:** 062020548-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.4	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0005 **Collected:** 11/3/2020 **Lab ID:** 062020548-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0006 **Collected:** 11/3/2020 **Lab ID:** 062020548-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0007 **Collected:** 11/3/2020 **Lab ID:** 062020548-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0008 **Collected:** 11/3/2020 **Lab ID:** 062020548-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0008 **Collected:** 11/3/2020 **Lab ID:** 062020548-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0010 **Collected:** 11/3/2020 **Lab ID:** 062020548-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0017 **Collected:** 11/3/2020 **Lab ID:** 062020548-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0018 **Collected:** 11/3/2020 **Lab ID:** 062020548-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0019 **Collected:** 11/3/2020 **Lab ID:** 062020548-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0038 **Collected:** 11/3/2020 **Lab ID:** 062020548-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0043 **Collected:** 11/3/2020 **Lab ID:** 062020548-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0044 **Collected:** 11/3/2020 **Lab ID:** 062020548-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0044 **Collected:** 11/3/2020 **Lab ID:** 062020548-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0045 **Collected:** 11/3/2020 **Lab ID:** 062020548-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0046 **Collected:** 11/3/2020 **Lab ID:** 062020548-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.5	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0047 **Collected:** 11/3/2020 **Lab ID:** 062020548-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0048 **Collected:** 11/3/2020 **Lab ID:** 062020548-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0049 **Collected:** 11/3/2020 **Lab ID:** 062020548-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0050 **Collected:** 11/3/2020 **Lab ID:** 062020548-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0051 **Collected:** 11/3/2020 **Lab ID:** 062020548-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0055 **Collected:** 11/3/2020 **Lab ID:** 062020548-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0056 **Collected:** 11/3/2020 **Lab ID:** 062020548-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0064 **Collected:** 11/3/2020 **Lab ID:** 062020548-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	97	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0065 **Collected:** 11/3/2020 **Lab ID:** 062020548-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.4	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0068 **Collected:** 11/3/2020 **Lab ID:** 062020548-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0072 **Collected:** 11/3/2020 **Lab ID:** 062020548-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0073 **Collected:** 11/3/2020 **Lab ID:** 062020548-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0073 **Collected:** 11/3/2020 **Lab ID:** 062020548-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0075 **Collected:** 11/3/2020 **Lab ID:** 062020548-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0076 **Collected:** 11/3/2020 **Lab ID:** 062020548-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0077 **Collected:** 11/3/2020 **Lab ID:** 062020548-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	32	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0078 **Collected:** 11/3/2020 **Lab ID:** 062020548-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0079 **Collected:** 11/3/2020 **Lab ID:** 062020548-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0080 **Collected:** 11/3/2020 **Lab ID:** 062020548-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0081 **Collected:** 11/3/2020 **Lab ID:** 062020548-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0081 **Collected:** 11/3/2020 **Lab ID:** 062020548-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	80	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0082 **Collected:** 11/3/2020 **Lab ID:** 062020548-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0086 **Collected:** 11/3/2020 **Lab ID:** 062020548-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	30	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0089 **Collected:** 11/3/2020 **Lab ID:** 062020548-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0090 **Collected:** 11/3/2020 **Lab ID:** 062020548-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0093 **Collected:** 11/3/2020 **Lab ID:** 062020548-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0095 **Collected:** 11/3/2020 **Lab ID:** 062020548-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0096 **Collected:** 11/3/2020 **Lab ID:** 062020548-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0097 **Collected:** 11/3/2020 **Lab ID:** 062020548-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0098 **Collected:** 11/3/2020 **Lab ID:** 062020548-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0099 **Collected:** 11/3/2020 **Lab ID:** 062020548-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0100 **Collected:** 11/3/2020 **Lab ID:** 062020548-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0101 **Collected:** 11/3/2020 **Lab ID:** 062020548-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0102 **Collected:** 11/3/2020 **Lab ID:** 062020548-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0103 **Collected:** 11/3/2020 **Lab ID:** 062020548-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0104 **Collected:** 11/3/2020 **Lab ID:** 062020548-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0105 **Collected:** 11/3/2020 **Lab ID:** 062020548-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0166 **Collected:** 11/3/2020 **Lab ID:** 062020548-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0167 **Collected:** 11/3/2020 **Lab ID:** 062020548-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0207 **Collected:** 11/3/2020 **Lab ID:** 062020548-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0234 **Collected:** 11/3/2020 **Lab ID:** 062020548-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-0235		Collected:	11/3/2020	Lab ID:	062020548-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0236		Collected:	11/3/2020	Lab ID:	062020548-0058	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0237		Collected:	11/3/2020	Lab ID:	062020548-0059	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0238		Collected:	11/3/2020	Lab ID:	062020548-0060	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0371		Collected:	11/3/2020	Lab ID:	062020548-0061	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0376		Collected:	11/3/2020	Lab ID:	062020548-0062	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0377		Collected:	11/3/2020	Lab ID:	062020548-0063	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0408		Collected:	11/3/2020	Lab ID:	062020548-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020548

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/3/2020 02:15 PM
 Collected: 11/3/2020

Project: #:19-45270, Brentwood Union Free School District, Brentwood Sonderling High School, SON, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0408 **Collected:** 11/3/2020 **Lab ID:** 062020548-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0410 **Collected:** 11/3/2020 **Lab ID:** 062020548-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0411 **Collected:** 11/3/2020 **Lab ID:** 062020548-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0412 **Collected:** 11/3/2020 **Lab ID:** 062020548-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	66	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~10-45270~~ 21-48246

Building: Brentwood Sonderling High School

SON

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0064	Nurse's Office	1022	Nurse's Office	NS	3/25/2021	6:19:00 AM

Samples Submitted 1

062105334

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 25 AM 9:20

Building Address

2 Sixth Avenue

Brentwood, NY 11717

Pb200.5

A. Perry 03/29/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Erin Todzia

Samplers Signature: *A. Todzia*JCB Project Manager: *Meghan Gynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/25/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Brentwood Sonderling High School, Brentwood
Union Free School District, 2 Sixth Avenue, Brentwood NY 11717

The reference number for these samples is EMSL Order #062105334. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105334

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/25/2021 09:20 AM
Collected: 3/25/2021

Project: #21-48246, Brentwood Sonderling High School, Brentwood Union Free School District, 2 Sixth Avenue, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-0064 **Collected:** 3/25/2021 **Lab ID:** 062105334-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Brentwood Sonderling High School

SON

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0002	Kitchen	1031	Kitchen	KC	5/5/2021	6:41:00 AM
BRTWD-0099	Faculty Lounge	1053	Faculty Lounge	CF	5/5/2021	6:44:00 AM
BRTWD-0411	Bathroom	1085	Women's Bathroom	BF	5/5/2021	6:46:00 AM
BRTWD-0412	Bathroom	1085	Women's Bathroom	BF	5/5/2021	6:47:00 AM

Samples Submitted 4

06207999

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY -5 PM 4:40

Building Address

2 Sixth Avenue

Brentwood, NY 11717

Pd 200.5-

A. Jiang 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: Alex OrlassinoJCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/11/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/5/2021. The results are tabulated on the attached data pages for the following client designated project:

19-45270, Brentwood Sonderling High School, Brentwood Union
Free School District, 2 Sixth Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062107999. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107999

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/05/21 4:40 PM
Collected: 5/5/2021

Project: 19-45270, Brentwood Sonderling High School, Brentwood Union Free School District, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0002 **Collected:** 5/5/2021 **Lab ID:** 062107999-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0099 **Collected:** 5/5/2021 **Lab ID:** 062107999-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-0411 **Collected:** 5/5/2021 **Lab ID:** 062107999-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-0412 **Collected:** 5/5/2021 **Lab ID:** 062107999-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Brentwood Sonderling High School

SON

062110610

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal ☒ Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0076	Bathroom	1021E2B	Girls Locker Room Bathroom	BF	6/16/2021	6:36:00 AM
BRTWD-0077	Bathroom	1021E2B	Girls Locker Room Bathroom	BF	6/16/2021	6:36:00 AM
BRTWD-0081	Bathroom	1020C	Boys Locker Room Bathroom	BF	6/16/2021	6:35:00 AM
BRTWD-0086	Bathroom	1018A	Team Locker Room Bathroom	BF	6/16/2021	6:33:00 AM

Samples Submitted 4

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 PM 3:15

Building Address

2 Sixth Avenue

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Sampler's Name: *Alexandria Orlassino*

Sampler's Signature: *Alexandria Orlassino*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Brentwood Sonderling High School, Brentwood
Union Free School District, 2 Sixth Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110610. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110610

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 06/16/21 3:15 PM
 Collected: 6/16/2021

Project: #21-48246, Brentwood Sonderling High School, Brentwood Union Free School District, 2 Sixth Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0076 **Collected:** 6/16/2021 **Lab ID:** 062110610-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-0077 **Collected:** 6/16/2021 **Lab ID:** 062110610-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-0081 **Collected:** 6/16/2021 **Lab ID:** 062110610-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-0086 **Collected:** 6/16/2021 **Lab ID:** 062110610-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Buildings & Grounds Building

BGB

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2952	Bathroom	1008A1	Stairwell Vestibule Bathroom	BF	12/15/2020	7:49:00 AM
BRTWD-2954	Bathroom	1006A	Vestibule Bathroom	BF	12/15/2020	7:51:00 AM
BRTWD-2955	Faculty Lounge	1005	Faculty Room	WC	12/15/2020	7:52:00 AM
BRTWD-2956	Faculty Lounge	1005	Faculty Room	CF	12/15/2020	7:52:00 AM
BRTWD-2957	Bathroom	2005	Women's Bathroom	BF	12/15/2020	7:55:00 AM
BRTWD-2958	Hallway	2007	Corridor Near Custodial Closet (2004)	WC	12/15/2020	7:55:00 AM
BRTWD-2959	Bathroom	2003	Men's Bathroom	BF	12/15/2020	7:56:00 AM
BRTWD-2960	Faculty Lounge	2002	Faculty Room	CF	12/15/2020	7:56:00 AM
BRTWD-2961	Special	1010	Warehouse	WC	12/15/2020	8:03:00 AM
BRTWD-2965	Bathroom	1011A	Auto Shop Bathroom	BF	12/15/2020	8:05:00 AM
BRTWD-2966	Bathroom	1014A	Glazier/Locksmith Shop Vestibule Bathroom	BF	12/15/2020	8:10:00 AM

Samples Submitted 11

062023236

RECEIVED
JCB ANALYTICAL, INC.
ORIOLE PLACE, NY
20 DEC 15 AM 11:48

Building Address

Oriole Place

Brentwood, NY 11717

approved 1/18/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: *Alexa Castelli 4270*Samplers Signature: *Oliver G...*JCB Project Manager: *Meghan Gw...*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/15/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-45270, Buildings & Grounds Building, Brentwood Union Free
School District, Oriole Place, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062023236. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023236

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/15/2020 11:48 AM
 Collected: 12/15/2020

Project: #19-45270, Buildings & Grounds Building, Brentwood Union Free School District, Oriole Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2952 **Collected:** 12/15/2020 **Lab ID:** 062023236-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2954 **Collected:** 12/15/2020 **Lab ID:** 062023236-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2955 **Collected:** 12/15/2020 **Lab ID:** 062023236-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2956 **Collected:** 12/15/2020 **Lab ID:** 062023236-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2957 **Collected:** 12/15/2020 **Lab ID:** 062023236-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2958 **Collected:** 12/15/2020 **Lab ID:** 062023236-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2959 **Collected:** 12/15/2020 **Lab ID:** 062023236-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023236

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/15/2020 11:48 AM
 Collected: 12/15/2020

Project: #19-45270, Buildings & Grounds Building, Brentwood Union Free School District, Oriole Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2960 **Collected:** 12/15/2020 **Lab ID:** 062023236-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2961 **Collected:** 12/15/2020 **Lab ID:** 062023236-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2965 **Collected:** 12/15/2020 **Lab ID:** 062023236-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2966 **Collected:** 12/15/2020 **Lab ID:** 062023236-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062021778 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Kindergarten Center

EKC

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2549	Classroom	N/A	Room 1	DW	11/19/2020	5:52:00 AM
BRTWD-2550	Classroom	N/A	Room 1	CF	11/19/2020	5:52:00 AM
BRTWD-2551	Bathroom	N/A	Room 1 Bathroom	BF	11/19/2020	5:52:00 AM
BRTWD-2552	Classroom	N/A	Room 2	DW	11/19/2020	5:58:00 AM
BRTWD-2553	Classroom	N/A	Room 2	CF	11/19/2020	5:58:00 AM
BRTWD-2554	Bathroom	N/A	Room 2 Bathroom	BF	11/19/2020	5:58:00 AM
BRTWD-2555	Classroom	N/A	Room 3	CF	11/19/2020	6:00:00 AM
BRTWD-2556	Classroom	N/A	Room 3	DW	11/19/2020	6:00:00 AM
BRTWD-2557	Bathroom	N/A	Room 3 Bathroom	BF	11/19/2020	6:01:00 AM
BRTWD-2558	Classroom	N/A	Room 4	DW	11/19/2020	6:02:00 AM
BRTWD-2559	Classroom	N/A	Room 4	CF	11/19/2020	6:03:00 AM
BRTWD-2560	Bathroom	N/A	Room 4 Bathroom	BF	11/19/2020	6:03:00 AM
BRTWD-2561	Classroom	N/A	Room 5	CF	11/19/2020	6:07:00 AM
BRTWD-2562	Classroom	N/A	Room 5	DW	11/19/2020	6:07:00 AM
BRTWD-2564	Classroom	N/A	Room 6	CF	11/19/2020	6:10:00 AM
BRTWD-2565	Classroom	N/A	Room 6	DW	11/19/2020	6:10:00 AM
BRTWD-2568	Hallway	N/A	Corridor Near Faculty Bathroom	WC	11/19/2020	6:12:00 AM
BRTWD-2569	Bathroom	N/A	Faculty Bathroom	BF	11/19/2020	6:14:00 AM

Building Address

50 Timberline Drive

Brentwood, NY 11717

Alina McEnroe 12/21/20

Analysis Type: ELAP 200.5

Lab Received: *Unique McKay*

Signature: *LM 11/19/20 4:52 PM*

Samplers Name: *Alina Caste 11/19/20*

Samplers Signature: *Alina Caste*

JCB Project Manager: *Meghan Gwynn*



062021778 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: East Kindergarten Center
EKC

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2570	Classroom	1001	Room 7	CF	11/19/2020	6:17:00 AM
BRTWD-2571	Classroom	1001	Room 7	DW	11/19/2020	6:17:00 AM
BRTWD-2572	Classroom	1003	Room 8	CF	11/19/2020	6:19:00 AM
BRTWD-2573	Classroom	1003	Room 8	DW	11/19/2020	6:19:00 AM
BRTWD-2574	Classroom	1004	Room 9	CF	11/19/2020	6:21:00 AM
BRTWD-2575	Classroom	1004	Room 9	DW	11/19/2020	6:21:00 AM
BRTWD-2576	Classroom	1005	Room 10	CF	11/19/2020	6:23:00 AM
BRTWD-2577	Classroom	1005	Room 10	DW	11/19/2020	6:23:00 AM
BRTWD-2578	Classroom	1006	Room 11	CF	11/19/2020	6:24:00 AM
BRTWD-2579	Classroom	1006	Room 11	DW	11/19/2020	6:25:00 AM
BRTWD-2580	Classroom	1007	Room 12	CF	11/19/2020	6:26:00 AM
BRTWD-2581	Classroom	1007	Room 12	DW	11/19/2020	6:26:00 AM
BRTWD-2582	Classroom	1008	Room 13	CF	11/19/2020	6:28:00 AM
BRTWD-2583	Classroom	1008	Room 13	DW	11/19/2020	6:28:00 AM
BRTWD-2584	Classroom	1011	Room 15	CF	11/19/2020	6:34:00 AM
BRTWD-2585	Classroom	1011	Room 15	DW	11/19/2020	6:34:00 AM
BRTWD-2586	Classroom	1014	Room 17	CF	11/19/2020	6:36:00 AM
BRTWD-2587	Classroom	1014	Room 17	DW	11/19/2020	6:36:00 AM

Building Address
50 Timberline Drive
Brentwood, NY 11717

Alissa McDonald 12/21/20

Analysis Type: ELAP 200.5

Lab Received: *Unique Market*

Signature: *Wm 11/19/20 4:52 PM*

Samplers Name: *Alina Castellan*

Samplers Signature: *Alina Castellan*

JCB Project Manager: *Meghan B. Wynn*



062021778 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: East Kindergarten Center
EKC

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2588	Classroom	1015	Room 20	CF	11/19/2020	6:38:00 AM
BRTWD-2589	Classroom	1015	Room 20	DW	11/19/2020	6:38:00 AM
BRTWD-2590	Hallway	1025	Corridor Near Room 19 (1016)	WC	11/19/2020	6:41:00 AM
BRTWD-2591	Classroom	1018	Room 22	CF	11/19/2020	6:43:00 AM
BRTWD-2592	Classroom	1018	Room 22	DW	11/19/2020	6:43:00 AM
BRTWD-2593	Bathroom	1020	Girls Bathroom	BF	11/19/2020	6:47:00 AM
BRTWD-2594	Bathroom	1028	Women's Bathroom	BF	11/19/2020	6:49:00 AM
BRTWD-2595	Bathroom	1028	Women's Bathroom	BF	11/19/2020	6:49:00 AM
BRTWD-2596	Bathroom	1029	Men's Bathroom	BF	11/19/2020	6:51:00 AM
BRTWD-2597	Nurse Office	1031	Nurse's Office	NS	11/19/2020	6:55:00 AM
BRTWD-2598	Bathroom	1031A	Nurse's Office Bathroom	BF	11/19/2020	6:55:00 AM
BRTWD-2600	Faculty Lounge	1037	Faculty Room	CF	11/19/2020	6:57:00 AM
BRTWD-2601	Hallway	1044	Corridor Near Faculty Room	DW	11/19/2020	7:00:00 AM
BRTWD-2602	Kitchen	1041	Kitchen	KC	11/19/2020	5:36:00 AM
BRTWD-2603	Kitchen	1041	Kitchen	KC	11/19/2020	5:36:00 AM
BRTWD-2604	Kitchen	1041	Kitchen	HW	11/19/2020	5:37:00 AM
BRTWD-2605	Kitchen	1041	Kitchen	PK	11/19/2020	5:37:00 AM
BRTWD-2606	Kitchen	1041	Kitchen	KC	11/19/2020	5:41:00 AM

Building Address
50 Timberline Drive
Brentwood, NY 11717

Alexandra McDonald 12/21/20

Analysis Type: ELAP 200.5

Lab Received: *Unique mercury*

Signature: *11/19/20 4:52 PM*

Samplers Name: *Alicia Castelluzzo*

Samplers Signature: *Alicia Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



062021778 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Kindergarten Center

EKC

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2607	Kitchen	1041	Kitchen	KC	11/19/2020	5:41:00 AM
BRTWD-2608	Kitchen	1041	Kitchen	SN	11/19/2020	5:43:00 AM
BRTWD-2609	Kitchen	1041	Kitchen	KC	11/19/2020	5:43:00 AM
BRTWD-2610	Bathroom	1041A1	Kitchen Bathroom	BF	11/19/2020	5:44:00 AM
BRTWD-2612	Bathroom	1047	Girls Bathroom	BF	11/19/2020	7:02:00 AM
BRTWD-2613	Bathroom	1047	Girls Bathroom	BF	11/19/2020	7:02:00 AM
BRTWD-2614	Bathroom	1047	Girls Bathroom	BF	11/19/2020	7:03:00 AM
BRTWD-2615	Bathroom	1047	Girls Bathroom	BF	11/19/2020	7:03:00 AM
BRTWD-2617	Bathroom	1050	Boys Bathroom	BF	11/19/2020	7:04:00 AM
BRTWD-2618	Bathroom	1050	Boys Bathroom	BF	11/19/2020	7:04:00 AM
BRTWD-2619	Bathroom	1050	Boys Bathroom	BF	11/19/2020	7:05:00 AM
BRTWD-2621	Classroom	1052	Room 32	CF	11/19/2020	7:08:00 AM
BRTWD-2622	Classroom	1052	Room 32	DW	11/19/2020	7:08:00 AM
BRTWD-2623	Classroom	1053	Room 31	CF	11/19/2020	7:10:00 AM
BRTWD-2624	Classroom	1053	Room 31	DW	11/19/2020	7:10:00 AM
BRTWD-2625	Classroom	1054	Room 34	CF	11/19/2020	7:12:00 AM
BRTWD-2626	Classroom	1054	Room 34	DW	11/19/2020	7:12:00 AM
BRTWD-2627	Classroom	1055	Room 33	CF	11/19/2020	7:14:00 AM

Building Address

50 Timberline Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5


Lab Received: Unique mckay

Signature: um 11/19/20 4:52pm

Samplers Name: Alicia Castellano

Samplers Signature: Alicia Castellano

JCB Project Manager: Meghan Gwinn



062021778 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: East Kindergarten Center
EKC

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2628	Classroom	1055	Room 33	DW	11/19/2020	7:14:00 AM
BRTWD-2629	Classroom	1056	Room 36	CF	11/19/2020	7:15:00 AM
BRTWD-2630	Classroom	1056	Room 36	DW	11/19/2020	7:15:00 AM
BRTWD-2631	Classroom	1057	Room 35	CF	11/19/2020	7:17:00 AM
BRTWD-2632	Classroom	1057	Room 35	DW	11/19/2020	7:17:00 AM
BRTWD-2633	Classroom	1058	Room 38	CF	11/19/2020	7:18:00 AM
BRTWD-2634	Classroom	1058	Room 38	DW	11/19/2020	7:19:00 AM
BRTWD-2635	Classroom	1060	Room 40	CF	11/19/2020	7:21:00 AM
BRTWD-2636	Classroom	1060	Room 40	DW	11/19/2020	7:21:00 AM
BRTWD-2637	Classroom	1061	Room 39	CF	11/19/2020	7:22:00 AM
BRTWD-2638	Classroom	1061	Room 39	DW	11/19/2020	7:23:00 AM
BRTWD-2639	Classroom	1062	Room 42	CF	11/19/2020	7:24:00 AM
BRTWD-2640	Classroom	1062	Room 42	DW	11/19/2020	7:24:00 AM
BRTWD-2641	Classroom	1064	Room 44	CF	11/19/2020	7:26:00 AM
BRTWD-2642	Classroom	1064	Room 44	DW	11/19/2020	7:26:00 AM
BRTWD-2646	Classroom	N/A	Room 46	DW	11/19/2020	7:34:00 AM
BRTWD-2647	Classroom	N/A	Room 46	CF	11/19/2020	7:34:00 AM
BRTWD-2649	Classroom	N/A	Room 47	CF	11/19/2020	7:35:00 AM

Building Address
50 Timberline Drive

Brentwood, NY 11717

Super McDonald 12/21/20

Analysis Type: ELAP 200.5


Lab Received: *Unique McKay*

Signature: *LM 11/19/20 4:52 PM*

Samplers Name: *Alina Castell 4220*

Samplers Signature: *Alina Castell*

JCB Project Manager: *Meghan Gwynn*



062021778 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Kindergarten Center

EKC

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2650	Classroom	N/A	Room 47	DW	11/19/2020	7:35:00 AM

Samples Submitted 91

RECEIVED
JCB ANALYTICAL, INC.
31 CARLE PLACE, NY
20 NOV 19 PM 4:52

Building Address

50 Timberline Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unique macaySignature: um 11/19/20 4:52pmSamplers Name: Alina Castel 11/19/20Samplers Signature: Alina CastelJCB Project Manager: Meghan Gwynn

Alina McDonald 12/21/20



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/19/2020. The results are tabulated on the attached data pages for the following client designated project:

East Kindergarten Center, 50 Timberline Drive, Brentwood, NY
11717. Brentwood Union Free School District, 19-45270

The reference number for these samples is EMSL Order #062021778. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2549 **Collected:** 11/19/2020 **Lab ID:** 062021778-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2550 **Collected:** 11/19/2020 **Lab ID:** 062021778-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2551 **Collected:** 11/19/2020 **Lab ID:** 062021778-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2552 **Collected:** 11/19/2020 **Lab ID:** 062021778-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2553 **Collected:** 11/19/2020 **Lab ID:** 062021778-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2554 **Collected:** 11/19/2020 **Lab ID:** 062021778-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2555 **Collected:** 11/19/2020 **Lab ID:** 062021778-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2556 **Collected:** 11/19/2020 **Lab ID:** 062021778-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2557 **Collected:** 11/19/2020 **Lab ID:** 062021778-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2558 **Collected:** 11/19/2020 **Lab ID:** 062021778-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2559 **Collected:** 11/19/2020 **Lab ID:** 062021778-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2560 **Collected:** 11/19/2020 **Lab ID:** 062021778-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2561 **Collected:** 11/19/2020 **Lab ID:** 062021778-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2562 **Collected:** 11/19/2020 **Lab ID:** 062021778-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2564 **Collected:** 11/19/2020 **Lab ID:** 062021778-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2565 **Collected:** 11/19/2020 **Lab ID:** 062021778-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2568 **Collected:** 11/19/2020 **Lab ID:** 062021778-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2569 **Collected:** 11/19/2020 **Lab ID:** 062021778-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2570 **Collected:** 11/19/2020 **Lab ID:** 062021778-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2571 **Collected:** 11/19/2020 **Lab ID:** 062021778-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2572 **Collected:** 11/19/2020 **Lab ID:** 062021778-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	36	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2573 **Collected:** 11/19/2020 **Lab ID:** 062021778-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	210	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2574 **Collected:** 11/19/2020 **Lab ID:** 062021778-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2575 **Collected:** 11/19/2020 **Lab ID:** 062021778-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2576 **Collected:** 11/19/2020 **Lab ID:** 062021778-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2577 **Collected:** 11/19/2020 **Lab ID:** 062021778-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2578 **Collected:** 11/19/2020 **Lab ID:** 062021778-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2579 **Collected:** 11/19/2020 **Lab ID:** 062021778-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2580 **Collected:** 11/19/2020 **Lab ID:** 062021778-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2580 **Collected:** 11/19/2020 **Lab ID:** 062021778-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2581 **Collected:** 11/19/2020 **Lab ID:** 062021778-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2582 **Collected:** 11/19/2020 **Lab ID:** 062021778-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2583 **Collected:** 11/19/2020 **Lab ID:** 062021778-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.9	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2584 **Collected:** 11/19/2020 **Lab ID:** 062021778-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2585 **Collected:** 11/19/2020 **Lab ID:** 062021778-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2586 **Collected:** 11/19/2020 **Lab ID:** 062021778-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2587 **Collected:** 11/19/2020 **Lab ID:** 062021778-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2588 **Collected:** 11/19/2020 **Lab ID:** 062021778-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2589 **Collected:** 11/19/2020 **Lab ID:** 062021778-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2590 **Collected:** 11/19/2020 **Lab ID:** 062021778-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2591 **Collected:** 11/19/2020 **Lab ID:** 062021778-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2592 **Collected:** 11/19/2020 **Lab ID:** 062021778-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.5	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2593 **Collected:** 11/19/2020 **Lab ID:** 062021778-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-2594		Collected:	11/19/2020	Lab ID:	062021778-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2595		Collected:	11/19/2020	Lab ID:	062021778-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2596		Collected:	11/19/2020	Lab ID:	062021778-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2597		Collected:	11/19/2020	Lab ID:	062021778-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2598		Collected:	11/19/2020	Lab ID:	062021778-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2600		Collected:	11/19/2020	Lab ID:	062021778-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2601		Collected:	11/19/2020	Lab ID:	062021778-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/18/2020	AM	12/21/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2602 **Collected:** 11/19/2020 **Lab ID:** 062021778-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2603 **Collected:** 11/19/2020 **Lab ID:** 062021778-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2604 **Collected:** 11/19/2020 **Lab ID:** 062021778-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2605 **Collected:** 11/19/2020 **Lab ID:** 062021778-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	49	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2606 **Collected:** 11/19/2020 **Lab ID:** 062021778-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2607 **Collected:** 11/19/2020 **Lab ID:** 062021778-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2608 **Collected:** 11/19/2020 **Lab ID:** 062021778-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2609 **Collected:** 11/19/2020 **Lab ID:** 062021778-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2610 **Collected:** 11/19/2020 **Lab ID:** 062021778-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2612 **Collected:** 11/19/2020 **Lab ID:** 062021778-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2613 **Collected:** 11/19/2020 **Lab ID:** 062021778-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2614 **Collected:** 11/19/2020 **Lab ID:** 062021778-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2615 **Collected:** 11/19/2020 **Lab ID:** 062021778-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2617 **Collected:** 11/19/2020 **Lab ID:** 062021778-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2618 **Collected:** 11/19/2020 **Lab ID:** 062021778-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-2618 **Collected:** 11/19/2020 **Lab ID:** 062021778-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2619 **Collected:** 11/19/2020 **Lab ID:** 062021778-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2621 **Collected:** 11/19/2020 **Lab ID:** 062021778-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2622 **Collected:** 11/19/2020 **Lab ID:** 062021778-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2623 **Collected:** 11/19/2020 **Lab ID:** 062021778-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2624 **Collected:** 11/19/2020 **Lab ID:** 062021778-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2625 **Collected:** 11/19/2020 **Lab ID:** 062021778-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2626 **Collected:** 11/19/2020 **Lab ID:** 062021778-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2627 **Collected:** 11/19/2020 **Lab ID:** 062021778-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2628 **Collected:** 11/19/2020 **Lab ID:** 062021778-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2629 **Collected:** 11/19/2020 **Lab ID:** 062021778-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2630 **Collected:** 11/19/2020 **Lab ID:** 062021778-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2631 **Collected:** 11/19/2020 **Lab ID:** 062021778-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2632 **Collected:** 11/19/2020 **Lab ID:** 062021778-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	12/18/2020	AM	12/21/2020	AM

Client Sample Description BRTWD-2633 **Collected:** 11/19/2020 **Lab ID:** 062021778-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2633		Collected:	11/19/2020	Lab ID:	062021778-0078	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	160	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2634		Collected:	11/19/2020	Lab ID:	062021778-0079	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2635		Collected:	11/19/2020	Lab ID:	062021778-0080	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2636		Collected:	11/19/2020	Lab ID:	062021778-0081	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2637		Collected:	11/19/2020	Lab ID:	062021778-0082	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2638		Collected:	11/19/2020	Lab ID:	062021778-0083	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2639		Collected:	11/19/2020	Lab ID:	062021778-0084	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2640		Collected:	11/19/2020	Lab ID:	062021778-0085	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021778

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/19/2020 04:52 PM
 Collected: 11/19/2020

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717. Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2640	Collected:	11/19/2020	Lab ID:	062021778-0085		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2641	Collected:	11/19/2020	Lab ID:	062021778-0086		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2642	Collected:	11/19/2020	Lab ID:	062021778-0087		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2646	Collected:	11/19/2020	Lab ID:	062021778-0088		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2647	Collected:	11/19/2020	Lab ID:	062021778-0089		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2649	Collected:	11/19/2020	Lab ID:	062021778-0090		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Client Sample Description		BRTWD-2650	Collected:	11/19/2020	Lab ID:	062021778-0091		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	12/18/2020	AM	12/21/2020	AM
Lead MDL: 1.0µg/L								



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062021778
CustomerID: JCBR50
CustomerPO:
ProjectID:

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062105802 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~19-45270~~ 21-48246
Building: East Kindergarten Center
EKC

Client:
Brentwood Union Free School District
☒ Retest ☐ New Install ☐
Turn Around: Normal ~~1 wk~~ Rush

Page 1 of 1

OrderID: 062105802

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2572	Classroom	1003	Room 8	CF	3/26/2021	7:26:00 AM
BRTWD-2573	Classroom	1003	Room 8	DW	3/26/2021	7:27:00 AM
BRTWD-2605	Kitchen	1041	Kitchen	PK	3/26/2021	7:08:00 AM
BRTWD-2606	Kitchen	1041	Kitchen	KC	3/26/2021	7:09:00 AM
BRTWD-2624	Classroom	1053	Room 31	DW	3/26/2021	7:12:00 AM
BRTWD-2630	Classroom	1056	Room 36	DW	3/26/2021	7:14:00 AM
BRTWD-2632	Classroom	1057	Room 35	DW	3/26/2021	7:16:00 AM
BRTWD-2633	Classroom	1058	Room 38	CF	3/26/2021	7:18:00 AM
BRTWD-2642	Classroom	1064	Room 44	DW	3/26/2021	7:21:00 AM

Samples Submitted 9

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address
50 Timberline Drive
Brentwood, NY 11717

Pb 200.5-

Analysis Type: ELAP 200.5 (40)

Lab Received: Unique Mexico

Signature: WM 3/27/21 3:25 pm

Samplers Name: Erin Todzia

Samplers Signature: A. Todzia

JCB Project Manager: Meghan Gwynn

Alvin Liang 04/02/21



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/27/2021. The results are tabulated on the attached data pages for the following client designated project:

East Kindergarten Center, 50 Timberline Drive, Brentwood, NY
11717, Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062105802. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105802

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 3/27/2021 03:25 PM
 Collected: 3/27/2021

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description		BRTWD-2572 Room 8	Collected:	3/27/2021	Lab ID:	062105802-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2573 Room 8	Collected:	3/27/2021	Lab ID:	062105802-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2605 Kitchen	Collected:	3/27/2021	Lab ID:	062105802-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2606 Kitchen	Collected:	3/27/2021	Lab ID:	062105802-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2624 Room 31	Collected:	3/27/2021	Lab ID:	062105802-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2630 Room 36	Collected:	3/27/2021	Lab ID:	062105802-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	35	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2632 Room 35	Collected:	3/27/2021	Lab ID:	062105802-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2633 Room 38	Collected:	3/27/2021	Lab ID:	062105802-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105802

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/27/2021 03:25 PM
Collected: 3/27/2021

Project: **East Kindergarten Center, 50 Timberline Drive, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-2633
Room 38 **Collected:** 3/27/2021 **Lab ID:** 062105802-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2642
Room 44 **Collected:** 3/27/2021 **Lab ID:** 062105802-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.6	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Kindergarten Center

EKC

062108242

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2634	Classroom	1058	Room 38	DW	5/7/2021	7:01:00 AM

Samples Submitted 1

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 7 PM 3:56

Building Address

50 Timberline Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 5/7/21 @ 3:46pm

Signature: [Signature]

Samplers Name: Alexandria Oriassino

Samplers Signature: A Oriassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/7/2021. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District. East Kindergarten Center.
EKC. JCB # 19-45270

The reference number for these samples is EMSL Order #062108242. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108242

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/07/21 3:46 PM
Collected: 5/7/2021

Project: **Brentwood Union Free School District. East Kindergarten Center. EKC. JCB # 19-45270**

Analytical Results

Client Sample Description BRTWD - 2634**Collected:** 5/7/2021**Lab ID:** 062108242-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

062 218353

**Lead in Water: Chain of Custody for**

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

21-48246

Building: East Kindergarten Center

EKC

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2630	Classroom	1056	Room 36	DW	8/24/2022	6:43:00 AM

Samples Submitted 1

16 200.5
[Signature]
 8/29/22

RECEIVED
 EHSL ANALYTICAL INC.
 CANTLE PLACE, NY
 2022 AUG 24 P 5:26

**Building Address**

50 Timberline Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5^m

Lab Received:

Signature:

Sampler's Name:

Sampler's Signature:

JCB Project Manager:

Lori Michalowski

[Signature]

Meghan Ewlynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2022. The results are tabulated on the attached data pages for the following client designated project:

**#: 21-48246, East Kindergarten Center, Brentwood Union Free
School District, 50 Timberline Drive, Brentwood NY 11717**

The reference number for these samples is EMSL Order #062218353. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218353

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/24/2022 05:26 PM
Collected: 8/24/2022

Project: #: 21-48246, East Kindergarten Center, Brentwood Union Free School District, 50 Timberline Drive, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-2630 **Collected:** 8/24/2022 **Lab ID:** 062218353-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: East Kindergarten Center

EKC

C62225061

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush



Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3071	HA	1044	Corridor From Main Office To Receiving Room	WC	12/7/2022	7:30:00 AM
BRTWD-3072	HA	1044	Corridor From Main Office To Receiving Room	WF	12/7/2022	7:31:00 AM
BRTWD-3073	HA	1025	Corridor From Room 7 To Main Office	WC	12/7/2022	7:34:00 AM
BRTWD-3074	HA	1025	Corridor From Room 7 To Main Office	WF	12/7/2022	7:35:00 AM

Samples Submitted 4

Pb 200.5
Ben Akter 12/8/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC - 7 P 2:40

Building Address

50 Timberline Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

12/11/22
2:40 PM

Samplers Name: Aileen McKamee

Samplers Signature: Aileen McKamee

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/19/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/7/2022. The results are tabulated on the attached data pages for the following client designated project:

East Kindergarten Center, Brentwood Union Free School District,
50 Timberline Drive, Brentwood NY 11717

The reference number for these samples is EMSL Order #062225061. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

Report amended 12/19/2022 09:10:01 Replaces initial report from 12/08/2022 22:59:06

Report amended 12/19/2022 15:23:10 Replaces amended report from 12/19/2022 09:10:01 Report w/ correct units

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225061

CustomerID: JC BR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/7/2022 02:40 PM
Collected: 12/7/2022

Project: East Kindergarten Center, Brentwood Union Free School District, 50 Timberline Drive, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3071 **Collected:** 12/7/2022 **Lab ID:** 062225061-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3072 **Collected:** 12/7/2022 **Lab ID:** 062225061-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3073 **Collected:** 12/7/2022 **Lab ID:** 062225061-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3074 **Collected:** 12/7/2022 **Lab ID:** 062225061-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Kindergarten Warehouse

EKW

Client:

Brentwood Union Free School District

Retest/New Install ☐ ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2977	Bathroom	1001A	Locker Area Bathroom	BF	11/19/2020	7:40:00 AM

Samples Submitted 1

062021628

20 NOV 19 PM 3:03

ANALYTICAL, INC.
CARLE PLACE, NY

Building Address

50 Timberline Drive

Brentwood, NY 11717

Alexis McDonald 11/24/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Michelle Selto
11/19/20 3:03 PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alina Castellan
Alina Castellan
Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/19/2020. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District, East Kindergarten
Warehouse, EKW, 50 Timberline Drive, Brentwood, NY 11717,
#-19-45270

The reference number for these samples is EMSL Order #062021628. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021628

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/19/2020 03:03 PM
Collected: 11/19/2020

Project: **Brentwood Union Free School District, East Kindergarten Warehouse, EKW, 50 Timberline Drive, Brentwood, NY 11717, #:19-45270**

Analytical Results

Client Sample Description BRTWD-2977 **Collected:** 11/19/2020 **Lab ID:** 062021628-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/24/2020	AL	11/24/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J.C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Middle School

EMS

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1354	Bathroom	1006A1	Auditorium Lobby Men's Bathroom	BF	11/20/2020	6:20:00 AM
BRTWD-1355	Bathroom	1006A1	Auditorium Lobby Men's Bathroom	BF	11/20/2020	6:20:00 AM
BRTWD-1356	Bathroom	1006A2	Auditorium Lobby Women's Bathroom	BF	11/20/2020	6:22:00 AM
BRTWD-1357	Bathroom	1006A2	Auditorium Lobby Women's Bathroom	BF	11/20/2020	6:22:00 AM
BRTWD-1361	Hallway	1023	Corridor Near Room 124 (1014)	DW	11/20/2020	6:31:00 AM
BRTWD-1362	Hallway	1023	Corridor Near Room 124 (1014)	DW	11/20/2020	6:31:00 AM
BRTWD-1365	Classroom	1015	Room 121	CF	11/20/2020	6:58:00 AM
BRTWD-1371	Hallway	N/A	Corridor Near Bathrooms	WC	11/20/2020	6:42:00 AM
BRTWD-1375	Classroom	N/A	Room 143	CF	11/20/2020	6:47:00 AM
BRTWD-1376	Classroom	N/A	Room 142	CF	11/20/2020	6:47:00 AM
BRTWD-1377	Hallway	N/A	Corridor Near Basement Stairwell	WC	11/20/2020	6:48:00 AM
BRTWD-1378	Hallway	N/A	Corridor Near Basement Stairwell	WC	11/20/2020	6:49:00 AM
BRTWD-1384	Hallway	N/A	Corridor Near Bathrooms	WC	11/20/2020	6:54:00 AM
BRTWD-1385	Hallway	N/A	Corridor Near Bathrooms	WC	11/20/2020	6:54:00 AM
BRTWD-1390	Bathroom	1026B	Faculty Women's Bathroom	BF	11/20/2020	7:00:00 AM
BRTWD-1391	Faculty Lounge	1026A	Faculty Room	CF	11/20/2020	7:01:00 AM
BRTWD-1392	Bathroom	1027A	Faculty Men's Bathroom	BF	11/20/2020	7:02:00 AM
BRTWD-1393	Hallway	1056	Corridor Near Faculty Room (1026A)	WC	11/20/2020	7:03:00 AM

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Allyson McDonald 12/28/20

Analysis Type: ELAP 200.5

Lab Received: *Unique mcray*

Signature: *Um 11/20/20 @ 3:09 pm*

Samplers Name: *Alinea Castelluzzo*

Samplers Signature: *Alinea Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Middle School

EMS

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1394	Hallway	1056	Corridor Near Faculty Room (1026A)	WF	11/20/2020	7:03:00 AM
BRTWD-1395	Bathroom	1028	Boys Bathroom	BF	11/20/2020	7:04:00 AM
BRTWD-1396	Bathroom	1029C	Nurse's Office Bathroom	BF	11/20/2020	7:05:00 AM
BRTWD-1397	Nurse Office	1029	Nurse's Office	NS	11/20/2020	7:05:00 AM
BRTWD-1399	Bathroom	1030	Girls Bathroom	BF	11/20/2020	7:06:00 AM
BRTWD-1400	Hallway	1056	Corridor Near Girls Locker Room (1033A)	DW	11/20/2020	7:09:00 AM
BRTWD-1401	Bathroom	1033B1	Girls Coach's Office Bathroom	BF	11/20/2020	7:15:00 AM
BRTWD-1404	Locker Room	1033A	Girls Locker Room	DW	11/20/2020	7:10:00 AM
BRTWD-1405	Hallway	1056	Corridor Near Boiler Room (0001)	DW	11/20/2020	7:13:00 AM
BRTWD-1406	Bathroom	1041A	Custodial Office Bathroom	BF	11/20/2020	7:13:00 AM
BRTWD-1407	Bathroom	1042A1	Boys Coach's Office Bathroom	BF	11/20/2020	7:14:00 AM
BRTWD-1408	Locker Room	1042B	Boys Locker Room	DW	11/20/2020	7:16:00 AM
BRTWD-1411	Hallway	1056	Corridor Near Room 110 (1044)	DW	11/20/2020	7:16:00 AM
BRTWD-1414	Home Economics	1048	Room 106	EC	11/20/2020	7:20:00 AM
BRTWD-1415	Home Economics	1048	Room 106	EC	11/20/2020	7:20:00 AM
BRTWD-1416	Home Economics	1048	Room 106	EC	11/20/2020	7:20:00 AM
BRTWD-1417	Home Economics	1048A	Room 106 Laundry Room	EC	11/20/2020	7:23:00 AM
BRTWD-1419	Home Economics	1052	Room 104	EC	11/20/2020	7:24:00 AM

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unique McKay

Signature: Len 11/20/20 @ 3:09 PM

Samplers Name: Alinea Castelluzzo

Samplers Signature: Alinea Castelluzzo

JCB Project Manager: Meghan Gwynn

OrderID: 062021710

Alyssa McDonald 12/28/20



062021710 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Middle School

EMS

Client:

Brentwood Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1420	Home Economics	1052	Room 104	EC	11/20/2020	7:25:00 AM
BRTWD-1421	Home Economics	1052	Room 104	EC	11/20/2020	7:25:00 AM
BRTWD-1422	Home Economics	1052	Room 104	EC	11/20/2020	7:25:00 AM
BRTWD-1426	Hallway	1056	Corridor Near Room 104 (1052)	DW	11/20/2020	7:55:00 AM
BRTWD-1431	Bathroom	2000	Boys Bathroom	BF	11/20/2020	7:33:00 AM
BRTWD-1432	Bathroom	2000	Boys Bathroom	BF	11/20/2020	7:33:00 AM
BRTWD-1434	Hallway	2021	Corridor Near Room 202 (2002)	WC	11/20/2020	7:34:00 AM
BRTWD-1435	Bathroom	2003	Girls Bathroom	BF	11/20/2020	7:35:00 AM
BRTWD-1436	Bathroom	2003	Girls Bathroom	BF	11/20/2020	7:35:00 AM
BRTWD-1445	Hallway	2021	Corridor Near Room 210 (2010)	DW	11/20/2020	7:38:00 AM
BRTWD-1446	Office	2017A	Library Work Room	CF	11/20/2020	7:39:00 AM
BRTWD-1447	Hallway	2021	Corridor Near Room 216 (2019)	DW	11/20/2020	7:40:00 AM
BRTWD-1450	Hallway	N/A	Corridor Near Faculty Bathrooms	WC	11/20/2020	7:41:00 AM
BRTWD-1454	Hallway	N/A	Corridor Near Room 246	WC	11/20/2020	7:43:00 AM
BRTWD-1455	Hallway	N/A	Corridor Near Room 246	WC	11/20/2020	7:43:00 AM
BRTWD-1456	Hallway	2041	Corridor Near Room 218 (2024)	DW	11/20/2020	7:46:00 AM
BRTWD-1457	Classroom	2030	Room 221	CF	11/20/2020	7:45:00 AM
BRTWD-1458	Classroom	2032	Room 223	CF	11/20/2020	7:45:00 AM

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unique Mercury

Signature: um 11/20/20 @ 3:09 PM

Samplers Name: Arling Castelli 11/22/20

Samplers Signature: Arling Castelli

JCB Project Manager: Meghan Gwynn

OrderID: 062021710

Alexis McDonald 12/28/20



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Middle School

EMS

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1462	Hallway	2041	Corridor Near Room 226 (2033)	DW	11/20/2020	7:48:00 AM
BRTWD-1463	Hallway	2041	Corridor Near Room 226 (2033)	WF	11/20/2020	7:48:00 AM
BRTWD-1467	Bathroom	2035	Boys Bathroom	BF	11/20/2020	7:49:00 AM
BRTWD-1468	Bathroom	2035	Boys Bathroom	BF	11/20/2020	7:49:00 AM
BRTWD-1469	Bathroom	2035	Boys Bathroom	BF	11/20/2020	7:49:00 AM
BRTWD-1471	Bathroom	2037	Girls Bathroom	BF	11/20/2020	7:50:00 AM
BRTWD-1472	Bathroom	2037	Girls Bathroom	BF	11/20/2020	7:51:00 AM
BRTWD-1473	Bathroom	2037	Girls Bathroom	BF	11/20/2020	7:51:00 AM
BRTWD-1474	Faculty Lounge	N/A	Basement Technology Suite Break Room	BW	11/20/2020	6:53:00 AM
BRTWD-1476	Kitchen	1036	Kitchen	HW	11/20/2020	6:02:00 AM
BRTWD-1477	Kitchen	1036	Kitchen	KC	11/20/2020	6:03:00 AM
BRTWD-1478	Kitchen	1036	Kitchen	KC	11/20/2020	6:03:00 AM
BRTWD-1479	Kitchen	1036	Kitchen	KC	11/20/2020	6:05:00 AM
BRTWD-1480	Kitchen	1036	Kitchen	SN	11/20/2020	6:05:00 AM
BRTWD-1481	Kitchen	1036	Kitchen	KC	11/20/2020	6:05:00 AM
BRTWD-1482	Kitchen	1036	Kitchen	HW	11/20/2020	6:07:00 AM
BRTWD-1483	Kitchen	1036	Kitchen	PK	11/20/2020	6:07:00 AM
BRTWD-1484	Kitchen	1036	Kitchen	HW	11/20/2020	6:07:00 AM

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unique mcraySignature: um 11/2/2020 3:09 AMSamplers Name: Alynn CastelliSamplers Signature: Alynn CastelliJCB Project Manager: Meghan Gwynn

OrderID: 062021710

Alynn mcray 12/28/20



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Middle School

EMS

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1486	Bathroom	1036D	Kitchen Bathroom	BF	11/20/2020	6:08:00 AM

Samples Submitted 73

RECEIVED
ENGL ANALYTICAL, INC.
CARLE PLACE, NY
20 NOV 20 PM 3:09

Building Address

70 Hilltop Drive

Brentwood, NY-11717

Analysis Type: ELAP 200.5

Lab Received: Unique mckaySignature: lem 11/20/20 @ 3:09 PMSamplers Name: Alicia Costello 11/22/20Samplers Signature: Alicia CostelloJCB Project Manager: Meghan Gwyll



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/20/2020. The results are tabulated on the attached data pages for the following client designated project:

East Middle School, 70 Hilltop Drive, Brentwood, NY 11717,
Brentwood Union Free School District, #19-45270

The reference number for these samples is EMSL Order #062021710. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1354 **Collected:** 11/20/2020 **Lab ID:** 062021710-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1355 **Collected:** 11/20/2020 **Lab ID:** 062021710-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	38	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1356 **Collected:** 11/20/2020 **Lab ID:** 062021710-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	30	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1357 **Collected:** 11/20/2020 **Lab ID:** 062021710-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1361 **Collected:** 11/20/2020 **Lab ID:** 062021710-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1362 **Collected:** 11/20/2020 **Lab ID:** 062021710-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1365 **Collected:** 11/20/2020 **Lab ID:** 062021710-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1371 **Collected:** 11/20/2020 **Lab ID:** 062021710-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1371 **Collected:** 11/20/2020 **Lab ID:** 062021710-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1375 **Collected:** 11/20/2020 **Lab ID:** 062021710-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	12/23/2020	AM	12/28/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1376 **Collected:** 11/20/2020 **Lab ID:** 062021710-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1377 **Collected:** 11/20/2020 **Lab ID:** 062021710-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1378 **Collected:** 11/20/2020 **Lab ID:** 062021710-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1384 **Collected:** 11/20/2020 **Lab ID:** 062021710-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1385 **Collected:** 11/20/2020 **Lab ID:** 062021710-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1390 **Collected:** 11/20/2020 **Lab ID:** 062021710-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1390 **Collected:** 11/20/2020 **Lab ID:** 062021710-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1391 **Collected:** 11/20/2020 **Lab ID:** 062021710-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1392 **Collected:** 11/20/2020 **Lab ID:** 062021710-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	12/23/2020	AM	12/28/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1393 **Collected:** 11/20/2020 **Lab ID:** 062021710-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1394 **Collected:** 11/20/2020 **Lab ID:** 062021710-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1395 **Collected:** 11/20/2020 **Lab ID:** 062021710-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1396 **Collected:** 11/20/2020 **Lab ID:** 062021710-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1397 **Collected:** 11/20/2020 **Lab ID:** 062021710-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1397 **Collected:** 11/20/2020 **Lab ID:** 062021710-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1399 **Collected:** 11/20/2020 **Lab ID:** 062021710-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1400 **Collected:** 11/20/2020 **Lab ID:** 062021710-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	12/23/2020	AM	12/28/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1401 **Collected:** 11/20/2020 **Lab ID:** 062021710-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1404 **Collected:** 11/20/2020 **Lab ID:** 062021710-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1405 **Collected:** 11/20/2020 **Lab ID:** 062021710-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	33	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1406 **Collected:** 11/20/2020 **Lab ID:** 062021710-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/23/2020	AM	12/28/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1407 **Collected:** 11/20/2020 **Lab ID:** 062021710-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1408 **Collected:** 11/20/2020 **Lab ID:** 062021710-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1411 **Collected:** 11/20/2020 **Lab ID:** 062021710-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1414 **Collected:** 11/20/2020 **Lab ID:** 062021710-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1415 **Collected:** 11/20/2020 **Lab ID:** 062021710-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1416 **Collected:** 11/20/2020 **Lab ID:** 062021710-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1417 **Collected:** 11/20/2020 **Lab ID:** 062021710-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	110	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1419 **Collected:** 11/20/2020 **Lab ID:** 062021710-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1419 **Collected:** 11/20/2020 **Lab ID:** 062021710-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1420 **Collected:** 11/20/2020 **Lab ID:** 062021710-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1421 **Collected:** 11/20/2020 **Lab ID:** 062021710-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Client Sample Description BRTWD-1422 **Collected:** 11/20/2020 **Lab ID:** 062021710-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1426 **Collected:** 11/20/2020 **Lab ID:** 062021710-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/23/2020	AM	12/28/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1431 **Collected:** 11/20/2020 **Lab ID:** 062021710-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1432 **Collected:** 11/20/2020 **Lab ID:** 062021710-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1434 **Collected:** 11/20/2020 **Lab ID:** 062021710-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1435 **Collected:** 11/20/2020 **Lab ID:** 062021710-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1436 **Collected:** 11/20/2020 **Lab ID:** 062021710-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1445 **Collected:** 11/20/2020 **Lab ID:** 062021710-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	300	6.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1446 **Collected:** 11/20/2020 **Lab ID:** 062021710-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1447 **Collected:** 11/20/2020 **Lab ID:** 062021710-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1450 **Collected:** 11/20/2020 **Lab ID:** 062021710-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1454 **Collected:** 11/20/2020 **Lab ID:** 062021710-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description		BRTWD-1454		Collected:	11/20/2020	Lab ID:	062021710-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1455		Collected:	11/20/2020	Lab ID:	062021710-0051	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1456		Collected:	11/20/2020	Lab ID:	062021710-0052	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1457		Collected:	11/20/2020	Lab ID:	062021710-0053	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1458		Collected:	11/20/2020	Lab ID:	062021710-0054	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1462		Collected:	11/20/2020	Lab ID:	062021710-0055	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1463		Collected:	11/20/2020	Lab ID:	062021710-0056	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0	µg/L	12/23/2020	AM	12/29/2020	AM
Client Sample Description		BRTWD-1467		Collected:	11/20/2020	Lab ID:	062021710-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1467 **Collected:** 11/20/2020 **Lab ID:** 062021710-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	12/23/2020	AM	12/29/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1468 **Collected:** 11/20/2020 **Lab ID:** 062021710-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1469 **Collected:** 11/20/2020 **Lab ID:** 062021710-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.0	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1471 **Collected:** 11/20/2020 **Lab ID:** 062021710-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1472 **Collected:** 11/20/2020 **Lab ID:** 062021710-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	35	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1473 **Collected:** 11/20/2020 **Lab ID:** 062021710-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1474 **Collected:** 11/20/2020 **Lab ID:** 062021710-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1476 **Collected:** 11/20/2020 **Lab ID:** 062021710-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/20/2020 03:09 PM
 Collected: 11/20/2020

Project: **East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270**

Analytical Results

Client Sample Description BRTWD-1476 **Collected:** 11/20/2020 **Lab ID:** 062021710-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.6	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1477 **Collected:** 11/20/2020 **Lab ID:** 062021710-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1478 **Collected:** 11/20/2020 **Lab ID:** 062021710-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/23/2020	AM	12/29/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1479 **Collected:** 11/20/2020 **Lab ID:** 062021710-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	12/23/2020	AM	12/29/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1480 **Collected:** 11/20/2020 **Lab ID:** 062021710-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1481 **Collected:** 11/20/2020 **Lab ID:** 062021710-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	12/23/2020	AM	12/29/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1482 **Collected:** 11/20/2020 **Lab ID:** 062021710-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021710

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/20/2020 03:09 PM
Collected: 11/20/2020

Project: East Middle School, 70 Hilltop Drive, Brentwood, NY 11717, Brentwood Union Free School District, #19-45270

Analytical Results

Client Sample Description BRTWD-1483 **Collected:** 11/20/2020 **Lab ID:** 062021710-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1484 **Collected:** 11/20/2020 **Lab ID:** 062021710-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Client Sample Description BRTWD-1486 **Collected:** 11/20/2020 **Lab ID:** 062021710-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	12/23/2020	AM	12/29/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: East Middle School

EMS

062108239

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1354	Bathroom	1006A1	Auditorium Lobby Men's Bathroom	BF	5/7/2021	6:38:00 AM
BRTWD-1355	Bathroom	1006A1	Auditorium Lobby Men's Bathroom	BF	5/7/2021	6:39:00 AM
BRTWD-1356	Bathroom	1006A2	Auditorium Lobby Women's Bathroom	BF	5/7/2021	6:39:00 AM
BRTWD-1357	Bathroom	1006A2	Auditorium Lobby Women's Bathroom	BF	5/7/2021	6:40:00 AM
BRTWD-1417	Home Economics	1048A	Room 106 Laundry Room	EC	5/7/2021	6:34:00 AM

Samples Submitted 5

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 7 PM 3:45

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 5/7/21 @ 3:45pm

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature:

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/7/2021. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District. East Middle School. EMS.
JCB # 19-45270.

The reference number for these samples is EMSL Order #062108239. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108239

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 05/07/21 3:45 PM
 Collected: 5/7/2021

Project: **Brentwood Union Free School District. East Middle School. EMS. JCB # 19-45270.****Analytical Results**

Client Sample Description BRTWD - 1354 **Collected:** 5/7/2021 **Lab ID:** 062108239-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1355 **Collected:** 5/7/2021 **Lab ID:** 062108239-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	120	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1356 **Collected:** 5/7/2021 **Lab ID:** 062108239-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	61	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1357 **Collected:** 5/7/2021 **Lab ID:** 062108239-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1417 **Collected:** 5/7/2021 **Lab ID:** 062108239-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

~~19-45270~~ 21-48246

Building:

East Middle School

EMS

062110612

Client:

Brentwood Union Free School District

Retest New Install ||

Turn Around: Normal 1 wk Rush _____

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1468	Bathroom	2035	Boys Bathroom (Across Room 228)	BF	6/16/2021	6:43:00 AM
BRTWD-1472	Bathroom	2037	Girls Bathroom (Across Room 228)	BF	6/16/2021	6:42:00 AM

Samples Submitted 2

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 P 3:14

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received:

Alyssa McDonald

Signature:

Alyssa McDonald

Samplers Name:

Alina Castelluzzo

Samplers Signature:

Alina Castelluzzo

JCB Project Manager:

Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, East Middle School, Brentwood Union Free School
District, 70 Hilltop Drive, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110612. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110612

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/16/21 3:14 PM
Collected: 6/16/2021

Project: #21-48246, East Middle School, Brentwood Union Free School District, 70 Hilltop Drive, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1468 **Collected:** 6/16/2021 **Lab ID:** 062110612-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-1472 **Collected:** 6/16/2021 **Lab ID:** 062110612-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	30	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

062222198



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: East Middle School

EMS

Courier

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3014	HA	1056	Corridor Near Boiler Room (1001)	WC	10/18/2022	6:36:00 AM
BRTWD-3015	HA	1056	Corridor Near Boiler Room (1001)	WF	10/18/2022	6:37:00 AM
BRTWD-3016	HA	1023	Corridor Near Room 124 (1014)	WC	10/18/2022	6:39:00 AM
BRTWD-3017	HA	1023	Corridor Near Room 124 (1014)	WF	10/18/2022	6:40:00 AM
BRTWD-3020	HA	2021	Corridor Near Room 216 (2019)	WC	10/18/2022	6:44:00 AM
BRTWD-3021	HA	2021	Corridor Near Room 216 (2019)	WF	10/18/2022	6:44:00 AM

Samples Submitted 6

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 OCT 18 P 12:26

Building Address

70 Hilltop Drive

Brentwood, NY 11717

Analysts Type: ELAP 200.5^{IN}

Lab Received:

Signature:

10-18-22 12:26 AM

Samplers Name: Meghan Gwynn

Samplers Signature:

JCB Project Manager:

Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

10/22/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/18/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 21-48246, East Middle School, Brentwood Union Free School
District, 70 Hilltop Drive, Brentwood NY 11717

The reference number for these samples is EMSL Order #062222198. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062222198

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/18/2022 12:26 PM
 Collected: 10/18/2022

Project: #: 21-48246, East Middle School, Brentwood Union Free School District, 70 Hilltop Drive, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3014 **Collected:** 10/18/2022 **Lab ID:** 062222198-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3015 **Collected:** 10/18/2022 **Lab ID:** 062222198-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3016 **Collected:** 10/18/2022 **Lab ID:** 062222198-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3017 **Collected:** 10/18/2022 **Lab ID:** 062222198-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3020 **Collected:** 10/18/2022 **Lab ID:** 062222198-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3021 **Collected:** 10/18/2022 **Lab ID:** 062222198-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Freshman Center

FRESH

062023210

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1501	Nurse Office	1010	Health Suite	NS	12/10/2020	6:09:00 AM
BRTWD-1503	Bathroom	1010C	Health Suite Bathroom	BF	12/10/2020	6:11:00 AM
BRTWD-1504	Bathroom	1020	Women's Bathroom	BF	12/10/2020	6:14:00 AM
BRTWD-1505	Bathroom	1021	Men's Bathroom	BF	12/10/2020	6:16:00 AM
BRTWD-1506	Office	1015	Principal's Office	BW	12/10/2020	6:18:00 AM
BRTWD-1508	Faculty Lounge	1034	Faculty Room	CF	12/10/2020	6:22:00 AM
BRTWD-1510	Faculty Lounge	1034	Faculty Room	CF	12/10/2020	6:23:00 AM
BRTWD-1512	Faculty Lounge	1034	Faculty Room	CF	12/10/2020	6:24:00 AM
BRTWD-1514	Faculty Lounge	1034	Faculty Room	CF	12/10/2020	6:25:00 AM
BRTWD-1517	Kitchen	1036	Cafeteria (Area Reconstructed)	HW	12/10/2020	6:33:00 AM
BRTWD-1518	Kitchen	1036	Cafeteria (Area Reconstructed)	KC	12/10/2020	6:33:00 AM
BRTWD-1519	Kitchen	1036	Cafeteria (Area Reconstructed)	HW	12/10/2020	6:33:00 AM
BRTWD-1520	Kitchen	1038	Kitchen	HW	12/10/2020	5:54:00 AM
BRTWD-1521	Kitchen	1038	Kitchen	KC	12/10/2020	5:56:00 AM
BRTWD-1522	Kitchen	1038	Kitchen	KC	12/10/2020	5:56:00 AM
BRTWD-1523	Kitchen	1038	Kitchen	KC	12/10/2020	5:58:00 AM
BRTWD-1524	Kitchen	1038	Kitchen	SN	12/10/2020	5:58:00 AM
BRTWD-1525	Kitchen	1038	Kitchen	PK	12/10/2020	5:59:00 AM

Building Address

33 Leahy Avenue

Brentwood, NY 11717

Pb 200.5-

A. J. J. 5/1/21

Analysis Type: ELAP 200.5 (A)

Lab Received:

Signature:

Samplers Name: Alina Castellan

Samplers Signature: Alina Castellan

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Freshman Center

FRESH

062023210

Client:

Brentwood Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Page 2 of 2

OrderID: 062023210

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1526	Kitchen	1038	Kitchen	HW	12/10/2020	5:59:00 AM
BRTWD-1527	Bathroom	1039	Kitchen Bathroom	BF	12/10/2020	6:00:00 AM
BRTWD-1536	Bathroom	1065	Men's Bathroom	BF	12/10/2020	6:38:00 AM
BRTWD-1537	Bathroom	1065	Men's Bathroom	BF	12/10/2020	6:38:00 AM
BRTWD-1540	Bathroom	1073B1	Girls Coach's Office Bathroom	BF	12/10/2020	6:48:00 AM
BRTWD-1542	Bathroom	1073A1	Girls Locker Room Bathroom	BF	12/10/2020	6:50:00 AM
BRTWD-1545	Bathroom	1071A1	Boys Coach's Office Bathroom	BF	12/10/2020	6:52:00 AM
BRTWD-1547	Bathroom	1071B1	Boys Locker Room Bathroom	BF	12/10/2020	6:53:00 AM
BRTWD-1548	Office	1068C	Library Work Room	CF	12/10/2020	6:56:00 AM
BRTWD-1550	Bathroom	1069	Women's Faculty Bathroom	BF	12/10/2020	6:58:00 AM
BRTWD-1551	Bathroom	1069	Women's Faculty Bathroom	BF	12/10/2020	6:58:00 AM
BRTWD-1561	Bathroom	1083	Girls Bathroom	BF	12/10/2020	7:11:00 AM
BRTWD-1565	Hallway	N/A	Corridor Near Women's Faculty Bathroom	WC	12/10/2020	7:26:00 AM
BRTWD-1629	Bathroom	2010	Girls Bathroom	BF	12/10/2020	7:31:00 AM
BRTWD-1630	Bathroom	2012	Faculty Bathroom	BF	12/10/2020	7:32:00 AM
BRTWD-2993	CA	1036	Cafeteria (Expanded in 2012)	WF	12/10/2020	6:30:00 AM
BRTWD-2994	HA	1076	Corridor Between Library & Gym	WF	12/10/2020	6:45:00 AM

Samples Submitted 35

Building Address

33 Leahy Avenue

Brentwood, NY 11717

Pb20.05-

A. Jung 01/19/21

Analysis Type: ELAP 2005

Lab Received:

Signature:

Samplers Name: *Aina Castelluzzo*

Samplers Signature: *Aina Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/10/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45270, Freshman Center, Brentwood Union Free School
District, 33 Leahy Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062023210. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023210

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/10/2020 04:39 PM
 Collected: 12/10/2020

Project: #19-45270, Freshman Center, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1501		Collected:	12/10/2020	Lab ID:	062023210-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1503		Collected:	12/10/2020	Lab ID:	062023210-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1504		Collected:	12/10/2020	Lab ID:	062023210-0003	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1505		Collected:	12/10/2020	Lab ID:	062023210-0004	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1506		Collected:	12/10/2020	Lab ID:	062023210-0005	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1508		Collected:	12/10/2020	Lab ID:	062023210-0006	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1510		Collected:	12/10/2020	Lab ID:	062023210-0007	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.5	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1512		Collected:	12/10/2020	Lab ID:	062023210-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023210

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/10/2020 04:39 PM
 Collected: 12/10/2020

Project: #19-45270, Freshman Center, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1512 **Collected:** 12/10/2020 **Lab ID:** 062023210-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1514 **Collected:** 12/10/2020 **Lab ID:** 062023210-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/18/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1517 **Collected:** 12/10/2020 **Lab ID:** 062023210-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1518 **Collected:** 12/10/2020 **Lab ID:** 062023210-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1519 **Collected:** 12/10/2020 **Lab ID:** 062023210-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1520 **Collected:** 12/10/2020 **Lab ID:** 062023210-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1521 **Collected:** 12/10/2020 **Lab ID:** 062023210-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1522 **Collected:** 12/10/2020 **Lab ID:** 062023210-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023210

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/10/2020 04:39 PM
 Collected: 12/10/2020

Project: #19-45270, Freshman Center, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1522		Collected:	12/10/2020	Lab ID:	062023210-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1523		Collected:	12/10/2020	Lab ID:	062023210-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1524		Collected:	12/10/2020	Lab ID:	062023210-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1525		Collected:	12/10/2020	Lab ID:	062023210-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1526		Collected:	12/10/2020	Lab ID:	062023210-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1527		Collected:	12/10/2020	Lab ID:	062023210-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1536		Collected:	12/10/2020	Lab ID:	062023210-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	1/18/2021	AM	1/19/2021	AL
Client Sample Description		BRTWD-1537		Collected:	12/10/2020	Lab ID:	062023210-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023210

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/10/2020 04:39 PM
 Collected: 12/10/2020

Project: #19-45270, Freshman Center, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1537 **Collected:** 12/10/2020 **Lab ID:** 062023210-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1540 **Collected:** 12/10/2020 **Lab ID:** 062023210-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1542 **Collected:** 12/10/2020 **Lab ID:** 062023210-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1545 **Collected:** 12/10/2020 **Lab ID:** 062023210-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1547 **Collected:** 12/10/2020 **Lab ID:** 062023210-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1548 **Collected:** 12/10/2020 **Lab ID:** 062023210-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1550 **Collected:** 12/10/2020 **Lab ID:** 062023210-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023210

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/10/2020 04:39 PM
 Collected: 12/10/2020

Project: #19-45270, Freshman Center, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1551 **Collected:** 12/10/2020 **Lab ID:** 062023210-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/18/2021	AM	1/19/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1561 **Collected:** 12/10/2020 **Lab ID:** 062023210-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1565 **Collected:** 12/10/2020 **Lab ID:** 062023210-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1629 **Collected:** 12/10/2020 **Lab ID:** 062023210-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-1630 **Collected:** 12/10/2020 **Lab ID:** 062023210-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-2993 **Collected:** 12/10/2020 **Lab ID:** 062023210-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2021	AM	1/19/2021	AL

Client Sample Description BRTWD-2994 **Collected:** 12/10/2020 **Lab ID:** 062023210-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	1/18/2021	AM	1/19/2021	AL



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062023210
CustomerID: JCBR50
CustomerPO:
ProjectID:

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Freshman Center

FRESH

062108229

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1542	Bathroom	1073A1	Girls Locker Room Bathroom	BF	5/6/2021	7:25:00 AM

Samples Submitted 1

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY -6 PM 2:51

Building Address

33 Leahy Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 5/6/21 @ 2:51pm

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: Alex Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/6/2021. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District. JCB # 19-45270.
Freshman Center. FRESH.

The reference number for these samples is EMSL Order #062108229. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108229

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/06/21 2:51 PM
Collected: 5/6/2021

Project: **Brentwood Union Free School District. JCB # 19-45270. Freshman Center. FRESH.**

Analytical Results

Client Sample Description BRTWD - 1542**Collected:** 5/6/2021**Lab ID:** 062108229-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	5/11/2021	DI	5/12/2021	AL
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Freshman Center

FRESH

062110643

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1561	Bathroom	1083	Girls Bathroom (Near Room 9)	BF	6/17/2021	6:34:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4:02

Building Address

33 Leahy Avenue

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Samplers Name: *Alexandria Orlassino*

Samplers Signature: *Alexandria Orlassino*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Freshman Center, Brentwood Union Free School
District, 33 Leahy Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110643. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110643

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:02 PM
Collected: 6/17/2021

Project: #21-48246, Freshman Center, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1561 **Collected:** 6/17/2021 **Lab ID:** 062110643-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	31	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Freshman Center

FRESH

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1561	Bathroom	1083	Girls Bathroom (Near Room 9)	BF	8/24/2022	6:54:00 AM

Samples Submitted 1



RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 24 P 12:06

P/6 200.5
[Signature]
8/29/22

Building Address

33 Leahy Avenue

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Katherine V. Vaud 8-24-22 12:06 PM

Signature: *[Signature]*

Samplers Name: Erin Todzia

Samplers Signature: *[Signature]*

JCB Project Manager: Meghan Omynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2022. The results are tabulated on the attached data pages for the following client designated project:

JCB #: 21-48246, Freshman Center, FRESH, Brentwood Union
Free School District, 33 Leahy Avenue, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062218271. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218271

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/24/2022 12:06 PM
Collected: 8/24/2022

Project: JCB #: 21-48246, Freshman Center, FRESH, Brentwood Union Free School District, 33 Leahy Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1561 **Collected:** 8/24/2022 **Lab ID:** 062218271-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Hemlock Park Elementary School

HEM

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2204	Classroom	1001	Room 2	CF	12/8/2020	7:17:00 AM
BRTWD-2205	Classroom	1001	Room 2	DW	12/8/2020	7:17:00 AM
BRTWD-2207	Classroom	1000	Room 1	CF	12/8/2020	7:18:00 AM
BRTWD-2208	Classroom	1000	Room 1	DW	12/8/2020	7:18:00 AM
BRTWD-2210	Classroom	1003	Room 3	CF	12/8/2020	7:20:00 AM
BRTWD-2211	Classroom	1003	Room 3	DW	12/8/2020	7:20:00 AM
BRTWD-2212	Classroom	1004	Room 4	CF	12/8/2020	7:22:00 AM
BRTWD-2213	Classroom	1004	Room 4	DW	12/8/2020	7:22:00 AM
BRTWD-2214	Bathroom	1004B	Room 4 Bathroom	BF	12/8/2020	7:22:00 AM
BRTWD-2215	Classroom	1005	Room 5	CF	12/8/2020	7:24:00 AM
BRTWD-2216	Classroom	1005	Room 5	DW	12/8/2020	7:24:00 AM
BRTWD-2217	Classroom	1007	Room 6	CF	12/8/2020	7:26:00 AM
BRTWD-2218	Classroom	1007	Room 6	DW	12/8/2020	7:26:00 AM
BRTWD-2219	Bathroom	1007B	Room 6 Bathroom	BF	12/8/2020	7:26:00 AM
BRTWD-2220	Classroom	1008	Room 7	CF	12/8/2020	7:28:00 AM
BRTWD-2221	Classroom	1008	Room 7	DW	12/8/2020	7:28:00 AM
BRTWD-2222	Classroom	1009	Room 8	CF	12/8/2020	7:30:00 AM
BRTWD-2223	Classroom	1009	Room 8	DW	12/8/2020	7:30:00 AM

Building Address

19 Hemlock Drive

Brentwood, NY 11717

062022878

Analysis Type: ELAP 200.5

Lab Reclaimed:

Signature:

12/8/20 320 PM

Samplers Name:

Samplers Signature:

JCB Project Manager:



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Hemlock Park Elementary School

HEM

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2224	Classroom	1010	Room 9	CF	12/8/2020	7:31:00 AM
BRTWD-2225	Classroom	1010	Room 9	DW	12/8/2020	7:31:00 AM
BRTWD-2226	Classroom	1011	Room 10	CF	12/8/2020	7:32:00 AM
BRTWD-2227	Classroom	1011	Room 10	DW	12/8/2020	7:32:00 AM
BRTWD-2228	Classroom	1012	Room 11	CF	12/8/2020	7:33:00 AM
BRTWD-2229	Classroom	1012	Room 11	DW	12/8/2020	7:33:00 AM
BRTWD-2230	Classroom	1013	Room 12	CF	12/8/2020	7:34:00 AM
BRTWD-2231	Classroom	1013	Room 12	DW	12/8/2020	7:34:00 AM
BRTWD-2232	Classroom	1014	Room 13	CF	12/8/2020	7:36:00 AM
BRTWD-2233	Classroom	1014	Room 13	DW	12/8/2020	7:36:00 AM
BRTWD-2234	Classroom	1015	Room 14	CF	12/8/2020	7:37:00 AM
BRTWD-2235	Classroom	1015	Room 14	DW	12/8/2020	7:37:00 AM
BRTWD-2236	Classroom	1016	Room 15	CF	12/8/2020	7:38:00 AM
BRTWD-2237	Classroom	1016	Room 15	DW	12/8/2020	7:38:00 AM
BRTWD-2238	Classroom	1017	Room 16	CF	12/8/2020	7:40:00 AM
BRTWD-2239	Classroom	1017	Room 16	DW	12/8/2020	7:40:00 AM
BRTWD-2240	Bathroom	1021	Men's Bathroom	BF	12/8/2020	7:41:00 AM
BRTWD-2242	Bathroom	1023	Women's Bathroom	BF	12/8/2020	8:37:00 AM

Building Address

19 Hemlock Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

062022878

12/8/20 3:20 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Hemlock Park Elementary School

HEM

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 Wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2243	Bathroom	1024D1	Girls Locker Room Toilet	BF	12/8/2020	7:43:00 AM
BRTWD-2244	Nurse Office	1025	Nurse's Office	NS	12/8/2020	7:47:00 AM
BRTWD-2245	Bathroom	1025B	Nurse's Office Bathroom	BF	12/8/2020	7:47:00 AM
BRTWD-2246	Nurse Office	1025A	Nurse Sick Room	NS	12/8/2020	7:47:00 AM
BRTWD-2247	Hallway	1054	Corridor Near Gym (1024)	WC	12/8/2020	7:48:00 AM
BRTWD-2248	Faculty Lounge	1030	Faculty Room	CF	12/8/2020	7:49:00 AM
BRTWD-2249	Hallway	1054	Corridor Near Custodial Office (1034A)	DW	12/8/2020	7:58:00 AM
BRTWD-2250	Classroom	1035	Music Room	CF	12/8/2020	7:59:00 AM
BRTWD-2258	Classroom	1040	Room 18	CF	12/8/2020	8:01:00 AM
BRTWD-2259	Classroom	1040	Room 18	DW	12/8/2020	8:01:00 AM
BRTWD-2260	Classroom	1041	Room 17	CF	12/8/2020	8:02:00 AM
BRTWD-2261	Classroom	1041	Room 17	DW	12/8/2020	8:02:00 AM
BRTWD-2262	Classroom	1043	Room 19	CF	12/8/2020	8:05:00 AM
BRTWD-2263	Classroom	1043	Room 19	DW	12/8/2020	8:05:00 AM
BRTWD-2264	Classroom	1044	Room 21	CF	12/8/2020	8:06:00 AM
BRTWD-2265	Classroom	1044	Room 21	DW	12/8/2020	8:06:00 AM
BRTWD-2266	Classroom	1045	Room 24	CF	12/8/2020	8:07:00 AM
BRTWD-2267	Classroom	1045	Room 24	DW	12/8/2020	8:07:00 AM

Building Address19 Hemlock Drive *Ayres McDonald 11/13/21*

Brentwood, NY 11717

062022878

Analysis Type: ELAP 200.5

Lab Rechecked:

Signature:

*12/8/20 3:20 PM*Samplers Name: *Ali Na Castelluzzo*Samplers Signature: *Ali Na Castelluzzo*JCB Project Manager: *Meghan Gwynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Hemlock Park Elementary School

HEM

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2268	Classroom	1046	Room 23	CF	12/8/2020	8:09:00 AM
BRTWD-2269	Classroom	1046	Room 23	DW	12/8/2020	8:09:00 AM
BRTWD-2270	Classroom	1047	Room 26	CF	12/8/2020	8:11:00 AM
BRTWD-2271	Classroom	1047	Room 26	DW	12/8/2020	8:11:00 AM
BRTWD-2272	Classroom	1048	Room 25	CF	12/8/2020	8:12:00 AM
BRTWD-2273	Classroom	1048	Room 25	DW	12/8/2020	8:12:00 AM
BRTWD-2274	Classroom	1049	Room 28	CF	12/8/2020	8:13:00 AM
BRTWD-2275	Classroom	1049	Room 28	DW	12/8/2020	8:13:00 AM
BRTWD-2276	Classroom	1050	Room 27	CF	12/8/2020	8:14:00 AM
BRTWD-2277	Classroom	1050	Room 27	DW	12/8/2020	8:14:00 AM
BRTWD-2278	Classroom	1052	Room 29	CF	12/8/2020	8:15:00 AM
BRTWD-2279	Classroom	1052	Room 29	DW	12/8/2020	8:15:00 AM
BRTWD-2280	Classroom	1051	Room 30	CF	12/8/2020	8:16:00 AM
BRTWD-2281	Classroom	1051	Room 30	DW	12/8/2020	8:16:00 AM
BRTWD-2282	Classroom	N/A	Room 31	CF	12/8/2020	8:18:00 AM
BRTWD-2283	Classroom	N/A	Room 31	DW	12/8/2020	8:18:00 AM
BRTWD-2284	Classroom	N/A	Room 32	CF	12/8/2020	8:20:00 AM
BRTWD-2285	Classroom	N/A	Room 32	DW	12/8/2020	8:20:00 AM

Building Address

19 Hemlock Drive

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Recieved:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

062022878

12/8/20 3:20pm



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Hemlock Park Elementary School

HEM

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal Lwk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2290	Hallway	N/A	Corridor Near Faculty Bathroom	WC	12/8/2020	8:22:00 AM
BRTWD-2291	Bathroom	N/A	Faculty Bathroom	BF	12/8/2020	8:23:00 AM
BRTWD-2294	Classroom	N/A	Room 33	CF	12/8/2020	8:24:00 AM
BRTWD-2295	Classroom	N/A	Room 33	DW	12/8/2020	8:24:00 AM
BRTWD-2296	Classroom	N/A	Room 35	DW	12/8/2020	8:26:00 AM
BRTWD-2297	Classroom	N/A	Room 35	CF	12/8/2020	8:26:00 AM
BRTWD-2298	Classroom	N/A	Room 34	CF	12/8/2020	8:27:00 AM
BRTWD-2299	Classroom	N/A	Room 34	DW	12/8/2020	8:27:00 AM
BRTWD-2300	Classroom	N/A	Room 37	DW	12/8/2020	8:29:00 AM
BRTWD-2301	Classroom	N/A	Room 37	CF	12/8/2020	8:29:00 AM
BRTWD-2302	Classroom	N/A	Room 36	CF	12/8/2020	8:30:00 AM
BRTWD-2303	Classroom	N/A	Room 36	DW	12/8/2020	8:30:00 AM
BRTWD-2304	Classroom	N/A	Room 39	DW	12/8/2020	8:31:00 AM
BRTWD-2305	Classroom	N/A	Room 39	CF	12/8/2020	8:31:00 AM
BRTWD-2306	Classroom	N/A	Room 38	CF	12/8/2020	8:32:00 AM
BRTWD-2307	Classroom	N/A	Room 38	DW	12/8/2020	8:32:00 AM
BRTWD-2308	Kitchen	1033	Kitchen	KC	12/8/2020	7:03:00 AM
BRTWD-2309	Kitchen	1033	Kitchen	KC	12/8/2020	7:03:00 AM

Building Address

19 Hemlock Drive *Aurora McDonald 11/18/21*
 Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

12/8/20 320PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

062022878



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Hemlock Park Elementary School

HEM

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2310	Kitchen	1033	Kitchen	HW	12/8/2020	7:07:00 AM
BRTWD-2311	Kitchen	1033	Kitchen	PK	12/8/2020	7:07:00 AM
BRTWD-2312	Kitchen	1033	Kitchen	KC	12/8/2020	7:08:00 AM
BRTWD-2313	Kitchen	1033	Kitchen	KC	12/8/2020	7:08:00 AM
BRTWD-2314	Kitchen	1033	Kitchen	KC	12/8/2020	7:08:00 AM
BRTWD-2315	Kitchen	1033	Kitchen	HW	12/8/2020	7:09:00 AM
BRTWD-2316	Bathroom	1033A	Kitchen Bathroom	BF	12/8/2020	7:10:00 AM
BRTWD-2992	BR	1029B	Boys Locker Room	BF	12/8/2020	7:56:00 AM

Samples Submitted 98

ANALYTICAL INC.
CARLE PLACE, NY
20 DEC - 8 PM 3:20

062022878

Building Address

19 Hemlock Drive

Brentwood, NY 11717

Alexander McDonald 11/18/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Michelle DeLuca
12/8/20 3:20pm

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alicia Castell 11/18/20
Alicia Castell
Meghan Gwinn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/8/2020. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District, Hemlock Park Elementary
School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY
11717

The reference number for these samples is EMSL Order #062022878. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2204 **Collected:** 12/8/2020 **Lab ID:** 062022878-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2205 **Collected:** 12/8/2020 **Lab ID:** 062022878-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2207 **Collected:** 12/8/2020 **Lab ID:** 062022878-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2208 **Collected:** 12/8/2020 **Lab ID:** 062022878-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2210 **Collected:** 12/8/2020 **Lab ID:** 062022878-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2211 **Collected:** 12/8/2020 **Lab ID:** 062022878-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2212 **Collected:** 12/8/2020 **Lab ID:** 062022878-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2213 **Collected:** 12/8/2020 **Lab ID:** 062022878-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2213 **Collected:** 12/8/2020 **Lab ID:** 062022878-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/13/2021	AM	1/15/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2214 **Collected:** 12/8/2020 **Lab ID:** 062022878-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2215 **Collected:** 12/8/2020 **Lab ID:** 062022878-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2216 **Collected:** 12/8/2020 **Lab ID:** 062022878-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2217 **Collected:** 12/8/2020 **Lab ID:** 062022878-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2218 **Collected:** 12/8/2020 **Lab ID:** 062022878-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2219 **Collected:** 12/8/2020 **Lab ID:** 062022878-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	1/13/2021	AM	1/15/2021	AL

Client Sample Description BRTWD-2220 **Collected:** 12/8/2020 **Lab ID:** 062022878-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description		BRTWD-2220		Collected:	12/8/2020	Lab ID:	062022878-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2021	AM	1/15/2021	AL
Client Sample Description		BRTWD-2221		Collected:	12/8/2020	Lab ID:	062022878-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2021	AM	1/15/2021	AL
Client Sample Description		BRTWD-2222		Collected:	12/8/2020	Lab ID:	062022878-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2021	AM	1/15/2021	AL
Client Sample Description		BRTWD-2223		Collected:	12/8/2020	Lab ID:	062022878-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2021	AM	1/15/2021	AL
Client Sample Description		BRTWD-2224		Collected:	12/8/2020	Lab ID:	062022878-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2021	AM	1/15/2021	AL
Client Sample Description		BRTWD-2225		Collected:	12/8/2020	Lab ID:	062022878-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0	µg/L	1/13/2021	AM	1/15/2021	AL
Client Sample Description		BRTWD-2226		Collected:	12/8/2020	Lab ID:	062022878-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2227		Collected:	12/8/2020	Lab ID:	062022878-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2227 **Collected:** 12/8/2020 **Lab ID:** 062022878-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2228 **Collected:** 12/8/2020 **Lab ID:** 062022878-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2229 **Collected:** 12/8/2020 **Lab ID:** 062022878-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2230 **Collected:** 12/8/2020 **Lab ID:** 062022878-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2231 **Collected:** 12/8/2020 **Lab ID:** 062022878-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2232 **Collected:** 12/8/2020 **Lab ID:** 062022878-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2233 **Collected:** 12/8/2020 **Lab ID:** 062022878-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2234 **Collected:** 12/8/2020 **Lab ID:** 062022878-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2234 **Collected:** 12/8/2020 **Lab ID:** 062022878-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/13/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2235 **Collected:** 12/8/2020 **Lab ID:** 062022878-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2236 **Collected:** 12/8/2020 **Lab ID:** 062022878-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2237 **Collected:** 12/8/2020 **Lab ID:** 062022878-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2238 **Collected:** 12/8/2020 **Lab ID:** 062022878-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2239 **Collected:** 12/8/2020 **Lab ID:** 062022878-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	180	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2240 **Collected:** 12/8/2020 **Lab ID:** 062022878-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/13/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2242 **Collected:** 12/8/2020 **Lab ID:** 062022878-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2243 **Collected:** 12/8/2020 **Lab ID:** 062022878-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2244 **Collected:** 12/8/2020 **Lab ID:** 062022878-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2245 **Collected:** 12/8/2020 **Lab ID:** 062022878-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2246 **Collected:** 12/8/2020 **Lab ID:** 062022878-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	1/13/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2247 **Collected:** 12/8/2020 **Lab ID:** 062022878-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2248 **Collected:** 12/8/2020 **Lab ID:** 062022878-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2249 **Collected:** 12/8/2020 **Lab ID:** 062022878-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description		BRTWD-2249	Collected:	12/8/2020	Lab ID:	062022878-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	130	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2250	Collected:	12/8/2020	Lab ID:	062022878-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2258	Collected:	12/8/2020	Lab ID:	062022878-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2259	Collected:	12/8/2020	Lab ID:	062022878-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2260	Collected:	12/8/2020	Lab ID:	062022878-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2261	Collected:	12/8/2020	Lab ID:	062022878-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2262	Collected:	12/8/2020	Lab ID:	062022878-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.8	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2263	Collected:	12/8/2020	Lab ID:	062022878-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2263 **Collected:** 12/8/2020 **Lab ID:** 062022878-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	88	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2264 **Collected:** 12/8/2020 **Lab ID:** 062022878-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2265 **Collected:** 12/8/2020 **Lab ID:** 062022878-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2266 **Collected:** 12/8/2020 **Lab ID:** 062022878-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2267 **Collected:** 12/8/2020 **Lab ID:** 062022878-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2268 **Collected:** 12/8/2020 **Lab ID:** 062022878-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2269 **Collected:** 12/8/2020 **Lab ID:** 062022878-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2270 **Collected:** 12/8/2020 **Lab ID:** 062022878-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2271 **Collected:** 12/8/2020 **Lab ID:** 062022878-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2272 **Collected:** 12/8/2020 **Lab ID:** 062022878-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2273 **Collected:** 12/8/2020 **Lab ID:** 062022878-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2274 **Collected:** 12/8/2020 **Lab ID:** 062022878-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2275 **Collected:** 12/8/2020 **Lab ID:** 062022878-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2276 **Collected:** 12/8/2020 **Lab ID:** 062022878-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2277 **Collected:** 12/8/2020 **Lab ID:** 062022878-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2278 **Collected:** 12/8/2020 **Lab ID:** 062022878-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2279 **Collected:** 12/8/2020 **Lab ID:** 062022878-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2280 **Collected:** 12/8/2020 **Lab ID:** 062022878-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2281 **Collected:** 12/8/2020 **Lab ID:** 062022878-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2282 **Collected:** 12/8/2020 **Lab ID:** 062022878-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2283 **Collected:** 12/8/2020 **Lab ID:** 062022878-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2284 **Collected:** 12/8/2020 **Lab ID:** 062022878-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2285 **Collected:** 12/8/2020 **Lab ID:** 062022878-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2290 **Collected:** 12/8/2020 **Lab ID:** 062022878-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2291 **Collected:** 12/8/2020 **Lab ID:** 062022878-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2294 **Collected:** 12/8/2020 **Lab ID:** 062022878-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2295 **Collected:** 12/8/2020 **Lab ID:** 062022878-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2296 **Collected:** 12/8/2020 **Lab ID:** 062022878-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2297 **Collected:** 12/8/2020 **Lab ID:** 062022878-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2297 **Collected:** 12/8/2020 **Lab ID:** 062022878-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2298 **Collected:** 12/8/2020 **Lab ID:** 062022878-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2299 **Collected:** 12/8/2020 **Lab ID:** 062022878-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2300 **Collected:** 12/8/2020 **Lab ID:** 062022878-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2301 **Collected:** 12/8/2020 **Lab ID:** 062022878-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2302 **Collected:** 12/8/2020 **Lab ID:** 062022878-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2303 **Collected:** 12/8/2020 **Lab ID:** 062022878-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2304 **Collected:** 12/8/2020 **Lab ID:** 062022878-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2304 **Collected:** 12/8/2020 **Lab ID:** 062022878-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2305 **Collected:** 12/8/2020 **Lab ID:** 062022878-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2306 **Collected:** 12/8/2020 **Lab ID:** 062022878-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2307 **Collected:** 12/8/2020 **Lab ID:** 062022878-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2308 **Collected:** 12/8/2020 **Lab ID:** 062022878-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2309 **Collected:** 12/8/2020 **Lab ID:** 062022878-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2310 **Collected:** 12/8/2020 **Lab ID:** 062022878-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2311 **Collected:** 12/8/2020 **Lab ID:** 062022878-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022878

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2020 03:20 PM
 Collected: 12/8/2020

Project: **Brentwood Union Free School District, Hemlock Park Elementary School, HEM, #:19-45270, 19 Hemlock Drive, Brentwood, NY 11717**

Analytical Results

Client Sample Description BRTWD-2311 **Collected:** 12/8/2020 **Lab ID:** 062022878-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2312 **Collected:** 12/8/2020 **Lab ID:** 062022878-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2313 **Collected:** 12/8/2020 **Lab ID:** 062022878-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2314 **Collected:** 12/8/2020 **Lab ID:** 062022878-0095

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2315 **Collected:** 12/8/2020 **Lab ID:** 062022878-0096

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2316 **Collected:** 12/8/2020 **Lab ID:** 062022878-0097

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2992 **Collected:** 12/8/2020 **Lab ID:** 062022878-0098

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062022878
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~49-45270~~ 21-48246
Building: Hemlock Park Elementary School
HEM

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2233	Classroom	1014	Room 13	DW	3/25/2021	7:41:00 AM
BRTWD-2235	Classroom	1015	Room 14	DW	3/25/2021	7:38:00 AM
BRTWD-2239	Classroom	1017	Room 16	DW	3/25/2021	7:36:00 AM
BRTWD-2259	Classroom	1040	Room 18	DW	3/25/2021	7:45:00 AM
BRTWD-2263	Classroom	1043	Room 19	DW	3/25/2021	7:51:00 AM
BRTWD-2283	Classroom	N/A	Room 31	DW	3/25/2021	7:53:00 AM

Samples Submitted 6

REVISED CoC RECEIVED 03/29/21.
-AL

062105335

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address
19 Hemlock Drive
Brentwood, NY 11717

Pb200.5 -

Alger Lantz 03/29/21

Analysis Type: ELAP 200.5 *AD*

Lab Reclosed: *Alger Lantz*

Signature: *Alger Lantz*

Samplers Name: *Enin Tadzia*

Samplers Signature: *Enin Tadzia*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/25/2021. The results are tabulated on the attached data pages for the following client designated project:

21-48246, Hemlock Park Elementary School, Brentwood Union
Free School District, 19 Hemlock Drive, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062105335. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 3/25/2021 09:20 AM
 Collected: 3/25/2021

Project: 21-48246, Hemlock Park Elementary School, Brentwood Union Free School District, 19 Hemlock Drive, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2233 **Collected:** 3/25/2021 **Lab ID:** 062105335-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Client Sample Description BRTWD-2235 **Collected:** 3/25/2021 **Lab ID:** 062105335-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	42	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Client Sample Description BRTWD-2239 **Collected:** 3/25/2021 **Lab ID:** 062105335-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Client Sample Description BRTWD-2259 **Collected:** 3/25/2021 **Lab ID:** 062105335-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Client Sample Description BRTWD-2263 **Collected:** 3/25/2021 **Lab ID:** 062105335-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Client Sample Description BRTWD-2283 **Collected:** 3/25/2021 **Lab ID:** 062105335-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Lead MDL: 1.0µg/L

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Hemlock Park Elementary School

HEM

062110637

Client:

Brentwood Union Free School District

Retest New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2214	Bathroom	1004B	Room 4 Bathroom	BF	6/17/2021	7:39:00 AM
BRTWD-2232	Classroom	1014	Room 13	CF	6/17/2021	7:40:00 AM
BRTWD-2258	Classroom	1040	Room 18	CF	6/17/2021	7:42:00 AM
BRTWD-2260	Classroom	1041	Room 17	CF	6/17/2021	7:43:00 AM
BRTWD-2274	Classroom	1049	Room 28	CF	6/17/2021	7:45:00 AM

Samples Submitted 5

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4: 06

Building Address

19 Hemlock Drive

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Samplers Name: *Alexandria Orlassino*

Samplers Signature: *A Orlassino*

JCB Project Manager *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Hemlock Park Elementary School, Brentwood Union
Free School District, 19 Hemlock Drive, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110637. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110637

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 06/17/21 4:06 PM
 Collected: 6/17/2021

Project: #21-48246, Hemlock Park Elementary School, Brentwood Union Free School District, 19 Hemlock Drive, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2214 **Collected:** 6/17/2021 **Lab ID:** 062110637-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2232 **Collected:** 6/17/2021 **Lab ID:** 062110637-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2258 **Collected:** 6/17/2021 **Lab ID:** 062110637-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2260 **Collected:** 6/17/2021 **Lab ID:** 062110637-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	39	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2274 **Collected:** 6/17/2021 **Lab ID:** 062110637-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Hemlock Park Elementary School

HEM

062218238

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2214	Bathroom	1004B	Room 4 Bathroom	BF	8/23/2022	8:39:00 AM
BRTWD-2235	Classroom	1015	Room 14	DW	8/23/2022	8:38:00 AM
BRTWD-2260	Classroom	1041	Room 17	CF	8/23/2022	8:35:00 AM
BRTWD-2263	Classroom	1043	Room 19	DW	8/23/2022	8:34:00 AM

Samples Submitted 4

P/L - 200.5
8/29/22

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 23 P 12:24

Courier

Building Address

19 Hemlock Drive

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Recieved: 8/23/22 @ 12:24pm

Signature:

Samplers Name: Meghan Gwynn

Samplers Signature:

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/23/2022. The results are tabulated on the attached data pages for the following client designated project:

**JCB #: 21-48246, Hemlock Park Elementary School, HEM,
Brentwood Union Free School District, 19 Hemlock Drive, Bay
Shore, NY 11706**

The reference number for these samples is EMSL Order #062218238. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218238

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/23/2022 12:24 PM
Collected: 8/23/2022

Project: JCB #: 21-48246, Hemlock Park Elementary School, HEM, Brentwood Union Free School District, 19 Hemlock Drive, Bay Shore, NY

Analytical Results

Client Sample Description BRTWD-2214 **Collected:** 8/23/2022 **Lab ID:** 062218238-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-2235 **Collected:** 8/23/2022 **Lab ID:** 062218238-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-2260 **Collected:** 8/23/2022 **Lab ID:** 062218238-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-2263 **Collected:** 8/23/2022 **Lab ID:** 062218238-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Hemlock Park Elementary School

HEM

062225147

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3079	HA	1054	Corridor Kitchen To Main Lobby	WC	12/8/2022	7:24:00 AM
BRTWD-3080	HA	1054	Corridor Kitchen To Main Lobby	WF	12/8/2022	7:25:00 AM
BRTWD-3081	HA	1054	Corridor Kitchen To Main Lobby	WC	12/8/2022	7:26:00 AM
BRTWD-3082	HA	1054	Corridor Kitchen To Main Lobby	WF	12/8/2022	7:27:00 AM

Samples Submitted 4

P6 200.5

Bernie AR Jr 12/10/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC - 8 P 4:42

Building Address

19 Hemlock Drive

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Alex Kasch / 12/8/22

4:42 PM

Samplers Name: Aileen McNamara

Samplers Signature: Aileen McNamara

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/12/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/8/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Hemlock School, Brentwood Union Free School
District, 19 Hemlock Drive, Bay Shore NY 11706

The reference number for these samples is EMSL Order #062225147. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225147

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2022 04:42 PM
 Collected: 12/8/2022

Project: #: 22-53405, Hemlock School, Brentwood Union Free School District, 19 Hemlock Drive, Bay Shore NY 11706

Analytical Results

Client Sample Description BRTWD-3079 **Collected:** 12/8/2022 **Lab ID:** 062225147-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<6.0 ND	6.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3080 **Collected:** 12/8/2022 **Lab ID:** 062225147-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3081 **Collected:** 12/8/2022 **Lab ID:** 062225147-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-3082 **Collected:** 12/8/2022 **Lab ID:** 062225147-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Instructional Media Center

IMC

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1652	Hallway	N/A	Corridor Near Room 43	WC	12/16/2020	6:35:00 AM

Samples Submitted 1

20 DEC 16 PM 4:54
INSTRUCTIONAL
MATERIALS
CARTAGE PLACE, NY
6

Building Address

33 Leahy Avenue

Brentwood, NY 11717

Pb200.5 -
A. Lamy
12/22/20

Analysis Type: ELAP 200.5 *AD*

Lab Received: *Unique McKay*

Signature: *Wm 12/16/20 @ 4:54 AM*

Samplers Name: *Meghan Gwynn*

Samplers Signature: *Meghan Gwynn*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/16/2020. The results are tabulated on the attached data pages for the following client designated project:

Instructional Media Center, 33 Leahy Avenue, Brentwood, NY
11717, Brentwood Union Free School District, 19-45270

The reference number for these samples is EMSL Order #062023546. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023546

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/16/2020 04:54 PM
Collected: 12/16/2020

Project: Instructional Media Center, 33 Leahy Avenue, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-1652 **Collected:** 12/16/2020 6:35:00 AM **Lab ID:** 062023546-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062022031 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Laurel Park Elementary School

LAUR

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 5

OrderID: 062022031

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2441	Bathroom	1001A	Room 1A Bathroom	BF	11/24/2020	6:02:00 AM
BRTWD-2442	Bathroom	1002A	Room 2A Bathroom	BF	11/24/2020	6:03:00 AM
BRTWD-2443	Classroom	1003	Room 1	CF	11/24/2020	6:04:00 AM
BRTWD-2445	Bathroom	1003B	Room 1 Bathroom	BF	11/24/2020	6:05:00 AM
BRTWD-2446	Classroom	1004	Room 2	CF	11/24/2020	6:06:00 AM
BRTWD-2447	Classroom	1004	Room 2	DW	11/24/2020	6:06:00 AM
BRTWD-2449	Classroom	1006	Room 4	CF	11/24/2020	6:08:00 AM
BRTWD-2450	Classroom	1006	Room 4	DW	11/24/2020	6:08:00 AM
BRTWD-2451	Classroom	1007	Room 3	CF	11/24/2020	6:09:00 AM
BRTWD-2452	Classroom	1007	Room 3	DW	11/24/2020	6:09:00 AM
BRTWD-2453	Bathroom	1007B	Room 3 Bathroom	BF	11/24/2020	6:11:00 AM
BRTWD-2454	Classroom	1008	Room 6	CF	11/24/2020	6:12:00 AM
BRTWD-2455	Classroom	1008	Room 6	DW	11/24/2020	6:12:00 AM
BRTWD-2456	Classroom	1010	Room 5	CF	11/24/2020	6:13:00 AM
BRTWD-2457	Classroom	1010	Room 5	DW	11/24/2020	6:13:00 AM
BRTWD-2458	Bathroom	1010B	Room 5 Bathroom	BF	11/24/2020	6:14:00 AM
BRTWD-2459	Classroom	1011	Room 8	CF	11/24/2020	6:15:00 AM
BRTWD-2460	Classroom	1011	Room 8	DW	11/24/2020	6:15:00 AM

Building Address

48 Swan Lane

Brentwood, NY 11717

Pb200.5 -

A. Lunny 01/02/21

Analysis Type: ELAP 200.5 AD

Lab Received: Unique Mera

Signature: um 11/24/20 @ 12:42 pm

Samplers Name: Alina Gwyll

Samplers Signature: Alina Gwyll

JCB Project Manager: Meghan Gwyll



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Laurel Park Elementary School

LAUR

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 2 of 5

OrderID: 062022031

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2461	Classroom	1012	Room 7	CF	11/24/2020	6:17:00 AM
BRTWD-2462	Classroom	1012	Room 7	DW	11/24/2020	6:17:00 AM
BRTWD-2463	Classroom	1013	Room 10	CF	11/24/2020	6:19:00 AM
BRTWD-2464	Classroom	1013	Room 10	DW	11/24/2020	6:19:00 AM
BRTWD-2465	Classroom	1014	Room 9	CF	11/24/2020	6:20:00 AM
BRTWD-2466	Classroom	1014	Room 9	DW	11/24/2020	6:20:00 AM
BRTWD-2467	Classroom	1015	Room 12	CF	11/24/2020	6:22:00 AM
BRTWD-2468	Classroom	1015	Room 12	DW	11/24/2020	6:22:00 AM
BRTWD-2469	Classroom	1016	Room 11	CF	11/24/2020	6:23:00 AM
BRTWD-2470	Classroom	1016	Room 11	DW	11/24/2020	6:23:00 AM
BRTWD-2471	Classroom	1017	Room 14	CF	11/24/2020	6:25:00 AM
BRTWD-2472	Classroom	1017	Room 14	DW	11/24/2020	6:25:00 AM
BRTWD-2473	Classroom	1018	Room 13	CF	11/24/2020	6:26:00 AM
BRTWD-2474	Classroom	1018	Room 13	DW	11/24/2020	6:26:00 AM
BRTWD-2475	Classroom	1019	Room 16	CF	11/24/2020	6:27:00 AM
BRTWD-2476	Classroom	1019	Room 16	DW	11/24/2020	6:27:00 AM
BRTWD-2477	Classroom	1020	Room 15	CF	11/24/2020	6:29:00 AM
BRTWD-2478	Classroom	1020	Room 15	DW	11/24/2020	6:29:00 AM

Building Address

48 Swan Lane

Brentwood, NY 11717

PB 200.5 -

A. Lung 01/08/21

Analysis Type: ELAP 200.5 AL

Lab Received: Unique Mear

Signature: um 11/24/2020 12:42pm

Samplers Name: Arlina Gossy 11/23/20

Samplers Signature: Arlina Gossy

JCB Project Manager: Meghan Gwynn



062022031 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Laurel Park Elementary School
LAUR

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Page 3 of 5

OrderID: 062022031

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2479	Bathroom	1026	Men's Bathroom	BF	11/24/2020	6:32:00 AM
BRTWD-2480	Bathroom	1026	Men's Bathroom	BF	11/24/2020	6:32:00 AM
BRTWD-2482	Bathroom	1028	Women's Bathroom	BF	11/24/2020	6:34:00 AM
BRTWD-2483	Bathroom	1028	Women's Bathroom	BF	11/24/2020	6:34:00 AM
BRTWD-2484	Bathroom	1031C1	Girls Locker Room Bathroom	BF	11/24/2020	6:35:00 AM
BRTWD-2485	Nurse Office	1029	Nurse's Office	NS	11/24/2020	6:40:00 AM
BRTWD-2486	Bathroom	1029A	Nurse's Office Bathroom	BF	11/24/2020	6:40:00 AM
BRTWD-2487	Office	1030A	Speech Therapist Office	CF	11/24/2020	6:40:00 AM
BRTWD-2488	Hallway	1040	Corridor Near Gymnasium (1031B)	WC	11/24/2020	6:41:00 AM
BRTWD-2489	Faculty Lounge	1035	Faculty Room	CF	11/24/2020	6:53:00 AM
BRTWD-2491	Hallway	1040	Corridor Near Kitchen (1038)	DW	11/24/2020	6:55:00 AM
BRTWD-2492	Hallway	1040	Corridor Near Kitchen (1038)	WF	11/24/2020	6:55:00 AM
BRTWD-2493	Kitchen	1038	Kitchen	KC	11/24/2020	5:52:00 AM
BRTWD-2494	Kitchen	1038	Kitchen	KC	11/24/2020	5:52:00 AM
BRTWD-2495	Kitchen	1038	Kitchen	PK	11/24/2020	5:53:00 AM
BRTWD-2496	Kitchen	1038	Kitchen	HW	11/24/2020	5:53:00 AM
BRTWD-2497	Kitchen	1038	Kitchen	KC	11/24/2020	5:54:00 AM
BRTWD-2498	Kitchen	1038	Kitchen	SN	11/24/2020	5:54:00 AM

Building Address

48 Swan Lane
Brentwood, NY 11717

Pb 200.5 -
A. Lunny 01/08/21

Analysis Type: ELAP 200.5 ④

Lab Received: Unique Mccoy

Signature: Lum 11/24/20 @ 12:42 PM

Samplers Name: Alina Coste 11/22/20

Samplers Signature: Alina Coste

JCB Project Manager: Meghan Gwynn



062022031 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Laurel Park Elementary School
LAUR

Client:
Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Page 4 of 5

OrderID: 062022031

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2499	Kitchen	1038	Kitchen	KC	11/24/2020	5:56:00 AM
BRTWD-2500	Kitchen	1038	Kitchen	KC	11/24/2020	5:56:00 AM
BRTWD-2501	Kitchen	1038	Kitchen	HW	11/24/2020	5:57:00 AM
BRTWD-2502	Bathroom	1038A1	Kitchen Bathroom	BF	11/24/2020	5:58:00 AM
BRTWD-2504	Classroom	1041	Room 20	CF	11/24/2020	6:59:00 AM
BRTWD-2505	Classroom	1041	Room 20	DW	11/24/2020	6:59:00 AM
BRTWD-2513	Classroom	1047	Room 17	CF	11/24/2020	7:01:00 AM
BRTWD-2514	Classroom	1047	Room 17	DW	11/24/2020	7:01:00 AM
BRTWD-2515	Classroom	1048	Room 19	CF	11/24/2020	7:03:00 AM
BRTWD-2517	Classroom	1049	Room 22	CF	11/24/2020	7:05:00 AM
BRTWD-2519	Classroom	1051	Room 24	CF	11/24/2020	7:09:00 AM
BRTWD-2520	Classroom	1051	Room 24	DW	11/24/2020	7:09:00 AM
BRTWD-2521	Classroom	1052	Room 23	CF	11/24/2020	7:11:00 AM
BRTWD-2522	Classroom	1052	Room 23	DW	11/24/2020	7:11:00 AM
BRTWD-2523	Classroom	1053	Room 26	CF	11/24/2020	7:13:00 AM
BRTWD-2524	Classroom	1053	Room 26	DW	11/24/2020	7:13:00 AM
BRTWD-2525	Classroom	1054	Room 25	CF	11/24/2020	7:15:00 AM
BRTWD-2526	Classroom	1054	Room 25	DW	11/24/2020	7:15:00 AM

Building Address

48 Swan Lane

Brentwood, NY 11717

Pb200.5 -

A-Lang 01/08/21

Analysis Type: ELAP 200.5 (A1)

Lab Received: Unique Maxay

Signature: um 11/24/2020 12:42pm

Samplers Name: Ailing Castaño 11/23/20

Samplers Signature: alivia Castaño

JCB Project Manager: Meghan Gwynn



062022031 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Laurel Park Elementary School
LAUR

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2527	Classroom	1055	Room 28	CF	11/24/2020	7:16:00 AM
BRTWD-2528	Classroom	1055	Room 28	DW	11/24/2020	7:17:00 AM
BRTWD-2529	Classroom	1056	Room 27	CF	11/24/2020	7:18:00 AM
BRTWD-2530	Classroom	1056	Room 27	DW	11/24/2020	7:18:00 AM
BRTWD-2531	Classroom	1057	Room 30	CF	11/24/2020	7:20:00 AM
BRTWD-2532	Classroom	1057	Room 30	DW	11/24/2020	7:20:00 AM
BRTWD-2533	Classroom	1058	Room 29	CF	11/24/2020	7:21:00 AM
BRTWD-2534	Classroom	1058	Room 29	DW	11/24/2020	7:21:00 AM
BRTWD-2535	Classroom	N/A	Room 31	CF	11/24/2020	7:24:00 AM
BRTWD-2536	Classroom	N/A	Room 31	DW	11/24/2020	7:24:00 AM
BRTWD-2537	Classroom	N/A	Room 34	DW	11/24/2020	7:26:00 AM
BRTWD-2538	Classroom	N/A	Room 34	CF	11/24/2020	7:26:00 AM
BRTWD-2987	BR	1034A1	Stage Boys Locker Room Bathroom	BF	11/24/2020	6:51:00 AM

Samples Submitted 85

11/24 PM 12:42
JCB, INC.
PLAICE, NY

Building Address

48 Swan Lane

Brentwood, NY 11717

ELAP 200.5 -

A. Lamy 01/09/21

Analysis Type: ELAP 200.5 AI

Lab Received: Unique Mercury

Signature: um 11/24/2020 12:42pm

Samplers Name:

Alexia Costa 01/11/22

Samplers Signature:

Alexia Costa

JCB Project Manager:

Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/24/2020. The results are tabulated on the attached data pages for the following client designated project:

Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY
11717, Brentwood Union Free School District, # 19-45270

The reference number for these samples is EMSL Order #062022031. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2441 **Collected:** 11/24/2020 **Lab ID:** 062022031-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2442 **Collected:** 11/24/2020 **Lab ID:** 062022031-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2443 **Collected:** 11/24/2020 **Lab ID:** 062022031-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2445 **Collected:** 11/24/2020 **Lab ID:** 062022031-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2446 **Collected:** 11/24/2020 **Lab ID:** 062022031-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2447 **Collected:** 11/24/2020 **Lab ID:** 062022031-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2449 **Collected:** 11/24/2020 **Lab ID:** 062022031-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2450		Collected:	11/24/2020	Lab ID:	062022031-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2451		Collected:	11/24/2020	Lab ID:	062022031-0009	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2452		Collected:	11/24/2020	Lab ID:	062022031-0010	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2453		Collected:	11/24/2020	Lab ID:	062022031-0011	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	27	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2454		Collected:	11/24/2020	Lab ID:	062022031-0012	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2455		Collected:	11/24/2020	Lab ID:	062022031-0013	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2456		Collected:	11/24/2020	Lab ID:	062022031-0014	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2457		Collected:	11/24/2020	Lab ID:	062022031-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2457		Collected:	11/24/2020	Lab ID:	062022031-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	86	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2458		Collected:	11/24/2020	Lab ID:	062022031-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2459		Collected:	11/24/2020	Lab ID:	062022031-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2460		Collected:	11/24/2020	Lab ID:	062022031-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.5	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2461		Collected:	11/24/2020	Lab ID:	062022031-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2462		Collected:	11/24/2020	Lab ID:	062022031-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.4	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2463		Collected:	11/24/2020	Lab ID:	062022031-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2464		Collected:	11/24/2020	Lab ID:	062022031-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2464 **Collected:** 11/24/2020 **Lab ID:** 062022031-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2465 **Collected:** 11/24/2020 **Lab ID:** 062022031-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2466 **Collected:** 11/24/2020 **Lab ID:** 062022031-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2467 **Collected:** 11/24/2020 **Lab ID:** 062022031-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.5	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2468 **Collected:** 11/24/2020 **Lab ID:** 062022031-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	59	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2469 **Collected:** 11/24/2020 **Lab ID:** 062022031-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	32	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2470 **Collected:** 11/24/2020 **Lab ID:** 062022031-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2471 **Collected:** 11/24/2020 **Lab ID:** 062022031-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2471 **Collected:** 11/24/2020 **Lab ID:** 062022031-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2472 **Collected:** 11/24/2020 **Lab ID:** 062022031-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2473 **Collected:** 11/24/2020 **Lab ID:** 062022031-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2474 **Collected:** 11/24/2020 **Lab ID:** 062022031-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2475 **Collected:** 11/24/2020 **Lab ID:** 062022031-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2476 **Collected:** 11/24/2020 **Lab ID:** 062022031-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	350	6.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2477 **Collected:** 11/24/2020 **Lab ID:** 062022031-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2478 **Collected:** 11/24/2020 **Lab ID:** 062022031-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2478 **Collected:** 11/24/2020 **Lab ID:** 062022031-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2479 **Collected:** 11/24/2020 **Lab ID:** 062022031-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.1	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2480 **Collected:** 11/24/2020 **Lab ID:** 062022031-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2482 **Collected:** 11/24/2020 **Lab ID:** 062022031-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2483 **Collected:** 11/24/2020 **Lab ID:** 062022031-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2484 **Collected:** 11/24/2020 **Lab ID:** 062022031-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2485 **Collected:** 11/24/2020 **Lab ID:** 062022031-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2486 **Collected:** 11/24/2020 **Lab ID:** 062022031-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2486 **Collected:** 11/24/2020 **Lab ID:** 062022031-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2487 **Collected:** 11/24/2020 **Lab ID:** 062022031-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2488 **Collected:** 11/24/2020 **Lab ID:** 062022031-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.3	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2489 **Collected:** 11/24/2020 **Lab ID:** 062022031-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2491 **Collected:** 11/24/2020 **Lab ID:** 062022031-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2492 **Collected:** 11/24/2020 **Lab ID:** 062022031-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.6	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2493 **Collected:** 11/24/2020 **Lab ID:** 062022031-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2494 **Collected:** 11/24/2020 **Lab ID:** 062022031-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2494 **Collected:** 11/24/2020 **Lab ID:** 062022031-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2495 **Collected:** 11/24/2020 **Lab ID:** 062022031-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2496 **Collected:** 11/24/2020 **Lab ID:** 062022031-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2497 **Collected:** 11/24/2020 **Lab ID:** 062022031-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2498 **Collected:** 11/24/2020 **Lab ID:** 062022031-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2499 **Collected:** 11/24/2020 **Lab ID:** 062022031-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2500 **Collected:** 11/24/2020 **Lab ID:** 062022031-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2501		Collected:	11/24/2020	Lab ID:	062022031-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	59	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2502		Collected:	11/24/2020	Lab ID:	062022031-0058	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2504		Collected:	11/24/2020	Lab ID:	062022031-0059	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2505		Collected:	11/24/2020	Lab ID:	062022031-0060	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2513		Collected:	11/24/2020	Lab ID:	062022031-0061	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2514		Collected:	11/24/2020	Lab ID:	062022031-0062	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2515		Collected:	11/24/2020	Lab ID:	062022031-0063	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2517		Collected:	11/24/2020	Lab ID:	062022031-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2517 **Collected:** 11/24/2020 **Lab ID:** 062022031-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2519 **Collected:** 11/24/2020 **Lab ID:** 062022031-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2520 **Collected:** 11/24/2020 **Lab ID:** 062022031-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2521 **Collected:** 11/24/2020 **Lab ID:** 062022031-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2522 **Collected:** 11/24/2020 **Lab ID:** 062022031-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2523 **Collected:** 11/24/2020 **Lab ID:** 062022031-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.5	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2524 **Collected:** 11/24/2020 **Lab ID:** 062022031-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2525 **Collected:** 11/24/2020 **Lab ID:** 062022031-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2525 **Collected:** 11/24/2020 **Lab ID:** 062022031-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2526 **Collected:** 11/24/2020 **Lab ID:** 062022031-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	48	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2527 **Collected:** 11/24/2020 **Lab ID:** 062022031-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2528 **Collected:** 11/24/2020 **Lab ID:** 062022031-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2529 **Collected:** 11/24/2020 **Lab ID:** 062022031-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2530 **Collected:** 11/24/2020 **Lab ID:** 062022031-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	160	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2531 **Collected:** 11/24/2020 **Lab ID:** 062022031-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Client Sample Description BRTWD-2532 **Collected:** 11/24/2020 **Lab ID:** 062022031-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/24/2020 12:42 PM
 Collected: 11/24/2020

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2532		Collected:	11/24/2020	Lab ID:	062022031-0078	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	290	6.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2533		Collected:	11/24/2020	Lab ID:	062022031-0079	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	43	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2534		Collected:	11/24/2020	Lab ID:	062022031-0080	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2535		Collected:	11/24/2020	Lab ID:	062022031-0081	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2536		Collected:	11/24/2020	Lab ID:	062022031-0082	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2537		Collected:	11/24/2020	Lab ID:	062022031-0083	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Client Sample Description		BRTWD-2538		Collected:	11/24/2020	Lab ID:	062022031-0084	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	1/4/2021	AM	1/5/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2987		Collected:	11/24/2020	Lab ID:	062022031-0085	

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022031

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/24/2020 12:42 PM
Collected: 11/24/2020

Project: Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270

Analytical Results

Client Sample Description BRTWD-2987 **Collected:** 11/24/2020 **Lab ID:** 062022031-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	1/4/2021	AM	1/5/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062105798

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 10-46270 21-48246

Building: Laurel Park Elementary School

LAUR

Client:

Brentwood Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2447	Classroom	1004	Room 2	DW	3/26/2021	6:44:00 AM
BRTWD-2457	Classroom	1010	Room 5	DW	3/26/2021	6:42:00 AM
BRTWD-2466	Classroom	1014	Room 9	DW	3/26/2021	6:39:00 AM
BRTWD-2468	Classroom	1015	Room 12	DW	3/26/2021	6:37:00 AM
BRTWD-2470	Classroom	1016	Room 11	DW	3/26/2021	6:35:00 AM
BRTWD-2476	Classroom	1019	Room 16	DW	3/26/2021	6:32:00 AM
BRTWD-2530	Classroom	1056	Room 27	DW	3/26/2021	6:48:00 AM
BRTWD-2532	Classroom	1057	Room 30	DW	3/26/2021	6:52:00 AM
BRTWD-2534	Classroom	1058	Room 29	DW	3/26/2021	6:50:00 AM

Samples Submitted 9

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address

48 Swan Lane

Brentwood, NY 11717

Pb200.5 -

Allyn Lunny 04/02/21

Analysis Type: ELAP 200.5 (AL)

Lab Received: *Unique McKeon*Signature: *WM 3/27/21 3:25 PM*Samplers Name: *Erin Todzia*Samplers Signature: *A. Todzia*JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/27/2021. The results are tabulated on the attached data pages for the following client designated project:

Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY
11717, Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062105798. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105798

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 3/27/2021 03:25 PM
 Collected: 3/26/2021

Project: **Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-2447
Room 2
Collected: 3/26/2021
Lab ID: 062105798-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2457
Room 5
Collected: 3/26/2021
Lab ID: 062105798-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	22	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2466
Room 9
Collected: 3/26/2021
Lab ID: 062105798-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2468
Room 12
Collected: 3/26/2021
Lab ID: 062105798-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.9	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2470
Room 11
Collected: 3/26/2021
Lab ID: 062105798-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2476
Room 16
Collected: 3/26/2021
Lab ID: 062105798-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Client Sample Description BRTWD-2530
Room 27
Collected: 3/26/2021
Lab ID: 062105798-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2532
Room 30
Collected: 3/26/2021
Lab ID: 062105798-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105798

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/27/2021 03:25 PM
Collected: 3/26/2021

Project: Laurel Park Elementary School, 48 Swan Lane, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246

Analytical Results

Client Sample Description BRTWD-2532 **Collected:** 3/26/2021 **Lab ID:** 062105798-0008
Room 30

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	4/1/2021	DI	4/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2534 **Collected:** 3/26/2021 **Lab ID:** 062105798-0009
Room 29

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Laurel Park Elementary School

LAUR

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2453	Bathroom	1007B	Room 3 Bathroom	BF	5/5/2021	7:35:00 AM
BRTWD-2454	Classroom	1008	Room 6	CF	5/5/2021	7:37:00 AM
BRTWD-2469	Classroom	1016	Room 11	CF	5/5/2021	7:39:00 AM
BRTWD-2513	Classroom	1047	Room 17	CF	5/5/2021	7:41:00 AM
BRTWD-2526	Classroom	1054	Room 25	DW	5/5/2021	7:43:00 AM
BRTWD-2531	Classroom	1057	Room 30	CF	5/5/2021	7:45:00 AM
BRTWD-2533	Classroom	1058	Room 29	CF	5/5/2021	7:47:00 AM

Samples Submitted 7

062107995

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 5 PM 4:39

Building Address

48 Swan Lane

Brentwood, NY 11717

Pb 200.5

A. Gwynn 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/11/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/5/2021. The results are tabulated on the attached data pages for the following client designated project:

**19-45270, Laurel Park Elementary School, Brentwood Union Free
School District, 48 Swan Lane, Brentwood , NY 11717**

The reference number for these samples is EMSL Order #062107995. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107995

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 05/05/21 4:39 PM
 Collected: 5/5/2021

Project: 19-45270, Laurel Park Elementary School, Brentwood Union Free School District, 48 Swan Lane, Brentwood , NY 11717

Analytical Results

Client Sample Description BRTWD-2453 **Collected:** 5/5/2021 **Lab ID:** 062107995-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	5/7/2021	AM	5/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2454 **Collected:** 5/5/2021 **Lab ID:** 062107995-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-2469 **Collected:** 5/5/2021 **Lab ID:** 062107995-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-2513 **Collected:** 5/5/2021 **Lab ID:** 062107995-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-2526 **Collected:** 5/5/2021 **Lab ID:** 062107995-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-2531 **Collected:** 5/5/2021 **Lab ID:** 062107995-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-2533 **Collected:** 5/5/2021 **Lab ID:** 062107995-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	94	3.0 µg/L	5/7/2021	AM	5/10/2021	AL



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062107995
CustomerID: JCBR50
CustomerPO:
ProjectID:

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~48-45270~~ 21-48246

Building: Laurel Park Elementary School

LAUR

062110613

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2501	Kitchen	1038	Kitchen	HW	6/16/2021	7:19:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 P 3:13

Building Address

48 Swan Lane

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: Alyssa McDonald

Signature: Alyssa McDonald

Samplers Name: Aisha Castelli

Samplers Signature: Aisha Castelli

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Laurel Park Elementary School, Brentwood Union
Free School District, 48 Swan Lane, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110613. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110613

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/16/21 3:13 PM
Collected: 6/16/2021

Project: #21-48246, Laurel Park Elementary School, Brentwood Union Free School District, 48 Swan Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2501 **Collected:** 6/16/2021 **Lab ID:** 062110613-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

21-48246

Building: Laurel Park Elementary School

LAUR

062 218358

Client:

Brentwood Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2454	Classroom	1008	Room 6	CF	8/24/2022	7:11:00 AM
BRTWD-2457	Classroom	1010	Room 5	DW	8/24/2022	7:14:00 AM
BRTWD-2526	Classroom	1054	Room 25	DW	8/24/2022	7:17:00 AM
BRTWD-2533	Classroom	1058	Room 29	CF	8/24/2022	7:28:00 AM

Samples Submitted 4

Pb 200.5
8/29/22

RECEIVED
EHSL ANALYTICAL INC.
CARLE PLACE, NY
2022 AUG 24 P 5:27



Building Address

48 Swan Lane

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Alex Hoshaw 8/24/22

5:27 PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

Lon Michalowski

Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 21-48246, Laurel Park Elementary School, Brentwood Union
Free School District, 48 Swan Lane, Brentwood NY 11717

The reference number for these samples is EMSL Order #062218358. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218358

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/24/2022 05:27 PM
Collected: 8/24/2022

Project: #: 21-48246, Laurel Park Elementary School, Brentwood Union Free School District, 48 Swan Lane, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-2454 **Collected:** 8/24/2022 **Lab ID:** 062218358-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.6	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-2457 **Collected:** 8/24/2022 **Lab ID:** 062218358-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-2526 **Collected:** 8/24/2022 **Lab ID:** 062218358-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-2533 **Collected:** 8/24/2022 **Lab ID:** 062218358-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	99	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Laurel Park Elementary School

LAUR

062225059



Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3059	HA	1040	Corridor Main Office To Receiving Room	WC	12/7/2022	6:59:00 AM
BRTWD-3060	HA	1040	Corridor Main Office To Receiving Room	WF	12/7/2022	7:05:00 AM
BRTWD-3061	HA	1040	Corridor Main Office To Receiving Room	WC	12/7/2022	7:02:00 AM
BRTWD-3062	HA	1040	Corridor Main Office To Receiving Room	WF	12/7/2022	7:03:00 AM

Samples Submitted 4

Pb 200.5

Bernu AKtr 12/8/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC -7 P 2:41

Building Address

48 Swan Lane

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Alex Kahn / 12/11/22

2:41 PM

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/8/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/7/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Laurel Park Elementary School, Brentwood Union
Free School District, 48 Swan Lane, Brentwood NY 11717

The reference number for these samples is EMSL Order #062225059. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225059

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2022 02:41 PM
 Collected: 12/7/2022

Project: #: 22-53405, Laurel Park Elementary School, Brentwood Union Free School District, 48 Swan Lane, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3059 **Collected:** 12/7/2022 **Lab ID:** 062225059-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3060 **Collected:** 12/7/2022 **Lab ID:** 062225059-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	12/8/2022	BA	12/8/2022	BA
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-3061 **Collected:** 12/7/2022 **Lab ID:** 062225059-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	12/8/2022	BA	12/8/2022	BA
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-3062 **Collected:** 12/7/2022 **Lab ID:** 062225059-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062022106 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Loretta Park Elementary School
LORE

Client:
Brentwood Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2328	Classroom	N/A	Room 5A	DW	11/25/2020	5:54:00 AM
BRTWD-2329	Classroom	N/A	Room 5A	CF	11/25/2020	5:54:00 AM
BRTWD-2330	Classroom	N/A	Room 6A	CF	11/25/2020	5:55:00 AM
BRTWD-2331	Classroom	N/A	Room 6A	DW	11/25/2020	5:55:00 AM
BRTWD-2332	Classroom	N/A	Room 4A	CF	11/25/2020	5:57:00 AM
BRTWD-2333	Classroom	N/A	Room 4A	DW	11/25/2020	5:57:00 AM
BRTWD-2335	Classroom	N/A	Room 3A	CF	11/25/2020	5:58:00 AM
BRTWD-2336	Classroom	N/A	Room 2A	CF	11/25/2020	6:00:00 AM
BRTWD-2337	Classroom	N/A	Room 2A	DW	11/25/2020	6:00:00 AM
BRTWD-2338	Classroom	N/A	Room 1A	DW	11/25/2020	6:01:00 AM
BRTWD-2339	Classroom	N/A	Room 1A	CF	11/25/2020	6:01:00 AM
BRTWD-2344	Hallway	N/A	Corridor Near Faculty Bathroom	WC	11/25/2020	6:02:00 AM
BRTWD-2345	Bathroom	N/A	Faculty Bathroom	BF	11/25/2020	6:03:00 AM
BRTWD-2348	Classroom	1000	Room 1	CF	11/25/2020	6:06:00 AM
BRTWD-2349	Classroom	1000	Room 1	DW	11/25/2020	6:06:00 AM
BRTWD-2350	Bathroom	1000A	Room 1 Bathroom	BF	11/25/2020	6:06:00 AM
BRTWD-2351	Classroom	1001	Room 2	CF	11/25/2020	6:08:00 AM
BRTWD-2352	Classroom	1001	Room 2	DW	11/25/2020	6:08:00 AM

Building Address

77 Stahley Street
Brentwood, NY 11717

OR for L. Liang
11/21

Analysis Type: ELAP 200.5

Lab Received: Unique McKay

Signature: Lum 11/25/20 3:54 PM

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Loretta Park Elementary School

LORE

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2353	Bathroom	1001A	Room 2 Bathroom	BF	11/25/2020	6:08:00 AM
BRTWD-2354	Classroom	1002	Room 3	CF	11/25/2020	6:09:00 AM
BRTWD-2355	Classroom	1002	Room 3	DW	11/25/2020	6:09:00 AM
BRTWD-2356	Classroom	1003	Room 4	CF	11/25/2020	6:11:00 AM
BRTWD-2357	Classroom	1003	Room 4	DW	11/25/2020	6:11:00 AM
BRTWD-2358	Classroom	1004	Room 5	CF	11/25/2020	6:12:00 AM
BRTWD-2359	Classroom	1004	Room 5	DW	11/25/2020	6:12:00 AM
BRTWD-2360	Classroom	1005	Room 6	CF	11/25/2020	6:13:00 AM
BRTWD-2361	Classroom	1005	Room 6	DW	11/25/2020	6:13:00 AM
BRTWD-2362	Classroom	1006	Room 7	CF	11/25/2020	6:15:00 AM
BRTWD-2363	Classroom	1006	Room 7	DW	11/25/2020	6:15:00 AM
BRTWD-2364	Classroom	1007	Room 8	CF	11/25/2020	6:16:00 AM
BRTWD-2365	Classroom	1007	Room 8	DW	11/25/2020	6:16:00 AM
BRTWD-2366	Classroom	1008	Room 9	CF	11/25/2020	6:17:00 AM
BRTWD-2367	Classroom	1008	Room 9	DW	11/25/2020	6:17:00 AM
BRTWD-2368	Classroom	1009	Room 10	CF	11/25/2020	6:19:00 AM
BRTWD-2369	Classroom	1009	Room 10	DW	11/25/2020	6:19:00 AM
BRTWD-2370	Classroom	1010	Room 11	CF	11/25/2020	6:20:00 AM

Building Address

77 Stahley Street

Brentwood, NY 11717

OR for *Analysis*
11/7/21

Analysis Type: ELAP 200.5

Lab Received: *Unique McKay*

Signature: *Wm 11/25/20 3:54 PM*

Samplers Name: *Alina Castelluzzo*

Samplers Signature: *Alina Castelluzzo*

JCB Project Manager: *Meghan Gwyn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Loretta Park Elementary School

LORE

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2371	Classroom	1010	Room 11	DW	11/25/2020	6:20:00 AM
BRTWD-2372	Classroom	1011	Room 12	CF	11/25/2020	6:21:00 AM
BRTWD-2373	Classroom	1011	Room 12	DW	11/25/2020	6:21:00 AM
BRTWD-2374	Classroom	1013	Room 14	CF	11/25/2020	6:22:00 AM
BRTWD-2375	Classroom	1013	Room 14	DW	11/25/2020	6:22:00 AM
BRTWD-2376	Faculty Lounge	1014	Faculty Room	CF	11/25/2020	6:27:00 AM
BRTWD-2377	Bathroom	1016	Women's Bathroom	BF	11/25/2020	6:28:00 AM
BRTWD-2378	Hallway	1038	Corridor Near Women's Bathroom	WC	11/25/2020	6:28:00 AM
BRTWD-2379	Bathroom	1020	Men's Bathroom	BF	11/25/2020	6:29:00 AM
BRTWD-2380	Nurse Office	1022	Nurse's Office	NS	11/25/2020	6:31:00 AM
BRTWD-2381	Bathroom	1022C	Nurse's Office Bathroom	BF	11/25/2020	6:31:00 AM
BRTWD-2383	Hallway	1038	Corridor Near Room 17 (1026)	WC	11/25/2020	6:33:00 AM
BRTWD-2384	Kitchen	1035	Kitchen	KC	11/25/2020	5:39:00 AM
BRTWD-2385	Kitchen	1035	Kitchen	KC	11/25/2020	5:39:00 AM
BRTWD-2386	Kitchen	1035	Kitchen	HW	11/25/2020	5:40:00 AM
BRTWD-2387	Kitchen	1035	Kitchen	PK	11/25/2020	5:40:00 AM
BRTWD-2388	Kitchen	1035	Kitchen	KC	11/25/2020	5:42:00 AM
BRTWD-2390	Kitchen	1035	Kitchen	KC	11/25/2020	5:47:00 AM

Building Address

77 Stahley Street

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unigun Mckay

Signature: um 11/25/20 3:54pm

Samplers Name: Alina Castella

Samplers Signature: Alina Castella

JCB Project Manager: Maggie Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Loretta Park Elementary School

LORE

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2391	Kitchen	1035	Kitchen	KC	11/25/2020	5:47:00 AM
BRTWD-2392	Kitchen	1035	Kitchen	HW	11/25/2020	5:48:00 AM
BRTWD-2393	Bathroom	1035AI	Kitchen Bathroom	BF	11/25/2020	5:49:00 AM
BRTWD-2402	Classroom	1045	Room 16	CF	11/25/2020	6:35:00 AM
BRTWD-2403	Classroom	1045	Room 16	DW	11/25/2020	6:35:00 AM
BRTWD-2404	Classroom	1047	Room 18	CF	11/25/2020	6:36:00 AM
BRTWD-2405	Classroom	1047	Room 18	DW	11/25/2020	6:36:00 AM
BRTWD-2406	Classroom	1048	Room 20	CF	11/25/2020	6:38:00 AM
BRTWD-2407	Classroom	1048	Room 20	DW	11/25/2020	6:38:00 AM
BRTWD-2408	Classroom	1049	Room 21	CF	11/25/2020	6:40:00 AM
BRTWD-2409	Classroom	1049	Room 21	DW	11/25/2020	6:40:00 AM
BRTWD-2410	Classroom	1050	Room 22	CF	11/25/2020	6:41:00 AM
BRTWD-2411	Classroom	1050	Room 22	DW	11/25/2020	6:41:00 AM
BRTWD-2412	Classroom	1051	Room 23	CF	11/25/2020	6:43:00 AM
BRTWD-2413	Classroom	1051	Room 23	DW	11/25/2020	6:43:00 AM
BRTWD-2414	Classroom	1052	Room 24	CF	11/25/2020	6:45:00 AM
BRTWD-2415	Classroom	1052	Room 24	DW	11/25/2020	6:45:00 AM
BRTWD-2416	Classroom	1053	Room 25	CF	11/25/2020	6:46:00 AM

Building Address

77 Stahley Street

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unique McKaySignature: um 11/25/20 3:34pmSamplers Name: Alina CastelluzzoSamplers Signature: Alina CastelluzzoJCB Project Manager: Meghan Gwynn



062022106 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Loretta Park Elementary School
LORE

Client:
Brentwood Union Free School District

Retest/New Install [+]
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2417	Classroom	1053	Room 25	DW	11/25/2020	6:46:00 AM
BRTWD-2418	Classroom	1054	Room 26	CF	11/25/2020	6:47:00 AM
BRTWD-2419	Classroom	1054	Room 26	DW	11/25/2020	6:47:00 AM
BRTWD-2420	Classroom	1055	Room 27	CF	11/25/2020	6:49:00 AM
BRTWD-2421	Classroom	1055	Room 27	DW	11/25/2020	6:49:00 AM
BRTWD-2422	Classroom	1056	Room 28	CF	11/25/2020	6:50:00 AM
BRTWD-2423	Classroom	1056	Room 28	DW	11/25/2020	6:50:00 AM
BRTWD-2424	Classroom	1057	Room 29	CF	11/25/2020	6:51:00 AM
BRTWD-2425	Classroom	1057	Room 29	DW	11/25/2020	6:51:00 AM

Samples Submitted 81

20 NOV 25 PM 3:54
ANALYTICAL
CARLE PLACE, NY

Building Address
77 Stahley Street
Brentwood, NY 11717

OR for A. Liang
11/21

Analysis Type: ELAP 200.5

Lab Received: Unique McKay

Signature: um 11/25/20 3:54pm

Samplers Name: Alicia Castelluzzo

Samplers Signature: Alicia Castelluzzo

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/27/2020. The results are tabulated on the attached data pages for the following client designated project:

**Loretta Park Elementary School, 77 Stahley Street, Brentwood,
NY 11717, Brentwood Union Free School District, # 19-45270**

The reference number for these samples is EMSL Order #062022106. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2328 **Collected:** 11/25/2020 **Lab ID:** 062022106-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2329 **Collected:** 11/25/2020 **Lab ID:** 062022106-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2330 **Collected:** 11/25/2020 **Lab ID:** 062022106-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2331 **Collected:** 11/25/2020 **Lab ID:** 062022106-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2332 **Collected:** 11/25/2020 **Lab ID:** 062022106-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2333 **Collected:** 11/25/2020 **Lab ID:** 062022106-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2335 **Collected:** 11/25/2020 **Lab ID:** 062022106-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2336 **Collected:** 11/25/2020 **Lab ID:** 062022106-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2336		Collected:	11/25/2020	Lab ID:	062022106-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2337		Collected:	11/25/2020	Lab ID:	062022106-0009	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2338		Collected:	11/25/2020	Lab ID:	062022106-0010	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2339		Collected:	11/25/2020	Lab ID:	062022106-0011	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2344		Collected:	11/25/2020	Lab ID:	062022106-0012	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2345		Collected:	11/25/2020	Lab ID:	062022106-0013	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2348		Collected:	11/25/2020	Lab ID:	062022106-0014	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2349		Collected:	11/25/2020	Lab ID:	062022106-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2349		Collected:	11/25/2020	Lab ID:	062022106-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2350		Collected:	11/25/2020	Lab ID:	062022106-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2351		Collected:	11/25/2020	Lab ID:	062022106-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2352		Collected:	11/25/2020	Lab ID:	062022106-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2353		Collected:	11/25/2020	Lab ID:	062022106-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2354		Collected:	11/25/2020	Lab ID:	062022106-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2355		Collected:	11/25/2020	Lab ID:	062022106-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2356		Collected:	11/25/2020	Lab ID:	062022106-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2356 **Collected:** 11/25/2020 **Lab ID:** 062022106-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2357 **Collected:** 11/25/2020 **Lab ID:** 062022106-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2358 **Collected:** 11/25/2020 **Lab ID:** 062022106-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2359 **Collected:** 11/25/2020 **Lab ID:** 062022106-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	56	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2360 **Collected:** 11/25/2020 **Lab ID:** 062022106-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2361 **Collected:** 11/25/2020 **Lab ID:** 062022106-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2362 **Collected:** 11/25/2020 **Lab ID:** 062022106-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2363 **Collected:** 11/25/2020 **Lab ID:** 062022106-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2363 **Collected:** 11/25/2020 **Lab ID:** 062022106-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2364 **Collected:** 11/25/2020 **Lab ID:** 062022106-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2365 **Collected:** 11/25/2020 **Lab ID:** 062022106-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.9	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2366 **Collected:** 11/25/2020 **Lab ID:** 062022106-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2367 **Collected:** 11/25/2020 **Lab ID:** 062022106-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	280	6.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2368 **Collected:** 11/25/2020 **Lab ID:** 062022106-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2369 **Collected:** 11/25/2020 **Lab ID:** 062022106-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2370 **Collected:** 11/25/2020 **Lab ID:** 062022106-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2370		Collected:	11/25/2020	Lab ID:	062022106-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2371		Collected:	11/25/2020	Lab ID:	062022106-0037	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2372		Collected:	11/25/2020	Lab ID:	062022106-0038	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2373		Collected:	11/25/2020	Lab ID:	062022106-0039	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2374		Collected:	11/25/2020	Lab ID:	062022106-0040	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2375		Collected:	11/25/2020	Lab ID:	062022106-0041	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2376		Collected:	11/25/2020	Lab ID:	062022106-0042	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2377		Collected:	11/25/2020	Lab ID:	062022106-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2377 **Collected:** 11/25/2020 **Lab ID:** 062022106-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2378 **Collected:** 11/25/2020 **Lab ID:** 062022106-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2379 **Collected:** 11/25/2020 **Lab ID:** 062022106-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2380 **Collected:** 11/25/2020 **Lab ID:** 062022106-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2381 **Collected:** 11/25/2020 **Lab ID:** 062022106-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2383 **Collected:** 11/25/2020 **Lab ID:** 062022106-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2384 **Collected:** 11/25/2020 **Lab ID:** 062022106-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2385 **Collected:** 11/25/2020 **Lab ID:** 062022106-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description		BRTWD-2385	Collected:	11/25/2020	Lab ID:	062022106-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2386	Collected:	11/25/2020	Lab ID:	062022106-0051		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2387	Collected:	11/25/2020	Lab ID:	062022106-0052		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2388	Collected:	11/25/2020	Lab ID:	062022106-0053		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2390	Collected:	11/25/2020	Lab ID:	062022106-0054		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2391	Collected:	11/25/2020	Lab ID:	062022106-0055		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-2392	Collected:	11/25/2020	Lab ID:	062022106-0056		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.3	3.0	µg/L	1/6/2021	AM	1/7/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2393 **Collected:** 11/25/2020 **Lab ID:** 062022106-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2402 **Collected:** 11/25/2020 **Lab ID:** 062022106-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2403 **Collected:** 11/25/2020 **Lab ID:** 062022106-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2404 **Collected:** 11/25/2020 **Lab ID:** 062022106-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2405 **Collected:** 11/25/2020 **Lab ID:** 062022106-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2406 **Collected:** 11/25/2020 **Lab ID:** 062022106-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2407 **Collected:** 11/25/2020 **Lab ID:** 062022106-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2408 **Collected:** 11/25/2020 **Lab ID:** 062022106-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2409 **Collected:** 11/25/2020 **Lab ID:** 062022106-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2410 **Collected:** 11/25/2020 **Lab ID:** 062022106-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2411 **Collected:** 11/25/2020 **Lab ID:** 062022106-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2412 **Collected:** 11/25/2020 **Lab ID:** 062022106-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2413 **Collected:** 11/25/2020 **Lab ID:** 062022106-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	65	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2414 **Collected:** 11/25/2020 **Lab ID:** 062022106-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2415 **Collected:** 11/25/2020 **Lab ID:** 062022106-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2415 **Collected:** 11/25/2020 **Lab ID:** 062022106-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2416 **Collected:** 11/25/2020 **Lab ID:** 062022106-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.1	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2417 **Collected:** 11/25/2020 **Lab ID:** 062022106-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2418 **Collected:** 11/25/2020 **Lab ID:** 062022106-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2419 **Collected:** 11/25/2020 **Lab ID:** 062022106-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	38	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2420 **Collected:** 11/25/2020 **Lab ID:** 062022106-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2421 **Collected:** 11/25/2020 **Lab ID:** 062022106-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2422 **Collected:** 11/25/2020 **Lab ID:** 062022106-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022106

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/25/2020 03:54 PM
 Collected: 11/25/2020

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, # 19-45270**

Analytical Results

Client Sample Description BRTWD-2422 **Collected:** 11/25/2020 **Lab ID:** 062022106-0078

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2423 **Collected:** 11/25/2020 **Lab ID:** 062022106-0079

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2424 **Collected:** 11/25/2020 **Lab ID:** 062022106-0080

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-2425 **Collected:** 11/25/2020 **Lab ID:** 062022106-0081

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062105809 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 40-45270 21-48246

Building: Loretta Park Elementary School

LORE

Client:

Brentwood Union Free School District

Retest/New Install: 1

Turn Around: Normal 1 wk Rush 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2359	Classroom	1004	Room 5	DW	3/26/2021	6:56:00 AM
BRTWD-2367	Classroom	1008	Room 9	DW	3/26/2021	6:46:00 AM
BRTWD-2373	Classroom	1011	Room 12	DW	3/26/2021	6:45:00 AM
BRTWD-2375	Classroom	1013	Room 14	DW	3/26/2021	6:44:00 AM
BRTWD-2411	Classroom	1050	Room 22	DW	3/26/2021	6:50:00 AM
BRTWD-2413	Classroom	1051	Room 23	DW	3/26/2021	6:51:00 AM
BRTWD-2415	Classroom	1052	Room 24	DW	3/26/2021	6:52:00 AM
BRTWD-2419	Classroom	1054	Room 26	DW	3/26/2021	6:53:00 AM

Samples Submitted 8

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address

77 Stahley Street

Brentwood, NY 11717

Pb200.5-

Alger Long
04/02/21

Analysis Type: ELAP 200.5 AD

Lab Received: Unique Macro

Signature: um 3/27/21 3:25 PM

Samplers Name: Meghan Gwynn

Samplers Signature: Meghan Gwynn

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/27/2021. The results are tabulated on the attached data pages for the following client designated project:

**Loretta Park Elementary School, 77 Stahley Street, Brentwood,
NY 11717, Brentwood Union Free School District, 21-48246**

The reference number for these samples is EMSL Order #062105809. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105809

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 3/27/2021 03:25 PM
 Collected: 3/26/2021

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description		BRTWD-2359 Room 5		Collected:	3/26/2021	Lab ID:	062105809-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0044	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2367 Room 9		Collected:	3/26/2021	Lab ID:	062105809-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0042	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2373 Room 12		Collected:	3/26/2021	Lab ID:	062105809-0003	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0087	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2375 Room 14		Collected:	3/26/2021	Lab ID:	062105809-0004	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0040	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2411 Room 22		Collected:	3/26/2021	Lab ID:	062105809-0005	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0044	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2413 Room 23		Collected:	3/26/2021	Lab ID:	062105809-0006	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0012 J	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Lead MDL: 0.0010mg/L								
Client Sample Description		BRTWD-2415 Room 24		Collected:	3/26/2021	Lab ID:	062105809-0007	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0074	0.0030	mg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-2419 Room 26		Collected:	3/26/2021	Lab ID:	062105809-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105809

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/27/2021 03:25 PM
Collected: 3/26/2021

Project: **Loretta Park Elementary School, 77 Stahley Street, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-2419 **Collected:** 3/26/2021 **Lab ID:** 062105809-0008
Room 26

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	0.0016 J	0.0030 mg/L	4/1/2021	DI	4/2/2021	AL
Lead MDL: 0.0010mg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Loretta Park Elementary School

LORE

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2350	Bathroom	1000A	Room 1 Bathroom	BF	5/5/2021	7:26:00 AM
BRTWD-2353	Bathroom	1001A	Room 2 Bathroom	BF	5/5/2021	7:24:00 AM

Samples Submitted 2

062108000

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY -5 PM 4:41

Building Address

77 Stahley Street

Brentwood, NY 11717

Pb200.5 -

A. J. Lundy 05/10/21

Analysis Type: ELAP 200.5

Lab Received: *cf*

Signature: *[Signature]*

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/11/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/5/2021. The results are tabulated on the attached data pages for the following client designated project:

19-45270, Loretta Park Elementary School, Brentwood Union
Free School District, 77 Stahley Street, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062108000. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108000

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/05/21 4:41 PM
Collected: 5/5/2021

Project: 19-45270, Loretta Park Elementary School, Brentwood Union Free School District, 77 Stahley Street, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2350 **Collected:** 5/5/2021 **Lab ID:** 062108000-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-2353 **Collected:** 5/5/2021 **Lab ID:** 062108000-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Loretta Park Elementary School

LORE

062225063

Walk In

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush ☐

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3063	HA	1038	Corridor Main Office To Maintenance	WC	12/7/2022	6:43:00 AM
BRTWD-3064	HA	1038	Corridor Main Office To Maintenance	WF	12/7/2022	6:44:00 AM
BRTWD-3065	HA	1038	Corridor Main Office To Maintenance	WC	12/7/2022	6:47:00 AM
BRTWD-3066	HA	1038	Corridor Main Office To Maintenance	WF	12/7/2022	6:48:00 AM

Samples Submitted 4

Pb 200.5

Boru Akter 12/8/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC -7 P 2:37

Building Address

77 Stahley Street

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Miss Ischur 12/11/22

CLARA / 2:37PM

Samplers Name: *Aileen McNamee*

Samplers Signature: *Aileen McNamee*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/8/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/7/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Loretta Park Elementary School, Brentwood Union
Free School District, 77 Stahley Street, Brentwood NY 11717

The reference number for these samples is EMSL Order #062225063. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225063

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/7/2022 02:37 PM
 Collected: 12/7/2022

Project: #: 22-53405, Loretta Park Elementary School, Brentwood Union Free School District, 77 Stahley Street, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3063 **Collected:** 12/7/2022 **Lab ID:** 062225063-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3064 **Collected:** 12/7/2022 **Lab ID:** 062225063-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3065 **Collected:** 12/7/2022 **Lab ID:** 062225063-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3066 **Collected:** 12/7/2022 **Lab ID:** 062225063-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Loretta Park Warehouse

LPW

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2974	Bathroom	1001B	Warehouse Bathroom	BF	11/25/2020	7:31:00 AM

Samples Submitted 1

062 022040

20 NOV 25 PM 3:54
CARLE PLACE, NY

Building Address

77 Stahley Street

Brentwood, NY 11717

P6200.5 - *[Signature]* 12/01/20Analysis Type: ELAP 2005 *[Signature]*Lab Received: *[Signature]*Signature: *[Signature]*Samplers Name: *Aileen Costello* 11/25/20Samplers Signature: *Aileen Costello*JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/25/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-45270, Loretta Park Warehouse, Brentwood Union Free
School District, 77 Stahley Street, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062022040. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022040

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/25/2020 03:54 PM
Collected: 11/25/2020

Project: #19-45270, Loretta Park Warehouse, Brentwood Union Free School District, 77 Stahley Street, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2974**Collected:** 11/25/2020**Lab ID:** 062022040-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: North Elementary School

NOR

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1038	Classroom	1004	Room A-11	CF	11/6/2020	5:43:00 AM
BRTWD-1039	Classroom	1004	Room A-11	DW	11/6/2020	5:43:00 AM
BRTWD-1041	Classroom	1005	Room A-10	CF	11/6/2020	5:44:00 AM
BRTWD-1042	Classroom	1005	Room A-10	DW	11/6/2020	5:44:00 AM
BRTWD-1043	Bathroom	1005A	Room A-10 Bathroom	BF	11/6/2020	5:45:00 AM
BRTWD-1044	Classroom	1006	Room A-9	CF	11/6/2020	5:46:00 AM
BRTWD-1045	Classroom	1006	Room A-9	DW	11/6/2020	5:47:00 AM
BRTWD-1046	Classroom	1007	Room A-8	CF	11/6/2020	5:48:00 AM
BRTWD-1047	Classroom	1007	Room A-8	DW	11/6/2020	5:48:00 AM
BRTWD-1048	Classroom	1008	Room A-7	CF	11/6/2020	5:49:00 AM
BRTWD-1049	Classroom	1008	Room A-7	DW	11/6/2020	5:49:00 AM
BRTWD-1050	Classroom	1009	Room A-6	CF	11/6/2020	5:50:00 AM
BRTWD-1051	Classroom	1009	Room A-6	DW	11/6/2020	5:50:00 AM
BRTWD-1052	Classroom	1010	Room A-5	CF	11/6/2020	5:52:00 AM
BRTWD-1053	Classroom	1010	Room A-5	DW	11/6/2020	5:52:00 AM
BRTWD-1054	Classroom	1011	Room A-4	CF	11/6/2020	5:54:00 AM
BRTWD-1055	Classroom	1011	Room A-4	DW	11/6/2020	5:54:00 AM
BRTWD-1056	Classroom	1012	Room A-3	CF	11/6/2020	5:55:00 AM

Building Address

50 West White Street

Brentwood, NY 11717

PB 200.5 -

12/09/20

Analysis Type: ELAP 200.5

Lab Received: Unique McKaySignature: LM 11/6/20 S. ShanSamplers Name: Aliya Gastrell 11/4/20Samplers Signature: Aliya GastrellJCB Project Manager: Meghan Gwyah



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: North Elementary School

NOR

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1057	Classroom	1012	Room A-3	DW	11/6/2020	5:55:00 AM
BRTWD-1058	Classroom	1013	Room A-2	CF	11/6/2020	5:56:00 AM
BRTWD-1059	Classroom	1013	Room A-2	DW	11/6/2020	5:56:00 AM
BRTWD-1060	Classroom	1015	Room A-1	CF	11/6/2020	5:58:00 AM
BRTWD-1061	Classroom	1015	Room A-1	DW	11/6/2020	5:58:00 AM
BRTWD-1062	Bathroom	1018	Women's Bathroom	BF	11/6/2020	5:59:00 AM
BRTWD-1063	Bathroom	1019	Student Bathroom	BF	11/6/2020	6:00:00 AM
BRTWD-1064	Hallway	1017	Corridor Near Main Office (1021)	WC	11/6/2020	6:02:00 AM
BRTWD-1067	Bathroom	2002	Ladies Bathroom	BF	11/6/2020	6:14:00 AM
BRTWD-1068	Bathroom	2003	Men's Bathroom	BF	11/6/2020	6:15:00 AM
BRTWD-1069	Classroom	2005	Room A-12	CF	11/6/2020	6:18:00 AM
BRTWD-1070	Classroom	2005	Room A-12	DW	11/6/2020	6:18:00 AM
BRTWD-1071	Classroom	2007	Room A-13	CF	11/6/2020	6:20:00 AM
BRTWD-1072	Classroom	2007	Room A-13	DW	11/6/2020	6:20:00 AM
BRTWD-1073	Classroom	2008	Room A-14	CF	11/6/2020	6:21:00 AM
BRTWD-1074	Classroom	2008	Room A-14	DW	11/6/2020	6:21:00 AM
BRTWD-1075	Classroom	2009	Room A-15	CF	11/6/2020	6:23:00 AM
BRTWD-1076	Classroom	2009	Room A-15	DW	11/6/2020	6:23:00 AM

Building Address

50 West White Street

Brentwood, NY 11717

Pb200.5-

A. Zeng 12/09/20

Analysis Type: ELAP 200.5 (A)

Lab Received: Unique mcr 24

Signature: um 11/16/20 554 pm

Samplers Name: Alina Castellanero

Samplers Signature: Alina Castellanero

JCB Project Manager: Meghan Gwynn



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Elementary School
NOR

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Page 3 of 7

OrderID: 062021075

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1077	Classroom	2010	Room A-16	CF	11/6/2020	6:25:00 AM
BRTWD-1078	Classroom	2010	Room A-16	DW	11/6/2020	6:25:00 AM
BRTWD-1079	Classroom	2011	Room A-17	CF	11/6/2020	6:27:00 AM
BRTWD-1080	Classroom	2011	Room A-17	DW	11/6/2020	6:27:00 AM
BRTWD-1081	Classroom	2012	Room A-18	CF	11/6/2020	6:29:00 AM
BRTWD-1082	Classroom	2012	Room A-18	DW	11/6/2020	6:29:00 AM
BRTWD-1083	Classroom	2013	Room A-19	CF	11/6/2020	6:31:00 AM
BRTWD-1084	Classroom	2013	Room A-19	DW	11/6/2020	6:31:00 AM
BRTWD-1085	Classroom	2014	Room A-20	CF	11/6/2020	6:33:00 AM
BRTWD-1086	Classroom	2014	Room A-20	DW	11/6/2020	6:33:00 AM
BRTWD-1087	Classroom	2015	Room A-21	CF	11/6/2020	6:36:00 AM
BRTWD-1088	Classroom	2015	Room A-21	DW	11/6/2020	6:36:00 AM
BRTWD-1089	Classroom	2016	Room A-22	CF	11/6/2020	6:38:00 AM
BRTWD-1090	Classroom	2016	Room A-22	DW	11/6/2020	6:38:00 AM
BRTWD-1091	Bathroom	1023B1	All Purpose Room Storage 2 Bathroom	BF	11/6/2020	6:09:00 AM
BRTWD-1092	Bathroom	1023C2	All Purpose Room Reading Office Bathroom	BF	11/6/2020	6:08:00 AM
BRTWD-1093	Kitchen	1026	Kitchen (Annex)	HW	11/6/2020	6:04:00 AM
BRTWD-1094	Kitchen	1026	Kitchen (Annex)	KC	11/6/2020	6:05:00 AM

Building Address
50 West White Street
Brentwood, NY 11717

P6206.5 -
A. Jung 12/09/20

Analysis Type: ELAP 200.5 *AD*
Lab Received: *Unique McKay*
Signature: *UM 11/6/20 5:54pm*

Samplers Name: *Allina Castelluzzo*
Samplers Signature: *Allina Castelluzzo*
JCB Project Manager: *Meghan Gwynn*



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Elementary School
NOR

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1095	Kitchen	1026	Kitchen (Annex)	KC	11/6/2020	6:06:00 AM
BRTWD-1097	Classroom	1031	Room 1	CF	11/6/2020	6:49:00 AM
BRTWD-1098	Classroom	1031	Room 1	DW	11/6/2020	6:49:00 AM
BRTWD-1099	Bathroom	1031B	Room 1 Bathroom	BF	11/6/2020	6:50:00 AM
BRTWD-1100	Bathroom	1033A	Library Bathroom	BF	11/6/2020	6:52:00 AM
BRTWD-1101	Classroom	1035	Room 3	CF	11/6/2020	6:55:00 AM
BRTWD-1102	Classroom	1035	Room 3	DW	11/6/2020	6:55:00 AM
BRTWD-1103	Classroom	1036	Room 5	CF	11/6/2020	6:58:00 AM
BRTWD-1105	Classroom	1037	Room 6	CF	11/6/2020	7:00:00 AM
BRTWD-1106	Classroom	1037	Room 6	DW	11/6/2020	7:00:00 AM
BRTWD-1107	Classroom	1038	Room 7	CF	11/6/2020	7:02:00 AM
BRTWD-1108	Classroom	1038	Room 7	DW	11/6/2020	7:02:00 AM
BRTWD-1109	Classroom	1039	Room 8	CF	11/6/2020	7:04:00 AM
BRTWD-1110	Classroom	1039	Room 8	DW	11/6/2020	7:05:00 AM
BRTWD-1111	Classroom	1040	Room 9	CF	11/6/2020	7:06:00 AM
BRTWD-1112	Classroom	1040	Room 9	DW	11/6/2020	7:07:00 AM
BRTWD-1113	Classroom	1041	Room 10	CF	11/6/2020	7:09:00 AM
BRTWD-1114	Classroom	1041	Room 10	DW	11/6/2020	7:10:00 AM

Building Address
50 West White Street
Brentwood, NY 11717

Ph 200.5 -
A. James 12/09/20

Analysis Type: ELAP 200.5 @
Lab Received: *Unique Mercury*
Signature: *Wm 11/6/20 554 an*

Samplers Name: *Alina Castelli 11/6/20*
Samplers Signature: *Alina Castelli*
JCB Project Manager: *Meghan Gwynn*



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Elementary School
NOR

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1115	Classroom	1042	Room 11	CF	11/6/2020	7:12:00 AM
BRTWD-1116	Classroom	1042	Room 11	DW	11/6/2020	7:12:00 AM
BRTWD-1117	Classroom	1043	Room 12	CF	11/6/2020	7:14:00 AM
BRTWD-1118	Classroom	1043	Room 12	DW	11/6/2020	7:15:00 AM
BRTWD-1119	Classroom	1044	Room 13	CF	11/6/2020	7:17:00 AM
BRTWD-1120	Classroom	1044	Room 13	DW	11/6/2020	7:17:00 AM
BRTWD-1121	Classroom	1045	Room 14	CF	11/6/2020	7:19:00 AM
BRTWD-1122	Classroom	1045	Room 14	DW	11/6/2020	7:20:00 AM
BRTWD-1123	Classroom	1047	Room 15	CF	11/6/2020	7:22:00 AM
BRTWD-1124	Classroom	1047	Room 15	DW	11/6/2020	7:22:00 AM
BRTWD-1125	Office	1050C	Conference Room	BW	11/6/2020	7:24:00 AM
BRTWD-1126	Bathroom	1052	Women's Bathroom	BF	11/6/2020	7:25:00 AM
BRTWD-1127	Bathroom	1053	Men's Bathroom	BF	11/6/2020	7:26:00 AM
BRTWD-1128	Nurse Office	1056	Nurse's Office	NS	11/6/2020	7:28:00 AM
BRTWD-1130	Bathroom	1056A	Nurse's Office Bathroom	BF	11/6/2020	7:29:00 AM
BRTWD-1132	Faculty Lounge	1057A	Faculty Room	CF	11/6/2020	7:32:00 AM
BRTWD-1133	Hallway	1086	Corridor Near Cafeteria (1063)	DW	11/6/2020	7:33:00 AM
BRTWD-1134	Kitchen	1065	Kitchen	KC	11/6/2020	5:30:00 AM

Building Address
50 West White Street
Brentwood, NY 11717

P200.5 -

A. Ljung 12/09/20

Analysis Type: ELAP 200.5 (A)

Lab Received: *Unique McKay*

Signature: *Lum 11/6/20 554 PM*

Samplers Name: *Ailin Castelli 11/20*

Samplers Signature: *Ailin Castelli*

JCB Project Manager: *Meghan Gwynn*



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Elementary School
NOR

Client:
Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Page 6 of 7

OrderID: 062021075

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1135	Kitchen	1065	Kitchen	PK	11/6/2020	5:31:00 AM
BRTWD-1136	Kitchen	1065	Kitchen	HW	11/6/2020	5:32:00 AM
BRTWD-1137	Kitchen	1065	Kitchen	KC	11/6/2020	5:33:00 AM
BRTWD-1138	Kitchen	1065	Kitchen	KC	11/6/2020	5:33:00 AM
BRTWD-1139	Kitchen	1065	Kitchen	KC	11/6/2020	5:34:00 AM
BRTWD-1140	Bathroom	1065C	Kitchen Bathroom	BF	11/6/2020	5:35:00 AM
BRTWD-1149	Classroom	1073	Room 16	CF	11/6/2020	7:36:00 AM
BRTWD-1150	Classroom	1073	Room 16	DW	11/6/2020	7:36:00 AM
BRTWD-1151	Classroom	1074	Room 17	CF	11/6/2020	7:37:00 AM
BRTWD-1152	Classroom	1074	Room 17	DW	11/6/2020	7:38:00 AM
BRTWD-1153	Classroom	1075	Room 18	CF	11/6/2020	7:40:00 AM
BRTWD-1154	Classroom	1075	Room 18	DW	11/6/2020	7:40:00 AM
BRTWD-1155	Classroom	1076	Room 19	CF	11/6/2020	7:42:00 AM
BRTWD-1156	Classroom	1076	Room 19	DW	11/6/2020	7:42:00 AM
BRTWD-1157	Classroom	1077	Room 20	CF	11/6/2020	7:44:00 AM
BRTWD-1158	Classroom	1077	Room 20	DW	11/6/2020	7:44:00 AM
BRTWD-1159	Classroom	1078	Room 21	CF	11/6/2020	7:46:00 AM
BRTWD-1161	Classroom	1079	Room 22	CF	11/6/2020	7:49:00 AM

Building Address
50 West White Street
Brentwood, NY 11717

Pb200.5 -
A. J. J. 12/09/20

Analysis Type: ELAP 200.5 AD
Lab Received: Unique Moxon
Signature: um 11/6/20 554em

Samplers Name: Alina Castelluzzo
Samplers Signature: Alina Castelluzzo
JCB Project Manager: Meghan Gwynn



062021075 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Elementary School
NOR

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1162	Classroom	1079	Room 22	DW	11/6/2020	7:49:00 AM
BRTWD-1163	Classroom	1080	Room 23	CF	11/6/2020	7:51:00 AM
BRTWD-1164	Classroom	1080	Room 23	DW	11/6/2020	7:51:00 AM
BRTWD-1165	Classroom	1081	Room 24	CF	11/6/2020	7:53:00 AM
BRTWD-1166	Classroom	1081	Room 24	DW	11/6/2020	7:53:00 AM
BRTWD-1167	Classroom	1082	Room 25	CF	11/6/2020	7:56:00 AM
BRTWD-1168	Classroom	1082	Room 25	DW	11/6/2020	7:56:00 AM
BRTWD-1169	Classroom	1083	Room 26	CF	11/6/2020	7:57:00 AM
BRTWD-1170	Classroom	1083	Room 26	DW	11/6/2020	7:57:00 AM
BRTWD-1171	Classroom	1084	Room 27	CF	11/6/2020	7:59:00 AM
BRTWD-1172	Classroom	1084	Room 27	DW	11/6/2020	7:59:00 AM

Samples Submitted 119

RECEIVED
ANALYTICAL, INC.
RIEPLAGE, NY
21 NOV - 6 PM 5:54

Building Address
50 West White Street
Brentwood, NY 11717

Pb 200.5 -

A. Lunny 12/09/20

Analysis Type: ELAP 200.5 *(12)*

Lab Received: *Unique McKay*

Signature: *LM 11/6/20 5:54pm*

Samplers Name: *Alina Castelluzzo*

Samplers Signature: *Alina Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/6/2020. The results are tabulated on the attached data pages for the following client designated project:

North Elementary School, 50 West White Street, Brentwood, NY
11717, Brentwood Union Free School District. Project # 19-45270

The reference number for these samples is EMSL Order #062021075. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1038		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1039		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1041		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0003	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1042		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0004	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1043		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0005	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1044		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0006	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1045		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0007	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1046		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1046	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0008
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1047	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0009
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1048	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0010
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-1049	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0011
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1050	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0012
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1051	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0013
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1052	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0014
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1053	Collected:		11/6/2020 5:43:00 AM	Lab ID:		062021075-0015
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description BRTWD-1053 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1054 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1055 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1056 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1057 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1058 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1059 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1060 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1060		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1061		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0023	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1062		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0024	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1063		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0025	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1064		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0026	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1067		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0027	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1068		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0028	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1069	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Lead MDL: 1.0µg/L							
Client Sample Description		BRTWD-1070	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0030	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	5.5	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Client Sample Description		BRTWD-1071	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0031	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	14	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Client Sample Description		BRTWD-1072	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0032	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	18	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Client Sample Description		BRTWD-1073	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0033	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	1.5 J	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Lead MDL: 1.0µg/L							
Client Sample Description		BRTWD-1074	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0034	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Client Sample Description		BRTWD-1075	Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0035	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	1.5 J	3.0	µg/L	12/3/2020	DI	12/4/2020 AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description BRTWD-1076 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1077 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1078 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1079 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1080 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1081 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1082 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1083		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1084		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1085		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1086		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1087		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1088		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1089		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	12/3/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1090		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1091		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0051	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1092		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0052	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1093		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0053	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1094		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0054	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1095		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0055	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	100	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1097		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0056	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1098		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description BRTWD-1098 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1099 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1100 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1101 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1102 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1103 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1105 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1106		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1107		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0065	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1108		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0066	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1109		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0067	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1110		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0068	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1111		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0069	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1112		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0070	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description BRTWD-1113 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1114 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1115 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1116 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1117 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1118 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1119 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1120		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0078	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1121		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0079	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1122		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0080	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1123		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0081	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1124		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0082	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1125		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0083	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1126		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0084	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1127		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0085	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1128		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0086	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1130		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0087	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1132		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0088	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1133		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0089	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1134		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0090	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1135		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0091	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0	µg/L	12/3/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1136		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0092	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1137		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0093	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1138		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0094	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1139		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0095	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1140		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0096	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1149		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0097	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1150		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0098	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.3	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1151		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0099	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description BRTWD-1151 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1152 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0100

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1153 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0101

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1154 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0102

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1155 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0103

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1156 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0104

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1157 **Collected:** 11/6/2020 5:43:00 AM **Lab ID:** 062021075-0105

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1158	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0106	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1159	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0107	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	27	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1161	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0108	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-1162	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0109	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-1163	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0110	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1164	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0111	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1165	Collected:		11/6/2020 5:43:00 AM	Lab ID:	062021075-0112	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
		Lead MDL: 1.0µg/L						

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021075

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 05:54 PM
 Collected: 11/6/2020

Project: North Elementary School, 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District. Project # 19-45270

Analytical Results

Client Sample Description		BRTWD-1166		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0113	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1167		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0114	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1168		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0115	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1169		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0116	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1170		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0117	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1171		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0118	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1172		Collected:	11/6/2020 5:43:00 AM	Lab ID:	062021075-0119	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	12/3/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062021075
CustomerID: JCBR50
CustomerPO:
ProjectID:

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062105804

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~49-46270~~ 21-48246

Building: North Elementary School

NOR

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1095	Kitchen	1026	Kitchen (Annex)	KC	3/26/2021	7:23:00 AM

Samples Submitted 1

RECEIVED
EHSI ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address

50 West White Street

Brentwood, NY 11717

Pb200.5 -

Alyssa Jung 04/02/21

Analysis Type: ELAP 200.5 (41)

Lab Received: *Unique McCoy*Signature: *um 3/27/21 3:25 PM*Samplers Name: *Meghan Gwynn*Samplers Signature: *Meghan Gwynn*JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/27/2021. The results are tabulated on the attached data pages for the following client designated project:

North Elementary School. 50 West White Street, Brentwood, NY
11717, Brentwood Union Free School District- 21-48246

The reference number for these samples is EMSL Order #062105804. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105804

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/27/2021 02:26 PM
Collected: 3/26/2021

Project: North Elementary School. 50 West White Street, Brentwood, NY 11717, Brentwood Union Free School District- 21-48246

Analytical Results

Client Sample Description BRTWD-1095 **Collected:** 3/26/2021 **Lab ID:** 062105804-0001
Kitchen

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	39	3.0 µg/L	4/1/2021	DI	4/2/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

062108232

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Elementary School
NOR

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1042	Classroom	1005	Room A-10	DW	5/6/2021	8:24:00 AM
BRTWD-1064	Hallway	1017	Corridor Near Annex Office (1021)	WC	5/6/2021	8:22:00 AM

Samples Submitted 2

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY -6 PM 2:50

Building Address
50 West White Street
Brentwood, NY 11717

Analysis Type: ELAP 200.5
Lab Received: 5/6/21 @ 2:50 pm
Signature: [Signature]

Samplers Name: Alexandria Orlassino
Samplers Signature: A Orlassino
JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/6/2021. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District. Norh Elementary School.
NOR. JCB # 19-45270

The reference number for these samples is EMSL Order #062108232. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108232

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/06/21 2:50 PM
Collected: 5/6/2021

Project: **Brentwood Union Free School District. Norh Elementary School. NOR. JCB # 19-45270****Analytical Results**

Client Sample Description BRTWD - 1042 **Collected:** 5/6/2021 **Lab ID:** 062108232-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	5/11/2021	DI	5/12/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD - 1064 **Collected:** 5/6/2021 **Lab ID:** 062108232-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~19-45270~~ 21-48246

Building: North Elementary School

NOR

062110636

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1072	Classroom	2007	Room A-13	DW	6/17/2021	7:16:00 AM
BRTWD-1159	Classroom	1078	Room 21	CF	6/17/2021	7:12:00 AM

Samples Submitted 2

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4: 04

Building Address

50 West White Street

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: Alyssa McDonald

Signature: Alyssa McDonald

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, North Elementary School, Brentwood Union Free
School District, 50 West White Street, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062110636. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110636

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:04 PM
Collected: 6/17/2021

Project: #21-48246, North Elementary School, Brentwood Union Free School District, 50 West White Street, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1072 **Collected:** 6/17/2021 **Lab ID:** 062110636-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-1159 **Collected:** 6/17/2021 **Lab ID:** 062110636-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	6/18/2021	AM	6/18/2021	AM
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

21-48246

Building: North Elementary School

NOR

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1095	Kitchen	1026	Kitchen (Annex)	KC	8/23/2022	9:16:00 AM

Samples Submitted 1

Pb 200.5
8/29/22

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 23 P 12:24

Building Address

50 West White Street

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Recieved: 8/23/22 @ 12:24pm

Signature:

Samplers Name: Meghan Gwynn

Samplers Signature: Meghan Gwynn

JCB Project Manager: Meghan Gwynn

Counter



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/23/2022. The results are tabulated on the attached data pages for the following client designated project:

JCB #: 21-48246, North Elementary School, NOR, Brentwood
Union Free School District, 50 West White Street, Brentwood, NY
11717

The reference number for these samples is EMSL Order #062218242. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218242

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/23/2022 12:24 PM
Collected: 8/23/2022

Project: JCB #: 21-48246, North Elementary School, NOR, Brentwood Union Free School District, 50 West White Street, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1095 **Collected:** 8/23/2022 **Lab ID:** 062218242-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: North Elementary School

NOR

062224981

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3051	HA	1086	Main Corridor	WC	12/6/2022	6:59:00 AM
BRTWD-3052	HA	1086	Main Corridor	WF	12/6/2022	7:00:00 AM
BRTWD-3053	HA	1017	Corridor Room A1 to A10	WC	12/6/2022	7:05:00 AM
BRTWD-3054	HA	1017	Corridor Room A1 to A10	WF	12/6/2022	7:06:00 AM

Samples Submitted 4

Pb 200.5

Born Akter 12/18/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC - 6 P 2:54

Building Address

50 West White Street

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Alex Busch 12/6/22

Signature: [Signature] 2:54 PM

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/8/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/6/2022. The results are tabulated on the attached data pages for the following client designated project:

**#: 22-53405, North Elementary School, Brentwood Union Free
School District, 50 West White Street, Brentwood NY 11717**

The reference number for these samples is EMSL Order #062224981. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062224981

CustomerID: JC BR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/6/2022 02:54 PM
Collected: 12/6/2022

Project: #: 22-53405, North Elementary School, Brentwood Union Free School District, 50 West White Street, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3051 **Collected:** 12/6/2022 **Lab ID:** 062224981-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3052 **Collected:** 12/6/2022 **Lab ID:** 062224981-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3053 **Collected:** 12/6/2022 **Lab ID:** 062224981-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3054 **Collected:** 12/6/2022 **Lab ID:** 062224981-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: North Middle School

NMS

062021553

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 1 of 4

OrderID: 062021553

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1664	Bathroom	1008A	Auditorium Lobby Men's Bathroom	BF	11/18/2020	6:31:00 AM
BRTWD-1665	Bathroom	1008A	Auditorium Lobby Men's Bathroom	BF	11/18/2020	6:31:00 AM
BRTWD-1666	Bathroom	1008B	Auditorium Lobby Women's Bathroom	BF	11/18/2020	6:33:00 AM
BRTWD-1667	Bathroom	1008B	Auditorium Lobby Women's Bathroom	BF	11/18/2020	6:33:00 AM
BRTWD-1668	Hallway	1000	Corridor Near Auditorium (1005)	DW	11/18/2020	6:34:00 AM
BRTWD-1675	Classroom	1015	Room 121	CF	11/18/2020	6:37:00 AM
BRTWD-1676	Classroom	1016	Room 122	CF	11/18/2020	6:38:00 AM
BRTWD-1677	Hallway	1023	Corridor Near Room 116 (1021)	DW	11/18/2020	6:41:00 AM
BRTWD-1678	Storage	1024	Room 114	BW	11/18/2020	6:47:00 AM
BRTWD-1683	Hallway	N/A	Corridor Near Bathrooms	WC	11/18/2020	6:49:00 AM
BRTWD-1689	Classroom	N/A	Room 143	CF	11/18/2020	6:50:00 AM
BRTWD-1690	Classroom	N/A	Room 142	CF	11/18/2020	6:52:00 AM
BRTWD-1691	Hallway	N/A	Corridor Near Room 146	WC	11/18/2020	6:54:00 AM
BRTWD-1692	Hallway	N/A	Corridor Near Room 146	WC	11/18/2020	6:55:00 AM
BRTWD-1693	Bathroom	1025	Women's Faculty Bathroom	BF	11/18/2020	6:59:00 AM
BRTWD-1694	Faculty Lounge	1026	Faculty Room	CF	11/18/2020	7:00:00 AM
BRTWD-1695	Bathroom	1027	Men's Faculty Bathroom	BF	11/18/2020	7:01:00 AM
BRTWD-1696	Hallway	1058	Corridor Near Faculty Lounge (1026)	WC	11/18/2020	7:02:00 AM

Building Address

350 Wicks Road

Brentwood, NY 11717

Pd 200.5 DOZ
12/18/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Aina Castanuzo

Samplers Signature: Aina Castanuzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Middle School
NMS

062.021553

Page 2 of 4

Client: Brentwood Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1697	Hallway	1058	Corridor Near Faculty Lounge (1026)	WF	11/18/2020	7:03:00 AM
BRTWD-1698	Bathroom	1028	Boys Bathroom	BF	11/18/2020	7:04:00 AM
BRTWD-1699	Bathroom	1029A	Nurse's Office Bathroom	BF	11/18/2020	7:04:00 AM
BRTWD-1700	Nurse Office	1029	Nurse's Office	NS	11/18/2020	7:06:00 AM
BRTWD-1701	Nurse Office	1029C	Nurse's Office - Inner Room 2	NS	11/18/2020	7:06:00 AM
BRTWD-1704	Hallway	1058	Corridor Near Girls Locker Room (1033)	DW	11/18/2020	7:07:00 AM
BRTWD-1707	Locker Room	1033	Girls Locker Room	DW	11/18/2020	7:09:00 AM
BRTWD-1708	Bathroom	1033A1	Girls Coach's Office Bathroom	BF	11/18/2020	7:12:00 AM
BRTWD-1709	Kitchen	1034	Kitchen	KC	11/18/2020	6:19:00 AM
BRTWD-1710	Kitchen	1034	Kitchen	KC	11/18/2020	6:19:00 AM
BRTWD-1711	Kitchen	1034	Kitchen	KC	11/18/2020	6:21:00 AM
BRTWD-1712	Kitchen	1034	Kitchen	SN	11/18/2020	6:21:00 AM
BRTWD-1713	Kitchen	1034	Kitchen	KC	11/18/2020	6:21:00 AM
BRTWD-1714	Kitchen	1034	Kitchen	PK	11/18/2020	6:22:00 AM
BRTWD-1715	Kitchen	1034	Kitchen	HW	11/18/2020	6:23:00 AM
BRTWD-1719	Hallway	1057	Corridor Near Elevator	DW	11/18/2020	7:13:00 AM
BRTWD-1720	Bathroom	1039A	Custodial Office Bathroom	BF	11/18/2020	7:15:00 AM
BRTWD-1721	Locker Room	1041	Boys Locker Room	DW	11/18/2020	7:17:00 AM

Building Address Pb 200.5 12/18/2020
350 Wicks Road
Brentwood, NY 11717

Analysts Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Aileen Casale 11/22/20
Samplers Signature:
JCB Project Manager: Meghan Gwynn

OrderID: 062021553



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: North Middle School
NMS

062021553

Page 3 of 4

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1724	Bathroom	1041A1	Boys Coach's Office Bathroom	BF	11/18/2020	7:18:00 AM
BRTWD-1725	Hallway	1057	Corridor Near Room 110 (1044)	DW	11/18/2020	7:19:00 AM
BRTWD-1726	Classroom	1046	Room 108	CF	11/18/2020	7:20:00 AM
BRTWD-1727	Home Economics	1048	Room 106	EC	11/18/2020	7:22:00 AM
BRTWD-1728	Home Economics	1048	Room 106	EC	11/18/2020	7:22:00 AM
BRTWD-1729	Home Economics	1048	Room 106	EC	11/18/2020	7:22:00 AM
BRTWD-1734	Home Economics	1051	Room 104	EC	11/18/2020	7:25:00 AM
BRTWD-1735	Home Economics	1051	Room 104	EC	11/18/2020	7:25:00 AM
BRTWD-1736	Home Economics	1051	Room 104	EC	11/18/2020	7:26:00 AM
BRTWD-1737	Home Economics	1051	Room 104	EC	11/18/2020	7:26:00 AM
BRTWD-1738	Storage	1051A	Room 104 Storage	CF	11/18/2020	7:27:00 AM
BRTWD-1748	Bathroom	2003	Girls Bathroom	BF	11/18/2020	7:34:00 AM
BRTWD-1749	Bathroom	2003	Girls Bathroom	BF	11/18/2020	7:35:00 AM
BRTWD-1750	Bathroom	2003	Girls Bathroom	BF	11/18/2020	7:35:00 AM
BRTWD-1752	Bathroom	2005	Boys Bathroom	BF	11/18/2020	7:38:00 AM
BRTWD-1753	Bathroom	2005	Boys Bathroom	BF	11/18/2020	7:38:00 AM
BRTWD-1756	Hallway	2018	Corridor Near Room 228 (2008)	DW	11/18/2020	7:40:00 AM
BRTWD-1758	Classroom	2009	Room 223	CF	11/18/2020	7:42:00 AM

Building Address PB 200.5 DOZ
350 Wicks Road
Brentwood, NY 11717
12/18/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Akina Castelli
Samplers Signature: Akina Castelli
JCB Project Manager: Meghan Gwynn

OrderID: 062021553



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: North Middle School

NMS

062 021553

Page 4 of 4

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1759	Classroom	2010	Room 226	CF	11/18/2020	7:43:00 AM
BRTWD-1761	Hallway	2018	Corridor Near Room 220 (2016)	DW	11/18/2020	7:44:00 AM
BRTWD-1766	Hallway	N/A	Corridor Near Faculty Bathrooms	WC	11/18/2020	7:46:00 AM
BRTWD-1767	Hallway	N/A	Corridor Near Faculty Bathrooms	WC	11/18/2020	7:46:00 AM
BRTWD-1773	Hallway	N/A	Corridor Near Room 246	WC	11/18/2020	7:49:00 AM
BRTWD-1774	Hallway	N/A	Corridor Near Room 246	WC	11/18/2020	7:49:00 AM
BRTWD-1775	Hallway	2043	Corridor Near Room 216 (2021)	DW	11/18/2020	7:52:00 AM
BRTWD-1776	Office	2023A	Library Work Room	CF	11/18/2020	7:55:00 AM
BRTWD-1777	Hallway	2043	Corridor Near Stairwell (2030)	DW	11/18/2020	7:56:00 AM
BRTWD-1783	Bathroom	2038	Women's Faculty Bathroom	BF	11/18/2020	7:58:00 AM
BRTWD-1784	Bathroom	2038	Women's Faculty Bathroom	BF	11/18/2020	7:58:00 AM

Samples Submitted 65

ANALYTICAL, INC.
151 ACADEMICAL BLVD.
CARLE PLACE, NY
20 NOV 18 PM 4:14

Building Address

350 Wicks Road

Brentwood, NY 11717

Pb 200.5 007
12/18/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

A. Lina Castelluzzo
Alicia Castelluzzo
Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/18/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45270, North Middle School, Brentwood Union Free School
District, 350 Wicks Road, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062021553. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1664 **Collected:** 11/18/2020 **Lab ID:** 062021553-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1665 **Collected:** 11/18/2020 **Lab ID:** 062021553-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1666 **Collected:** 11/18/2020 **Lab ID:** 062021553-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	58	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1667 **Collected:** 11/18/2020 **Lab ID:** 062021553-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1668 **Collected:** 11/18/2020 **Lab ID:** 062021553-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1675 **Collected:** 11/18/2020 **Lab ID:** 062021553-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1676 **Collected:** 11/18/2020 **Lab ID:** 062021553-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1677 **Collected:** 11/18/2020 **Lab ID:** 062021553-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1677		Collected:	11/18/2020	Lab ID:	062021553-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1678		Collected:	11/18/2020	Lab ID:	062021553-0009	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1683		Collected:	11/18/2020	Lab ID:	062021553-0010	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1689		Collected:	11/18/2020	Lab ID:	062021553-0011	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1690		Collected:	11/18/2020	Lab ID:	062021553-0012	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1691		Collected:	11/18/2020	Lab ID:	062021553-0013	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1692		Collected:	11/18/2020	Lab ID:	062021553-0014	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1693		Collected:	11/18/2020	Lab ID:	062021553-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1693		Collected:	11/18/2020	Lab ID:	062021553-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1694		Collected:	11/18/2020	Lab ID:	062021553-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1695		Collected:	11/18/2020	Lab ID:	062021553-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1696		Collected:	11/18/2020	Lab ID:	062021553-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1697		Collected:	11/18/2020	Lab ID:	062021553-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1698		Collected:	11/18/2020	Lab ID:	062021553-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1699		Collected:	11/18/2020	Lab ID:	062021553-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1700		Collected:	11/18/2020	Lab ID:	062021553-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1700 **Collected:** 11/18/2020 **Lab ID:** 062021553-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1701 **Collected:** 11/18/2020 **Lab ID:** 062021553-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1704 **Collected:** 11/18/2020 **Lab ID:** 062021553-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1707 **Collected:** 11/18/2020 **Lab ID:** 062021553-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1708 **Collected:** 11/18/2020 **Lab ID:** 062021553-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1709 **Collected:** 11/18/2020 **Lab ID:** 062021553-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1710 **Collected:** 11/18/2020 **Lab ID:** 062021553-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1711		Collected:	11/18/2020	Lab ID:	062021553-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1712		Collected:	11/18/2020	Lab ID:	062021553-0030	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1713		Collected:	11/18/2020	Lab ID:	062021553-0031	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1714		Collected:	11/18/2020	Lab ID:	062021553-0032	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1715		Collected:	11/18/2020	Lab ID:	062021553-0033	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1719		Collected:	11/18/2020	Lab ID:	062021553-0034	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1720		Collected:	11/18/2020	Lab ID:	062021553-0035	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1721		Collected:	11/18/2020	Lab ID:	062021553-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1721 **Collected:** 11/18/2020 **Lab ID:** 062021553-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1724 **Collected:** 11/18/2020 **Lab ID:** 062021553-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1725 **Collected:** 11/18/2020 **Lab ID:** 062021553-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1726 **Collected:** 11/18/2020 **Lab ID:** 062021553-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1727 **Collected:** 11/18/2020 **Lab ID:** 062021553-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.6	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1728 **Collected:** 11/18/2020 **Lab ID:** 062021553-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1729 **Collected:** 11/18/2020 **Lab ID:** 062021553-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1734 **Collected:** 11/18/2020 **Lab ID:** 062021553-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1734 **Collected:** 11/18/2020 **Lab ID:** 062021553-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1735 **Collected:** 11/18/2020 **Lab ID:** 062021553-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1736 **Collected:** 11/18/2020 **Lab ID:** 062021553-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1737 **Collected:** 11/18/2020 **Lab ID:** 062021553-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1738 **Collected:** 11/18/2020 **Lab ID:** 062021553-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	39	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1748 **Collected:** 11/18/2020 **Lab ID:** 062021553-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1749 **Collected:** 11/18/2020 **Lab ID:** 062021553-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1750 **Collected:** 11/18/2020 **Lab ID:** 062021553-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1750		Collected:	11/18/2020	Lab ID:	062021553-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1752		Collected:	11/18/2020	Lab ID:	062021553-0051	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1753		Collected:	11/18/2020	Lab ID:	062021553-0052	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1756		Collected:	11/18/2020	Lab ID:	062021553-0053	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1758		Collected:	11/18/2020	Lab ID:	062021553-0054	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1759		Collected:	11/18/2020	Lab ID:	062021553-0055	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1761		Collected:	11/18/2020	Lab ID:	062021553-0056	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1766		Collected:	11/18/2020	Lab ID:	062021553-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/18/2020 04:14 PM
 Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1766		Collected:	11/18/2020	Lab ID:	062021553-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1767		Collected:	11/18/2020	Lab ID:	062021553-0058	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1773		Collected:	11/18/2020	Lab ID:	062021553-0059	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1774		Collected:	11/18/2020	Lab ID:	062021553-0060	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1775		Collected:	11/18/2020	Lab ID:	062021553-0061	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1776		Collected:	11/18/2020	Lab ID:	062021553-0062	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1777		Collected:	11/18/2020	Lab ID:	062021553-0063	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/16/2020	AM	12/18/2020	DI
Client Sample Description		BRTWD-1783		Collected:	11/18/2020	Lab ID:	062021553-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021553

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/18/2020 04:14 PM
Collected: 11/18/2020

Project: #19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1783 **Collected:** 11/18/2020 **Lab ID:** 062021553-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Client Sample Description BRTWD-1784 **Collected:** 11/18/2020 **Lab ID:** 062021553-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/16/2020	AM	12/18/2020	DI

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: North Middle School

NMS

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1666	Bathroom	1008B	Auditorium Lobby Women's Bathroom	BF	5/6/2021	7:41:00 AM
BRTWD-1738	Storage	1051A	Room 104 Storage	CF	5/7/2021	7:39:00 AM

Samples Submitted 2

062108234

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 7 PM 3:47

Building Address

350 Wicks Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: [Signature]Signature: [Signature]Samplers Name: Erin TodziaSamplers Signature: [Signature]JCB Project Manager: Meghan Owyne



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/7/2021. The results are tabulated on the attached data pages for the following client designated project:

**19-45270, North Middle School, Brentwood Union Free School
District, 350 Wicks Road, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062108234. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108234

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/07/21 3:47 PM
Collected: 5/6/2021

Project: 19-45270, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1666 **Collected:** 5/6/2021 **Lab ID:** 062108234-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD-1738 **Collected:** 5/6/2021 **Lab ID:** 062108234-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.4	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062121667

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: North Middle School

NMS

Client:

Brentwood Union Free School District

Retest/New Install M

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3005	CR	2019	Room 218 Life Skills	EC	10/28/2021	7:32:00 AM

Samples Submitted 1

200.5
Tung
11/2/21

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 OCT 28 P 12:06

Building Address

350 Wicks Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Unique Mercury

Signature: LMSamplers Name: Meghan GwynnSamplers Signature: Meghan GwynnJCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

11/2/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/28/2021. The results are tabulated on the attached data pages for the following client designated project:

North Middle School, 350 Wicks Road, Brentwood, NY 11717,
Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062121667. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062121667

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/28/2021 12:06 PM
Collected: 10/28/2021

Project: **North Middle School, 350 Wicks Road, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-3005 **Collected:** 10/28/2021 **Lab ID:** 062121667-0001
Room 218 Life Skills

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	11/2/2021	TH	11/2/2021	TH
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246
Building: North Middle School
NMS

062222200

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3028	HA	1057	Corridor Near Elevator	WC	10/18/2022	7:31:00 AM
BRTWD-3029	HA	1057	Corridor Near Elevator	WF	10/18/2022	7:32:00 AM
BRTWD-3030	HA	N/A	Corridor Near Bathrooms (New Construction)	WC	10/18/2022	7:34:00 AM
BRTWD-3031	HA	N/A	Corridor Near Bathrooms (New Construction)	WF	10/18/2022	7:35:00 AM
BRTWD-3032	HA	1008	Corridor Near Auditorium (1005)	WC	10/18/2022	7:37:00 AM
BRTWD-3033	HA	1008	Corridor Near Auditorium (1005)	WF	10/18/2022	7:38:00 AM
BRTWD-3034	HA	2043	Corridor Near Room 216 (2021)	WC	10/18/2022	7:42:00 AM
BRTWD-3035	HA	2043	Corridor Near Room 216 (2021)	WF	10/18/2022	7:43:00 AM
BRTWD-3036	HA	N/A	Corridor Near Faculty Bathrooms (New Construction)	WC	10/18/2022	7:45:00 AM
BRTWD-3037	HA	N/A	Corridor Near Faculty Bathrooms (New Construction)	WF	10/18/2022	7:46:00 AM

Samples Submitted 10

RECEIVED
EHEALTH
LABORATORY, INC.
10/18/2022 12:26 PM
10/18/2022 12:26 PM

Building Address
350 Wicks Road
Brentwood, NY 11717

Analysis Type: ELAP 200.5
Lab Received: Alex Baker 10/18/22
Signature: [Signature] 12:26 PM

Samplers Name: Meghan Gwynn
Samplers Signature: [Signature]
JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

10/22/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/18/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 21-48246, North Middle School, Brentwood Union Free School
District, 350 Wicks Road, Brentwood NY 11717

The reference number for these samples is EMSL Order #062222200. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062222200

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/18/2022 12:26 PM
 Collected: 10/18/2022

Project: #: 21-48246, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3028 **Collected:** 10/18/2022 **Lab ID:** 062222200-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3029 **Collected:** 10/18/2022 **Lab ID:** 062222200-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3030 **Collected:** 10/18/2022 **Lab ID:** 062222200-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3031 **Collected:** 10/18/2022 **Lab ID:** 062222200-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3032 **Collected:** 10/18/2022 **Lab ID:** 062222200-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	6.0 µg/L	10/21/2022	CM	10/22/2022	CM

Lead MDL: 2.0µg/L

Client Sample Description BRTWD-3033 **Collected:** 10/18/2022 **Lab ID:** 062222200-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3034 **Collected:** 10/18/2022 **Lab ID:** 062222200-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3035 **Collected:** 10/18/2022 **Lab ID:** 062222200-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062222200

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/18/2022 12:26 PM
Collected: 10/18/2022

Project: #: 21-48246, North Middle School, Brentwood Union Free School District, 350 Wicks Road, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3035 **Collected:** 10/18/2022 **Lab ID:** 062222200-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3036 **Collected:** 10/18/2022 **Lab ID:** 062222200-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3037 **Collected:** 10/18/2022 **Lab ID:** 062222200-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for 062021127

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 1 of 7

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1187	Classroom	1001	Room 32	CF	11/10/2020	5:51:00 AM
BRTWD-1188	Classroom	1001	Room 32	DW	11/10/2020	5:51:00 AM
BRTWD-1189	Classroom	1002	Room 33	CF	11/10/2020	5:53:00 AM
BRTWD-1190	Classroom	1002	Room 33	DW	11/10/2020	5:53:00 AM
BRTWD-1191	Classroom	1003	Room 30	CF	11/10/2020	5:54:00 AM
BRTWD-1192	Classroom	1003	Room 30	DW	11/10/2020	5:54:00 AM
BRTWD-1193	Classroom	1004	Room 31	CF	11/10/2020	5:56:00 AM
BRTWD-1194	Classroom	1004	Room 31	DW	11/10/2020	5:56:00 AM
BRTWD-1195	Classroom	1005	Room 28	CF	11/10/2020	5:58:00 AM
BRTWD-1196	Classroom	1005	Room 28	DW	11/10/2020	5:58:00 AM
BRTWD-1197	Classroom	1006	Room 29	CF	11/10/2020	5:59:00 AM
BRTWD-1198	Classroom	1006	Room 29	DW	11/10/2020	6:00:00 AM
BRTWD-1199	Classroom	1007	Room 27	CF	11/10/2020	6:02:00 AM
BRTWD-1200	Classroom	1007	Room 27	DW	11/10/2020	6:02:00 AM
BRTWD-1201	Bathroom	1012	Faculty Bathroom	BF	11/10/2020	6:04:00 AM
BRTWD-1202	Bathroom	1013	Student Bathroom	BF	11/10/2020	6:04:00 AM
BRTWD-1204	Bathroom	1030C	Gym Locker Room Bathroom	BF	11/10/2020	6:16:00 AM
BRTWD-1205	Office	1024A	Principal's Office	BW	11/10/2020	6:10:00 AM

Building Address

2 Devon Road

Brentwood, NY 11717

Pb200.5 -

A. Perry 12/03/20

Analysis Type: ELAP 200.5 AD

Lab Received: Katherine Vlach 11-10-2020

Signature: *AK* 5:00 PM

Samplers Name: *Alicia Caspell*

Samplers Signature: *Alicia Caspell*

JCB Project Manager: *Megan Gwynn*

RECEIVED
ANALYTICAL
LABORATORY
NOV 11 2020
P 5:56

OrderID: 062021127



Lead in Water: Chain of Custody for

062021127

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 2 of 7

OrderID: 062021127

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1206	Bathroom	1025	Men's Bathroom	BF	11/10/2020	6:11:00 AM
BRTWD-1208	Bathroom	1028	Women's Bathroom	BF	11/10/2020	6:12:00 AM
BRTWD-1209	Hallway	1032	Corridor Near Custodial Closet 10A (1027)	WC	11/10/2020	6:12:00 AM
BRTWD-1210	Nurse Office	1031	Nurse's Office	NS	11/10/2020	6:14:00 AM
BRTWD-1211	Bathroom	1031A	Nurse's Office Bathroom	BF	11/10/2020	6:14:00 AM
BRTWD-1218	Classroom	1037	Room 15	CF	11/10/2020	6:16:00 AM
BRTWD-1219	Classroom	1037	Room 15	DW	11/10/2020	6:16:00 AM
BRTWD-1220	Classroom	1038	Room 16	CF	11/10/2020	6:18:00 AM
BRTWD-1221	Classroom	1038	Room 16	DW	11/10/2020	6:18:00 AM
BRTWD-1222	Classroom	1039	Room 17	CF	11/10/2020	6:20:00 AM
BRTWD-1223	Classroom	1039	Room 17	DW	11/10/2020	6:20:00 AM
BRTWD-1224	Classroom	1040	Room 18	CF	11/10/2020	6:22:00 AM
BRTWD-1225	Classroom	1040	Room 18	DW	11/10/2020	6:22:00 AM
BRTWD-1226	Classroom	1041	Room 19	CF	11/10/2020	6:24:00 AM
BRTWD-1227	Classroom	1041	Room 19	DW	11/10/2020	6:24:00 AM
BRTWD-1228	Classroom	1042	Room 20	CF	11/10/2020	6:26:00 AM
BRTWD-1229	Classroom	1042	Room 20	DW	11/10/2020	6:26:00 AM
BRTWD-1230	Bathroom	1045A	Room 20A Bathroom	BF	11/10/2020	6:28:00 AM

Building Address

2 Devon Road

Brentwood, NY 11717

Pb 200.5 -
A. Lum 12/31/20

Analysis Type: ELAP 200.5 (A)

Lab Received: Katherine Viana 11-10-20

Signature: OK Diana 5:06 PM

Samplers Name: Alika Castelluzzo

Samplers Signature: Alika Castelluzzo

JCB Project Manager: Megan Gwynn



Lead in Water: Chain of Custody for 062021127

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 3 of 7

OrderID: 062021127

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1231	Classroom	1047	Room 21	CF	11/10/2020	6:30:00 AM
BRTWD-1232	Classroom	1047	Room 21	DW	11/10/2020	6:30:00 AM
BRTWD-1233	Classroom	1048	Room 22	CF	11/10/2020	6:33:00 AM
BRTWD-1234	Classroom	1048	Room 22	DW	11/10/2020	6:33:00 AM
BRTWD-1235	Classroom	1049	Room 23	CF	11/10/2020	6:35:00 AM
BRTWD-1236	Classroom	1049	Room 23	DW	11/10/2020	6:35:00 AM
BRTWD-1237	Classroom	1050	Room 24	CF	11/10/2020	6:36:00 AM
BRTWD-1238	Classroom	1050	Room 24	DW	11/10/2020	6:37:00 AM
BRTWD-1239	Classroom	1051	Room 25	CF	11/10/2020	6:38:00 AM
BRTWD-1240	Classroom	1051	Room 25	DW	11/10/2020	6:39:00 AM
BRTWD-1241	Classroom	1052	Room 26	CF	11/10/2020	6:41:00 AM
BRTWD-1242	Classroom	1052	Room 26	DW	11/10/2020	6:41:00 AM
BRTWD-1243	Classroom	N/A	Room 410	CF	11/10/2020	6:43:00 AM
BRTWD-1244	Classroom	N/A	Room 410	DW	11/10/2020	6:43:00 AM
BRTWD-1245	Classroom	N/A	Room 412	CF	11/10/2020	6:45:00 AM
BRTWD-1246	Classroom	N/A	Room 412	DW	11/10/2020	6:45:00 AM
BRTWD-1251	Hallway	N/A	Corridor Near Bathrooms	WC	11/10/2020	6:45:00 AM
BRTWD-1252	Bathroom	N/A	Faculty Bathroom	BF	11/10/2020	6:45:00 AM

RECEIVED
ANALYTICAL
LAB
11/11/20
J.C. BRODERICK & ASSOCIATES, INC.

Building Address Pb 200.5 -

2 Devon Road

Brentwood, NY 11717

A. J. J. 12/03/20

Analysis Type: ELAP 200.5 (A)

Lab Recieved: Katherine Vind 11-10-20

Signature: Dr. [Signature] 5:06 PM

Samplers Name: Arika Castelluzzo

Samplers Signature: [Signature]

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Northeast Elementary School
NES

062021127

Page 4 of 7

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1255	Classroom	N/A	Room 414	DW	11/10/2020	6:47:00 AM
BRTWD-1256	Classroom	N/A	Room 414	CF	11/10/2020	6:48:00 AM
BRTWD-1257	Classroom	N/A	Room 416	DW	11/10/2020	6:49:00 AM
BRTWD-1258	Classroom	N/A	Room 416	CF	11/10/2020	6:50:00 AM
BRTWD-1259	Faculty Lounge	1055	Faculty Room 8	CF	11/10/2020	6:54:00 AM
BRTWD-1260	Faculty Lounge	1055	Faculty Room 8	BW	11/10/2020	6:55:00 AM
BRTWD-1261	Classroom	1056	Room 6	DW	11/10/2020	6:57:00 AM
BRTWD-1262	Classroom	1056	Room 6	CF	11/10/2020	6:57:00 AM
BRTWD-1263	Classroom	1057	Room 5	CF	11/10/2020	6:59:00 AM
BRTWD-1264	Classroom	1057	Room 5	DW	11/10/2020	6:59:00 AM
BRTWD-1265	Classroom	1058	Room 4	CF	11/10/2020	7:01:00 AM
BRTWD-1266	Classroom	1058	Room 4	DW	11/10/2020	7:01:00 AM
BRTWD-1267	Classroom	1060	Room 1	CF	11/10/2020	7:03:00 AM
BRTWD-1269	Classroom	1061	Room 2	CF	11/10/2020	7:05:00 AM
BRTWD-1270	Classroom	1061	Room 2	DW	11/10/2020	7:05:00 AM
BRTWD-1271	Kitchen	1067	Annex Kitchen	HW	11/10/2020	7:07:00 AM
BRTWD-1272	Kitchen	1067	Annex Kitchen	KC	11/10/2020	7:09:00 AM
BRTWD-1273	Kitchen	1067	Annex Kitchen	SN	11/10/2020	7:09:00 AM

Building Address Pb200.5 -

2 Devon Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5 AD


Lab Received: Katherine Vland 11-10-20

Signature: ORVland 5:06 PM

Samplers Name: Alina Castedumpe

Samplers Signature: Alina Castedumpe

JCB Project Manager: Megan Gwynn



Lead in Water: Chain of Custody for

062021127

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1274	Kitchen	1067	Annex Kitchen	KC	11/10/2020	7:10:00 AM
BRTWD-1275	Bathroom	1065	Student Bathroom	BF	11/10/2020	7:11:00 AM
BRTWD-1276	Bathroom	1066	Faculty Bathroom	BF	11/10/2020	7:11:00 AM
BRTWD-1278	Hallway	1085	Corridor Near Speech Room (1070)	WC	11/10/2020	7:13:00 AM
BRTWD-1279	Classroom	1071	Room 9A	CF	11/10/2020	7:15:00 AM
BRTWD-1280	Classroom	1071	Room 9A	DW	11/10/2020	7:15:00 AM
BRTWD-1281	Classroom	1072	Room 12A	CF	11/10/2020	7:17:00 AM
BRTWD-1282	Classroom	1072	Room 12A	DW	11/10/2020	7:17:00 AM
BRTWD-1283	Classroom	1073	Room 7A	CF	11/10/2020	7:20:00 AM
BRTWD-1284	Classroom	1073	Room 7A	DW	11/10/2020	7:20:00 AM
BRTWD-1285	Classroom	1074	Room 10A	CF	11/10/2020	7:21:00 AM
BRTWD-1286	Classroom	1074	Room 10A	DW	11/10/2020	7:21:00 AM
BRTWD-1287	Classroom	1075	Room 5A	CF	11/10/2020	7:25:00 AM
BRTWD-1288	Classroom	1075	Room 5A	DW	11/10/2020	7:25:00 AM
BRTWD-1289	Bathroom	1075B	Room 5A Bathroom	BF	11/10/2020	7:27:00 AM
BRTWD-1290	Classroom	1077	Room 8A	CF	11/10/2020	7:28:00 AM
BRTWD-1292	Classroom	1078	Room 6A	CF	11/10/2020	7:30:00 AM
BRTWD-1294	Classroom	1079	Room 3A	CF	11/10/2020	7:30:00 AM

Building Address P200.5 -

2 Devon Road

Brentwood, NY 11771

Analysis Type: ELAP 200.5 (A)

Lab Received: Katherine Vixod 11-10-20

Signature: ORobinson 5:06 PM

Samplers Name: Aliya Castelli 11/20

Samplers Signature: Aliya Castelli

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

062021127

Page 6 of 7

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1295	Classroom	1079	Room 3A	DW	11/10/2020	7:31:00 AM
BRTWD-1296	Bathroom	1079A	Room 3A Bathroom	BF	11/10/2020	7:32:00 AM
BRTWD-1298	Classroom	1081	Room 4A	CF	11/10/2020	7:34:00 AM
BRTWD-1299	Classroom	1081	Room 4A	DW	11/10/2020	7:34:00 AM
BRTWD-1300	Classroom	1082	Room 2A	CF	11/10/2020	7:36:00 AM
BRTWD-1301	Classroom	1082	Room 2A	DW	11/10/2020	7:36:00 AM
BRTWD-1302	Classroom	1083	Room 1A	CF	11/10/2020	7:38:00 AM
BRTWD-1303	Classroom	1083	Room 1A	DW	11/10/2020	7:38:00 AM
BRTWD-1304	Bathroom	1083B	Room 1A Bathroom	BF	11/10/2020	7:40:00 AM
BRTWD-1305	Cafeteria	1018	Cafeteria	WC	11/10/2020	5:37:00 AM
BRTWD-1306	Kitchen	1018B	Kitchen	KC	11/10/2020	5:41:00 AM
BRTWD-1307	Kitchen	1018B	Kitchen	SN	11/10/2020	5:42:00 AM
BRTWD-1309	Kitchen	1018B	Kitchen	KC	11/10/2020	5:44:00 AM
BRTWD-1310	Kitchen	1018B	Kitchen	HW	11/10/2020	5:45:00 AM
BRTWD-1311	Kitchen	1018B	Kitchen	PK	11/10/2020	5:46:00 AM
BRTWD-1312	Kitchen	1018B	Kitchen	KC	11/10/2020	5:47:00 AM
BRTWD-1313	Bathroom	1018B2	Kitchen Bathroom	BF	11/10/2020	5:47:00 AM
BRTWD-1317	Classroom	2009	Room 34	CF	11/10/2020	7:46:00 AM

Building Address

Pb200.5 -

2 Devon Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5 AV

Lab Received: Katherine Viaud 11-10-20

Signature: OK 5:06 PM

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

062021127

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 7 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1318	Classroom	2009	Room 34	DW	11/10/2020	7:47:00 AM
BRTWD-1319	Classroom	2010	Room 35	CF	11/10/2020	7:47:00 AM
BRTWD-1320	Classroom	2010	Room 35	DW	11/10/2020	7:47:00 AM
BRTWD-1321	Classroom	2008	Room 37	CF	11/10/2020	7:49:00 AM
BRTWD-1322	Classroom	2008	Room 37	DW	11/10/2020	7:49:00 AM
BRTWD-1323	Classroom	2007	Room 36	CF	11/10/2020	7:50:00 AM
BRTWD-1324	Classroom	2007	Room 36	DW	11/10/2020	7:50:00 AM
BRTWD-1325	Classroom	2006	Room 39	CF	11/10/2020	7:52:00 AM
BRTWD-1326	Classroom	2006	Room 39	DW	11/10/2020	7:52:00 AM
BRTWD-1327	Classroom	2005	Room 38	CF	11/10/2020	7:54:00 AM
BRTWD-1328	Classroom	2005	Room 38	DW	11/10/2020	7:54:00 AM
BRTWD-1329	Classroom	2003	Room 40	CF	11/10/2020	7:55:00 AM
BRTWD-1330	Classroom	2003	Room 40	DW	11/10/2020	7:56:00 AM

Samples Submitted 121

RECEIVED
ANALYTICAL, INC.
11/10/20
10 PM 5:06
STATE PLACE, NY

Building Address

2 Devon Road

Brentwood, NY 11717

10200.5-

A. L... 12/03/20

Analysis Type: ELAP 200.5

Lab Received: Katherine Vard 11-10-20

Signature: *OK* 5:06 PM

Samplers Name: Alina Coste 11/10/20

Samplers Signature: *Alina Coste*

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/10/2020. The results are tabulated on the attached data pages for the following client designated project:

19-45270, Brentwood Union Free School District, Northeast
Elementary School NES, 2 Devon Road, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062021127. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1187 **Collected:** 11/10/2020 **Lab ID:** 062021127-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1188 **Collected:** 11/10/2020 **Lab ID:** 062021127-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1189 **Collected:** 11/10/2020 **Lab ID:** 062021127-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1190 **Collected:** 11/10/2020 **Lab ID:** 062021127-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1191 **Collected:** 11/10/2020 **Lab ID:** 062021127-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1192 **Collected:** 11/10/2020 **Lab ID:** 062021127-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1193 **Collected:** 11/10/2020 **Lab ID:** 062021127-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1194 **Collected:** 11/10/2020 **Lab ID:** 062021127-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1194 **Collected:** 11/10/2020 **Lab ID:** 062021127-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	130	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1195 **Collected:** 11/10/2020 **Lab ID:** 062021127-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1196 **Collected:** 11/10/2020 **Lab ID:** 062021127-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1197 **Collected:** 11/10/2020 **Lab ID:** 062021127-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1198 **Collected:** 11/10/2020 **Lab ID:** 062021127-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1199 **Collected:** 11/10/2020 **Lab ID:** 062021127-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1200 **Collected:** 11/10/2020 **Lab ID:** 062021127-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1201		Collected:	11/10/2020	Lab ID:	062021127-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1202		Collected:	11/10/2020	Lab ID:	062021127-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1204		Collected:	11/10/2020	Lab ID:	062021127-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.5	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Client Sample Description		BRTWD-1205		Collected:	11/10/2020	Lab ID:	062021127-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Client Sample Description		BRTWD-1206		Collected:	11/10/2020	Lab ID:	062021127-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1208		Collected:	11/10/2020	Lab ID:	062021127-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Client Sample Description		BRTWD-1209		Collected:	11/10/2020	Lab ID:	062021127-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1210 **Collected:** 11/10/2020 **Lab ID:** 062021127-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1211 **Collected:** 11/10/2020 **Lab ID:** 062021127-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1218 **Collected:** 11/10/2020 **Lab ID:** 062021127-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1219 **Collected:** 11/10/2020 **Lab ID:** 062021127-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1220 **Collected:** 11/10/2020 **Lab ID:** 062021127-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1221 **Collected:** 11/10/2020 **Lab ID:** 062021127-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1222 **Collected:** 11/10/2020 **Lab ID:** 062021127-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1223 **Collected:** 11/10/2020 **Lab ID:** 062021127-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1224 **Collected:** 11/10/2020 **Lab ID:** 062021127-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.5	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1225 **Collected:** 11/10/2020 **Lab ID:** 062021127-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1226 **Collected:** 11/10/2020 **Lab ID:** 062021127-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1227 **Collected:** 11/10/2020 **Lab ID:** 062021127-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1228 **Collected:** 11/10/2020 **Lab ID:** 062021127-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1229 **Collected:** 11/10/2020 **Lab ID:** 062021127-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1230 **Collected:** 11/10/2020 **Lab ID:** 062021127-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1231 **Collected:** 11/10/2020 **Lab ID:** 062021127-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1232 **Collected:** 11/10/2020 **Lab ID:** 062021127-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1233 **Collected:** 11/10/2020 **Lab ID:** 062021127-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1234 **Collected:** 11/10/2020 **Lab ID:** 062021127-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1235 **Collected:** 11/10/2020 **Lab ID:** 062021127-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1236 **Collected:** 11/10/2020 **Lab ID:** 062021127-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1237 **Collected:** 11/10/2020 **Lab ID:** 062021127-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1238 **Collected:** 11/10/2020 **Lab ID:** 062021127-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1239 **Collected:** 11/10/2020 **Lab ID:** 062021127-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1240 **Collected:** 11/10/2020 **Lab ID:** 062021127-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1241 **Collected:** 11/10/2020 **Lab ID:** 062021127-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1242 **Collected:** 11/10/2020 **Lab ID:** 062021127-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1243 **Collected:** 11/10/2020 **Lab ID:** 062021127-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1244 **Collected:** 11/10/2020 **Lab ID:** 062021127-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1244 **Collected:** 11/10/2020 **Lab ID:** 062021127-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1245 **Collected:** 11/10/2020 **Lab ID:** 062021127-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1246 **Collected:** 11/10/2020 **Lab ID:** 062021127-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1251 **Collected:** 11/10/2020 **Lab ID:** 062021127-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1252 **Collected:** 11/10/2020 **Lab ID:** 062021127-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1255 **Collected:** 11/10/2020 **Lab ID:** 062021127-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1256 **Collected:** 11/10/2020 **Lab ID:** 062021127-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1257 **Collected:** 11/10/2020 **Lab ID:** 062021127-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1257		Collected:	11/10/2020	Lab ID:	062021127-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1258		Collected:	11/10/2020	Lab ID:	062021127-0058	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Client Sample Description		BRTWD-1259		Collected:	11/10/2020	Lab ID:	062021127-0059	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Client Sample Description		BRTWD-1260		Collected:	11/10/2020	Lab ID:	062021127-0060	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1261		Collected:	11/10/2020	Lab ID:	062021127-0061	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1262		Collected:	11/10/2020	Lab ID:	062021127-0062	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/3/2020	AL
Client Sample Description		BRTWD-1263		Collected:	11/10/2020	Lab ID:	062021127-0063	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1264 **Collected:** 11/10/2020 **Lab ID:** 062021127-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1265 **Collected:** 11/10/2020 **Lab ID:** 062021127-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1266 **Collected:** 11/10/2020 **Lab ID:** 062021127-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1267 **Collected:** 11/10/2020 **Lab ID:** 062021127-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1269 **Collected:** 11/10/2020 **Lab ID:** 062021127-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1270 **Collected:** 11/10/2020 **Lab ID:** 062021127-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1271 **Collected:** 11/10/2020 **Lab ID:** 062021127-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	240	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1272 **Collected:** 11/10/2020 **Lab ID:** 062021127-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1273 **Collected:** 11/10/2020 **Lab ID:** 062021127-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	82	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1274 **Collected:** 11/10/2020 **Lab ID:** 062021127-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	57	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1275 **Collected:** 11/10/2020 **Lab ID:** 062021127-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1276 **Collected:** 11/10/2020 **Lab ID:** 062021127-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1278 **Collected:** 11/10/2020 **Lab ID:** 062021127-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1279 **Collected:** 11/10/2020 **Lab ID:** 062021127-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1280 **Collected:** 11/10/2020 **Lab ID:** 062021127-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	12/2/2020	DI	12/3/2020	AL

Client Sample Description BRTWD-1281 **Collected:** 11/10/2020 **Lab ID:** 062021127-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1282 **Collected:** 11/10/2020 **Lab ID:** 062021127-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/2/2020	DI	12/3/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1283 **Collected:** 11/10/2020 **Lab ID:** 062021127-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	39	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1284 **Collected:** 11/10/2020 **Lab ID:** 062021127-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1285 **Collected:** 11/10/2020 **Lab ID:** 062021127-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/2/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1286 **Collected:** 11/10/2020 **Lab ID:** 062021127-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1287 **Collected:** 11/10/2020 **Lab ID:** 062021127-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1288 **Collected:** 11/10/2020 **Lab ID:** 062021127-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1289 **Collected:** 11/10/2020 **Lab ID:** 062021127-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1290 **Collected:** 11/10/2020 **Lab ID:** 062021127-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1292 **Collected:** 11/10/2020 **Lab ID:** 062021127-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1294 **Collected:** 11/10/2020 **Lab ID:** 062021127-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1295 **Collected:** 11/10/2020 **Lab ID:** 062021127-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1296 **Collected:** 11/10/2020 **Lab ID:** 062021127-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1296 **Collected:** 11/10/2020 **Lab ID:** 062021127-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	190	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1298 **Collected:** 11/10/2020 **Lab ID:** 062021127-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1299 **Collected:** 11/10/2020 **Lab ID:** 062021127-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	12/2/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1300 **Collected:** 11/10/2020 **Lab ID:** 062021127-0095

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	12/2/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1301 **Collected:** 11/10/2020 **Lab ID:** 062021127-0096

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1302 **Collected:** 11/10/2020 **Lab ID:** 062021127-0097

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1303 **Collected:** 11/10/2020 **Lab ID:** 062021127-0098

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1304		Collected:	11/10/2020	Lab ID:	062021127-0099	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	180	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1305		Collected:	11/10/2020	Lab ID:	062021127-0100	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1306		Collected:	11/10/2020	Lab ID:	062021127-0101	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1307		Collected:	11/10/2020	Lab ID:	062021127-0102	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-1309		Collected:	11/10/2020	Lab ID:	062021127-0103	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-1310		Collected:	11/10/2020	Lab ID:	062021127-0104	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1311		Collected:	11/10/2020	Lab ID:	062021127-0105	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	30	3.0	µg/L	12/2/2020	DI	12/4/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1312 **Collected:** 11/10/2020 **Lab ID:** 062021127-0106

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1313 **Collected:** 11/10/2020 **Lab ID:** 062021127-0107

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1317 **Collected:** 11/10/2020 **Lab ID:** 062021127-0108

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	12/2/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1318 **Collected:** 11/10/2020 **Lab ID:** 062021127-0109

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1319 **Collected:** 11/10/2020 **Lab ID:** 062021127-0110

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1320 **Collected:** 11/10/2020 **Lab ID:** 062021127-0111

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1321 **Collected:** 11/10/2020 **Lab ID:** 062021127-0112

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1322 **Collected:** 11/10/2020 **Lab ID:** 062021127-0113

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/10/2020 05:06 PM
 Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1322		Collected:	11/10/2020	Lab ID:	062021127-0113	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1323		Collected:	11/10/2020	Lab ID:	062021127-0114	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	42	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1324		Collected:	11/10/2020	Lab ID:	062021127-0115	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1325		Collected:	11/10/2020	Lab ID:	062021127-0116	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1326		Collected:	11/10/2020	Lab ID:	062021127-0117	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1327		Collected:	11/10/2020	Lab ID:	062021127-0118	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Client Sample Description		BRTWD-1328		Collected:	11/10/2020	Lab ID:	062021127-0119	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	12/2/2020	DI	12/4/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1329		Collected:	11/10/2020	Lab ID:	062021127-0120	

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021127

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/10/2020 05:06 PM
Collected: 11/10/2020

Project: 19-45270, Brentwood Union Free School District, Northeast Elementary School NES, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1329 **Collected:** 11/10/2020 **Lab ID:** 062021127-0120

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/2/2020	DI	12/4/2020	AL

Client Sample Description BRTWD-1330 **Collected:** 11/10/2020 **Lab ID:** 062021127-0121

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/3/2020	DI	12/4/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062105811 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~49-45270~~ 21-48246
Building: Northeast Elementary School
NES

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1194	Classroom	1004	Room 31	DW	3/26/2021	7:53:00 AM
BRTWD-1198	Classroom	1006	Room 29	DW	3/26/2021	7:51:00 AM
BRTWD-1274	Kitchen	1067	Annex Kitchen	KC	3/26/2021	8:01:00 AM
BRTWD-1322	Classroom	2008	Room 37	DW	3/26/2021	7:56:00 AM
BRTWD-1323	Classroom	2007	Room 36	CF	3/26/2021	7:58:00 AM

Samples Submitted 5

RECEIVED
ENVIRONMENTAL ANALYTICAL, INC.
100 CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address
2 Devon Road
Brentwood, NY 11717

P6203.5-
Alvin Young 04/02/21

Analysis Type: ELAP 200.5 (4)

Lab Received: Unique McKay

Signature: _____

Samplers Name: Erin Todzia

Samplers Signature: A. Todzia

JCB Project Manager: Meghan Ouyinn

OrderID: 062105811



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/27/2021. The results are tabulated on the attached data pages for the following client designated project:

Northeast Elementary School, 2 Devon Road, Brentwood, NY
11717, Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062105811. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105811

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 3/27/2021 03:25 PM
 Collected: 3/26/2021

Project: **Northeast Elementary School, 2 Devon Road, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description		BRTWD-1194 Room 31		Collected:	3/26/2021	Lab ID:	062105811-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1198 Room 29		Collected:	3/26/2021	Lab ID:	062105811-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-1274 Annex Kitchen		Collected:	3/26/2021	Lab ID:	062105811-0003	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	480 D	30	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-1322 Room 37		Collected:	3/26/2021	Lab ID:	062105811-0004	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	4/1/2021	DI	4/2/2021	AL
Client Sample Description		BRTWD-1323 Room 36		Collected:	3/26/2021	Lab ID:	062105811-0005	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	4/1/2021	DI	4/2/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Northeast Elementary School

NES

062108244

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1304	Bathroom	1083B	Room 1A Bathroom	BF	5/7/2021	7:56:00 AM
BRTWD-1311	Kitchen	1018B	Kitchen	PK	5/7/2021	7:59:00 AM

Samples Submitted 2

RECEIVED
EMSI ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 7 PM 3:46

Building Address

2 Devon Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 5/7/21 @ 3:46 pm

Signature: [Signature]

Samplers Name: Alexandria Orllassino

Samplers Signature: A Orllassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/7/2021. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District. Northeast Elementary
School. NES. JCB # 19-45270

The reference number for these samples is EMSL Order #062108244. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108244

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/07/21 3:46 PM
Collected: 5/7/2021

Project: **Brentwood Union Free School District. Northeast Elementary School. NES. JCB # 19-45270****Analytical Results**

Client Sample Description BRTWD - 1304 **Collected:** 5/7/2021 **Lab ID:** 062108244-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	550 D	30 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1311 **Collected:** 5/7/2021 **Lab ID:** 062108244-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~49-45278~~ 21-48246

Building: Northeast Elementary School

NES

062110639

Page 1 of 1

Client:

Brentwood Union Free School District

Retest: ☒ New Install ☐

Turn Around: ☒ Normal 1 wk ☐ Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1271	Kitchen	1067	Annex Kitchen	HW	6/17/2021	7:35:00 AM
BRTWD-1273	Kitchen	1067	Annex Kitchen	SN	6/17/2021	7:36:00 AM
BRTWD-1283	Classroom	1073	Room 7A	CF	6/17/2021	7:38:00 AM
BRTWD-1324	Classroom	2007	Room 36	DW	6/17/2021	7:43:00 AM

Samples Submitted 4

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4: 08

Building Address

2 Devon Road

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: Alyssa McDonald

Signature: Alyssa McDonald

Samplers Name: Ailing Castello 6/23/20

Samplers Signature: Ailing Castello

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, Northeast Elementary School, Brentwood Union Free
School District, 2 Devon Road, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062110639. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110639

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:08 PM
Collected: 6/17/2021

Project: #21-48246, Northeast Elementary School, Brentwood Union Free School District, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1271 **Collected:** 6/17/2021 **Lab ID:** 062110639-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-1273 **Collected:** 6/17/2021 **Lab ID:** 062110639-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-1283 **Collected:** 6/17/2021 **Lab ID:** 062110639-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-1324 **Collected:** 6/17/2021 **Lab ID:** 062110639-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Northeast Elementary School

NES

062218289

Page 1 of 1

Client:

Brentwood Union Free School District

Retest New Install | |

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1274	Kitchen	1067	Annex Kitchen	KC	8/24/2022	8:20:00 AM
BRTWD-1296	Bathroom	1079A	Room 3A Bathroom	BF	8/24/2022	8:26:00 AM
BRTWD-1304	Bathroom	1083B	Room 1A Bathroom	BF	8/24/2022	8:23:00 AM

Samples Submitted 3

Pb 200.5
Cy/hi
8/24/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 24 P 12:06

Courier

Building Address

2 Devon Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 8/24/22 @ 12:06pm

Signature:

Sampler's Name: Erin Todzia

Sampler's Signature:

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2022. The results are tabulated on the attached data pages for the following client designated project:

JCB #: 21-48246, Northeast Elementary School, NES, Brentwood
Union Free School District, 2 Devon Road, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062218289. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218289

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/24/2022 12:06 PM
Collected: 8/24/2022

Project: JCB #: 21-48246, Northeast Elementary School, NES, Brentwood Union Free School District, 2 Devon Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1274 **Collected:** 8/24/2022 **Lab ID:** 062218289-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-1296 **Collected:** 8/24/2022 **Lab ID:** 062218289-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	510 D	12 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-1304 **Collected:** 8/24/2022 **Lab ID:** 062218289-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Northeast Elementary School

NES

062224980

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3055	HA	N/A	Corridor Near Bathrooms (New Construction)	WC	12/6/2022	7:17:00 AM
BRTWD-3056	HA	N/A	Corridor Near Bathrooms (New Construction)	WF	12/6/2022	7:18:00 AM
BRTWD-3057	HA	1032	Corridor Between Gym & Library	WC	12/6/2022	7:22:00 AM
BRTWD-3058	HA	1032	Corridor Between Gym & Library	WF	12/6/2022	7:23:00 AM

Samples Submitted

4

Pb 200.5

Bent AKter 12/8/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC - 6 P 2:55

Building Address

2 Devon Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Alex Kodon 12/6/22

2:55 PM

Samplers Name: Aileen McNamara

Samplers Signature: Aileen McNamara

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/8/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/6/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Northeast Elementary School, Brentwood Union
Free School District, 2 Devon Road, Brentwood NY 11717

The reference number for these samples is EMSL Order #062224980. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062224980

CustomerID: JC BR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/6/2022 02:55 PM
 Collected: 12/6/2022

Project: #: 22-53405, Northeast Elementary School, Brentwood Union Free School District, 2 Devon Road, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3055 **Collected:** 12/6/2022 **Lab ID:** 062224980-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3056 **Collected:** 12/6/2022 **Lab ID:** 062224980-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3057 **Collected:** 12/6/2022 **Lab ID:** 062224980-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3058 **Collected:** 12/6/2022 **Lab ID:** 062224980-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRÖDERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Oak Park Elementary School

OPE

062 022751

Page 1 of 6

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2753	Classroom	1001	Room 1	CF	12/3/2020	5:51:00 AM
BRTWD-2755	Classroom	1003	Room 2	CF	12/3/2020	5:53:00 AM
BRTWD-2756	Classroom	1003	Room 2	DW	12/3/2020	5:53:00 AM
BRTWD-2757	Bathroom	1003B	Room 2 Bathroom	BF	12/3/2020	5:54:00 AM
BRTWD-2758	Bathroom	1001B	Room 1 Bathroom	BF	12/3/2020	5:56:00 AM
BRTWD-2759	Classroom	1004	Room 3	CF	12/3/2020	5:58:00 AM
BRTWD-2760	Classroom	1004	Room 3	DW	12/3/2020	5:58:00 AM
BRTWD-2761	Classroom	1005	Room 4	CF	12/3/2020	5:59:00 AM
BRTWD-2762	Classroom	1005	Room 4	DW	12/3/2020	5:59:00 AM
BRTWD-2763	Classroom	1006	Room 5	CF	12/3/2020	6:00:00 AM
BRTWD-2764	Classroom	1006	Room 5	DW	12/3/2020	6:00:00 AM
BRTWD-2765	Classroom	1007	Room 6	CF	12/3/2020	6:02:00 AM
BRTWD-2766	Classroom	1007	Room 6	DW	12/3/2020	6:02:00 AM
BRTWD-2767	Classroom	1008	Room 7	CF	12/3/2020	6:03:00 AM
BRTWD-2768	Classroom	1008	Room 7	DW	12/3/2020	6:03:00 AM
BRTWD-2769	Classroom	1009	Room 8	CF	12/3/2020	6:05:00 AM
BRTWD-2770	Classroom	1009	Room 8	DW	12/3/2020	6:05:00 AM
BRTWD-2771	Classroom	1010	Room 9	CF	12/3/2020	6:06:00 AM

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

Ph 200.5 -

A. Perry 01/20/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Samplers Name: Alina Castellan

Samplers Signature: Alina Castellan

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Oak Park Elementary School

OPE

0620.22751

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk / Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2772	Classroom	1010	Room 9	DW	12/3/2020	6:06:00 AM
BRTWD-2773	Classroom	1011	Room 10	CF	12/3/2020	6:08:00 AM
BRTWD-2774	Classroom	1011	Room 10	DW	12/3/2020	6:08:00 AM
BRTWD-2775	Classroom	1012	Room 11	CF	12/3/2020	6:09:00 AM
BRTWD-2776	Classroom	1012	Room 11	DW	12/3/2020	6:09:00 AM
BRTWD-2777	Classroom	1013	Room 12	CF	12/3/2020	6:10:00 AM
BRTWD-2778	Classroom	1013	Room 12	DW	12/3/2020	6:10:00 AM
BRTWD-2779	Classroom	1015	Room 14	CF	12/3/2020	6:12:00 AM
BRTWD-2780	Classroom	1015	Room 14	DW	12/3/2020	6:12:00 AM
BRTWD-2781	Classroom	1017	Room 15	CF	12/3/2020	6:14:00 AM
BRTWD-2783	Bathroom	1023	Women's Bathroom	BF	12/3/2020	6:16:00 AM
BRTWD-2784	Hallway	1040	Corridor Outside Bathrooms (1023/1024)	WC	12/3/2020	6:17:00 AM
BRTWD-2785	Bathroom	1024	Men's Bathroom	BF	12/3/2020	6:18:00 AM
BRTWD-2787	Nurse Office	1026	Nurse's Office	NS	12/3/2020	6:20:00 AM
BRTWD-2788	Bathroom	1026B	Nurse's Office Bathroom	BF	12/3/2020	6:20:00 AM
BRTWD-2789	Nurse Office	1026A	Nurse's Office Exam Room	NS	12/3/2020	6:20:00 AM
BRTWD-2790	Faculty Lounge	1033	Faculty Room 31	CF	12/3/2020	6:22:00 AM
BRTWD-2791	Classroom	1035	Room 30	CF	12/3/2020	6:25:00 AM

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

Pb206.5-

A. Lang 11/20/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Oak Park Elementary School

OPE

062 022751

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2793	Kitchen	1038	Kitchen	KC	12/3/2020	5:36:00 AM
BRTWD-2794	Kitchen	1038	Kitchen	KC	12/3/2020	5:36:00 AM
BRTWD-2795	Kitchen	1038	Kitchen	HW	12/3/2020	5:40:00 AM
BRTWD-2796	Kitchen	1038	Kitchen	PK	12/3/2020	5:40:00 AM
BRTWD-2797	Kitchen	1038	Kitchen	SN	12/3/2020	5:43:00 AM
BRTWD-2798	Kitchen	1038	Kitchen	KC	12/3/2020	5:43:00 AM
BRTWD-2800	Kitchen	1038	Kitchen	KC	12/3/2020	5:45:00 AM
BRTWD-2801	Kitchen	1038	Kitchen	KC	12/3/2020	5:45:00 AM
BRTWD-2802	Kitchen	1038	Kitchen	HW	12/3/2020	5:46:00 AM
BRTWD-2803	Bathroom	1038A1	Kitchen Bathroom	BF	12/3/2020	5:47:00 AM
BRTWD-2812	Classroom	1047	Room 16	CF	12/3/2020	6:28:00 AM
BRTWD-2813	Classroom	1047	Room 16	DW	12/3/2020	6:28:00 AM
BRTWD-2814	Classroom	1049	Room 18	CF	12/3/2020	6:30:00 AM
BRTWD-2815	Classroom	1049	Room 18	DW	12/3/2020	6:30:00 AM
BRTWD-2816	Classroom	1050	Room 20	CF	12/3/2020	6:33:00 AM
BRTWD-2817	Classroom	1050	Room 20	DW	12/3/2020	6:33:00 AM
BRTWD-2818	Classroom	1051	Room 21	CF	12/3/2020	6:35:00 AM
BRTWD-2819	Classroom	1051	Room 21	DW	12/3/2020	6:35:00 AM

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

PO 200.5 -

A. J. J. 01/23/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: *Alina GASTON*

Samplers Signature: *Alina Gaston*

JCB Project Manager: *Meghan Gwynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Oak Park Elementary School

OPE

062 022751

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2820	Classroom	1052	Room 22	CF	12/3/2020	6:36:00 AM
BRTWD-2821	Classroom	1052	Room 22	DW	12/3/2020	6:36:00 AM
BRTWD-2822	Classroom	1053	Room 23	CF	12/3/2020	6:38:00 AM
BRTWD-2823	Classroom	1053	Room 23	DW	12/3/2020	6:38:00 AM
BRTWD-2824	Classroom	1054	Room 24	CF	12/3/2020	6:39:00 AM
BRTWD-2825	Classroom	1054	Room 24	DW	12/3/2020	6:39:00 AM
BRTWD-2826	Classroom	1055	Room 25	CF	12/3/2020	6:40:00 AM
BRTWD-2827	Classroom	1055	Room 25	DW	12/3/2020	6:40:00 AM
BRTWD-2828	Classroom	1056	Room 26	CF	12/3/2020	6:41:00 AM
BRTWD-2829	Classroom	1056	Room 26	DW	12/3/2020	6:41:00 AM
BRTWD-2830	Classroom	1059	Room 29	CF	12/3/2020	6:44:00 AM
BRTWD-2831	Classroom	1059	Room 29	DW	12/3/2020	6:44:00 AM
BRTWD-2832	Classroom	1057	Room 27	CF	12/3/2020	6:43:00 AM
BRTWD-2833	Classroom	1057	Room 27	DW	12/3/2020	6:43:00 AM
BRTWD-2834	Classroom	1058	Room 28	CF	12/3/2020	6:46:00 AM
BRTWD-2835	Classroom	1058	Room 28	DW	12/3/2020	6:46:00 AM
BRTWD-2836	Classroom	N/A	Room 52	CF	12/3/2020	6:48:00 AM
BRTWD-2837	Classroom	N/A	Room 52	DW	12/3/2020	6:48:00 AM

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

PO 200.5

A. Perry 01/20/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

AO
Steele

Samplers Name: *Aina Castelluzzo*

Samplers Signature: *Aina Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Oak Park Elementary School

OPE

062022751

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2838	Classroom	N/A	Room 53	DW	12/3/2020	6:49:00 AM
BRTWD-2839	Classroom	N/A	Room 53	CF	12/3/2020	6:49:00 AM
BRTWD-2840	Classroom	N/A	Room 54	CF	12/3/2020	6:51:00 AM
BRTWD-2841	Classroom	N/A	Room 54	DW	12/3/2020	6:51:00 AM
BRTWD-2842	Classroom	N/A	Room 55	DW	12/3/2020	6:52:00 AM
BRTWD-2843	Classroom	N/A	Room 55	CF	12/3/2020	6:52:00 AM
BRTWD-2852	Hallway	N/A	Corridor Near Bathrooms	WC	12/3/2020	6:55:00 AM
BRTWD-2853	Bathroom	N/A	Faculty Bathroom	BF	12/3/2020	6:56:00 AM
BRTWD-2856	Classroom	N/A	Room 56	CF	12/3/2020	6:57:00 AM
BRTWD-2857	Classroom	N/A	Room 56	DW	12/3/2020	6:57:00 AM
BRTWD-2858	Classroom	N/A	Room 57	CF	12/3/2020	6:58:00 AM
BRTWD-2859	Classroom	N/A	Room 57	DW	12/3/2020	6:58:00 AM
BRTWD-2860	Classroom	N/A	Room 58	CF	12/3/2020	7:00:00 AM
BRTWD-2861	Classroom	N/A	Room 58	DW	12/3/2020	7:00:00 AM
BRTWD-2862	Classroom	N/A	Room 59	CF	12/3/2020	7:01:00 AM
BRTWD-2863	Classroom	N/A	Room 59	DW	12/3/2020	7:01:00 AM
BRTWD-2864	Classroom	N/A	Room 60	CF	12/3/2020	7:02:00 AM
BRTWD-2865	Classroom	N/A	Room 60	DW	12/3/2020	7:02:00 AM

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

Ph 200.5

A. J. J. 01/20/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alina Castelluzzo

Alina Castelluzzo

Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Oak Park Elementary School

OPE

062.022751

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2866	Classroom	N/A	Room 61	CF	12/3/2020	7:03:00 AM
BRTWD-2867	Classroom	N/A	Room 61	DW	12/3/2020	7:03:00 AM
BRTWD-2869	Bathroom	N/A	Faculty Bathroom	BF	12/3/2020	7:05:00 AM
BRTWD-2873	Hallway	N/A	Corridor Near Bathrooms	WC	12/3/2020	7:06:00 AM
BRTWD-2874	Hallway	N/A	Corridor Near Bathrooms	WC	12/3/2020	7:06:00 AM
BRTWD-2877	Classroom	N/A	Room 66	CF	12/3/2020	7:09:00 AM
BRTWD-2878	Classroom	N/A	Room 66	DW	12/3/2020	7:09:00 AM
BRTWD-2879	Classroom	N/A	Room 67	DW	12/3/2020	7:10:00 AM
BRTWD-2880	Classroom	N/A	Room 67	CF	12/3/2020	7:10:00 AM
BRTWD-2881	Classroom	N/A	Room 68	DW	12/3/2020	7:11:00 AM
BRTWD-2882	Classroom	N/A	Room 68	CF	12/3/2020	7:11:00 AM
BRTWD-2883	Classroom	N/A	Room 69	CF	12/3/2020	7:14:00 AM
BRTWD-2884	Classroom	N/A	Room 69	DW	12/3/2020	7:14:00 AM
BRTWD-2885	Hallway	1040	Corridor Near Cafeteria	DW	12/3/2020	7:18:00 AM

Samples Submitted 104

20 DEC -3 PM 6:20
STATE OF NEW YORK
SARILE PLACE, NY

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

(ANALYZED ON 01/13/21)

Pb 200.5 -

A. Long 01/26/21

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: *Alina Castellanza*

Samplers Signature: *Alina Castellanza*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/3/2020. The results are tabulated on the attached data pages for the following client designated project:

**19-45270, Oak Park Elementary School, Brentwood Union Free
School District, 775 Wisconsin Avenue, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062022751. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-2753	Collected:	12/3/2020	Lab ID:	062022751-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2755	Collected:	12/3/2020	Lab ID:	062022751-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2756	Collected:	12/3/2020	Lab ID:	062022751-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2757	Collected:	12/3/2020	Lab ID:	062022751-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2758	Collected:	12/3/2020	Lab ID:	062022751-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2759	Collected:	12/3/2020	Lab ID:	062022751-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2760	Collected:	12/3/2020	Lab ID:	062022751-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2761	Collected:	12/3/2020	Lab ID:	062022751-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2761 **Collected:** 12/3/2020 **Lab ID:** 062022751-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2762 **Collected:** 12/3/2020 **Lab ID:** 062022751-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2763 **Collected:** 12/3/2020 **Lab ID:** 062022751-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2764 **Collected:** 12/3/2020 **Lab ID:** 062022751-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2765 **Collected:** 12/3/2020 **Lab ID:** 062022751-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2766 **Collected:** 12/3/2020 **Lab ID:** 062022751-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2767 **Collected:** 12/3/2020 **Lab ID:** 062022751-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2768 **Collected:** 12/3/2020 **Lab ID:** 062022751-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2769 **Collected:** 12/3/2020 **Lab ID:** 062022751-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2770 **Collected:** 12/3/2020 **Lab ID:** 062022751-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2771 **Collected:** 12/3/2020 **Lab ID:** 062022751-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2772 **Collected:** 12/3/2020 **Lab ID:** 062022751-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2773 **Collected:** 12/3/2020 **Lab ID:** 062022751-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2774 **Collected:** 12/3/2020 **Lab ID:** 062022751-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/3/2020 06:26 PM
Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2775 **Collected:** 12/3/2020 **Lab ID:** 062022751-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2776 **Collected:** 12/3/2020 **Lab ID:** 062022751-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2777 **Collected:** 12/3/2020 **Lab ID:** 062022751-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2778 **Collected:** 12/3/2020 **Lab ID:** 062022751-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2779 **Collected:** 12/3/2020 **Lab ID:** 062022751-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.5	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2780 **Collected:** 12/3/2020 **Lab ID:** 062022751-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2781 **Collected:** 12/3/2020 **Lab ID:** 062022751-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2783 **Collected:** 12/3/2020 **Lab ID:** 062022751-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2784 **Collected:** 12/3/2020 **Lab ID:** 062022751-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2785 **Collected:** 12/3/2020 **Lab ID:** 062022751-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2787 **Collected:** 12/3/2020 **Lab ID:** 062022751-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2788 **Collected:** 12/3/2020 **Lab ID:** 062022751-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2789 **Collected:** 12/3/2020 **Lab ID:** 062022751-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	44	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2790 **Collected:** 12/3/2020 **Lab ID:** 062022751-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-2791	Collected:	12/3/2020	Lab ID:	062022751-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2793	Collected:	12/3/2020	Lab ID:	062022751-0037		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2794	Collected:	12/3/2020	Lab ID:	062022751-0038		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2795	Collected:	12/3/2020	Lab ID:	062022751-0039		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2796	Collected:	12/3/2020	Lab ID:	062022751-0040		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2797	Collected:	12/3/2020	Lab ID:	062022751-0041		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2798	Collected:	12/3/2020	Lab ID:	062022751-0042		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2800 **Collected:** 12/3/2020 **Lab ID:** 062022751-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2801 **Collected:** 12/3/2020 **Lab ID:** 062022751-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.4	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2802 **Collected:** 12/3/2020 **Lab ID:** 062022751-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2803 **Collected:** 12/3/2020 **Lab ID:** 062022751-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2812 **Collected:** 12/3/2020 **Lab ID:** 062022751-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2813 **Collected:** 12/3/2020 **Lab ID:** 062022751-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2814 **Collected:** 12/3/2020 **Lab ID:** 062022751-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-2815	Collected:	12/3/2020	Lab ID:	062022751-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2816	Collected:	12/3/2020	Lab ID:	062022751-0051		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2817	Collected:	12/3/2020	Lab ID:	062022751-0052		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2818	Collected:	12/3/2020	Lab ID:	062022751-0053		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2819	Collected:	12/3/2020	Lab ID:	062022751-0054		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2820	Collected:	12/3/2020	Lab ID:	062022751-0055		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2821	Collected:	12/3/2020	Lab ID:	062022751-0056		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-2822	Collected:	12/3/2020	Lab ID:	062022751-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2823	Collected:	12/3/2020	Lab ID:	062022751-0058		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	160	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2824	Collected:	12/3/2020	Lab ID:	062022751-0059		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2825	Collected:	12/3/2020	Lab ID:	062022751-0060		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2826	Collected:	12/3/2020	Lab ID:	062022751-0061		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2827	Collected:	12/3/2020	Lab ID:	062022751-0062		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.2	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2828	Collected:	12/3/2020	Lab ID:	062022751-0063		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
		Lead MDL: 1.0µg/L						

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2829 **Collected:** 12/3/2020 **Lab ID:** 062022751-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2830 **Collected:** 12/3/2020 **Lab ID:** 062022751-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2831 **Collected:** 12/3/2020 **Lab ID:** 062022751-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2832 **Collected:** 12/3/2020 **Lab ID:** 062022751-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2833 **Collected:** 12/3/2020 **Lab ID:** 062022751-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2834 **Collected:** 12/3/2020 **Lab ID:** 062022751-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2835 **Collected:** 12/3/2020 **Lab ID:** 062022751-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2836 **Collected:** 12/3/2020 **Lab ID:** 062022751-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2837 **Collected:** 12/3/2020 **Lab ID:** 062022751-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2838 **Collected:** 12/3/2020 **Lab ID:** 062022751-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2839 **Collected:** 12/3/2020 **Lab ID:** 062022751-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2840 **Collected:** 12/3/2020 **Lab ID:** 062022751-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2841 **Collected:** 12/3/2020 **Lab ID:** 062022751-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2842 **Collected:** 12/3/2020 **Lab ID:** 062022751-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2843 **Collected:** 12/3/2020 **Lab ID:** 062022751-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2852 **Collected:** 12/3/2020 **Lab ID:** 062022751-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2853 **Collected:** 12/3/2020 **Lab ID:** 062022751-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2856 **Collected:** 12/3/2020 **Lab ID:** 062022751-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2857 **Collected:** 12/3/2020 **Lab ID:** 062022751-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2858 **Collected:** 12/3/2020 **Lab ID:** 062022751-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2859 **Collected:** 12/3/2020 **Lab ID:** 062022751-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2860 **Collected:** 12/3/2020 **Lab ID:** 062022751-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2860 **Collected:** 12/3/2020 **Lab ID:** 062022751-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2861 **Collected:** 12/3/2020 **Lab ID:** 062022751-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2862 **Collected:** 12/3/2020 **Lab ID:** 062022751-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2863 **Collected:** 12/3/2020 **Lab ID:** 062022751-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2864 **Collected:** 12/3/2020 **Lab ID:** 062022751-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2865 **Collected:** 12/3/2020 **Lab ID:** 062022751-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2866 **Collected:** 12/3/2020 **Lab ID:** 062022751-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2867 **Collected:** 12/3/2020 **Lab ID:** 062022751-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2869 **Collected:** 12/3/2020 **Lab ID:** 062022751-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2873 **Collected:** 12/3/2020 **Lab ID:** 062022751-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2874 **Collected:** 12/3/2020 **Lab ID:** 062022751-0095

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2877 **Collected:** 12/3/2020 **Lab ID:** 062022751-0096

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2878 **Collected:** 12/3/2020 **Lab ID:** 062022751-0097

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Client Sample Description BRTWD-2879 **Collected:** 12/3/2020 **Lab ID:** 062022751-0098

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/12/2021	AM	1/13/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022751

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:26 PM
 Collected: 12/3/2020

Project: 19-45270, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-2880		Collected:	12/3/2020	Lab ID:	062022751-0099	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2881		Collected:	12/3/2020	Lab ID:	062022751-0100	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2882		Collected:	12/3/2020	Lab ID:	062022751-0101	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2883		Collected:	12/3/2020	Lab ID:	062022751-0102	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2884		Collected:	12/3/2020	Lab ID:	062022751-0103	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Client Sample Description		BRTWD-2885		Collected:	12/3/2020	Lab ID:	062022751-0104	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	1/12/2021	AM	1/13/2021	AL
Lead MDL: 1.0µg/L								

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~19-45270~~ 21-48246

Building: Oak Park Elementary School

OPE

Client:

Brentwood Union Free School District

Retest New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2823	Classroom	1053	Room 23	DW	3/25/2021	7:02:00 AM

Samples Submitted 1

062105332

 RECEIVED
 EMIL ANALYTICAL, INC.
 CARLE PLACE, NY

21 MAR 25 AM 9:20

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

Pb200.5 -

03/29/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sampler's Name: Erin Todzia

Sampler's Signature:

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/25/2021. The results are tabulated on the attached data pages for the following client designated project:

**21-48246, Oak Park Elementary School, Brentwood Union Free
School District, 775 Wisconsin Avenue, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062105332. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105332

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/25/2021 09:20 AM
Collected: 3/25/2021

Project: 21-48246, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2823 **Collected:** 3/25/2021 **Lab ID:** 062105332-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246
Building: Oak Park Elementary School
OPE

062110611

Client: Brentwood Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2757	Bathroom	1003B	Room 2 Bathroom	BF	6/16/2021	7:43:00 AM
BRTWD-2789	Nurse Office	1026A	Nurse's Office Exam Room	NS	6/16/2021	7:41:00 AM
BRTWD-2835	Classroom	1058	Room 28	DW	6/16/2021	7:38:00 AM

Samples Submitted 3

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 P 3:13

Building Address

775 Wisconsin Avenue
Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: Alyssa McDonald

Signature: Alyssa McDonald

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, Oak Park Elementary School, Brentwood Union Free
School District, 775 Wisconsin Avenue, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062110611. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110611

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/16/21 3:13 PM
Collected: 6/16/2021

Project: #21-48246, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisconsin Avenue, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2757 **Collected:** 6/16/2021 **Lab ID:** 062110611-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2789 **Collected:** 6/16/2021 **Lab ID:** 062110611-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	240	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-2835 **Collected:** 6/16/2021 **Lab ID:** 062110611-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	6/17/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246
Building: Oak Park Elementary School
OPE

062218291

Page 1 of 1

Client:

Brentwood Union Free School District

Retest New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2789	Nurse Office	1026A	Nurse's Office Exam Room	NS	8/24/2022	7:29:00 AM

Samples Submitted 1

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 24 P 12:06

Courier

P6 200.5
Erin
8/24/22

Building Address

775 Wisconsin Avenue
Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: 8/24/22 @ 12:00pm

Signature:

Samplers Name: Erin Todzia

Samplers Signature:

JCB Project Manager: Meghan Cuyun

OrderID: 062218291



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2022. The results are tabulated on the attached data pages for the following client designated project:

JCB #: 21-48246, Oak Park Elementary School, OPE, Brentwood
Union Free School District, 775 Wisconsin Avenue, Bay Shore,
NY 11706

The reference number for these samples is EMSL Order #062218291. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218291

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/24/2022 12:06 PM
Collected: 8/24/2022

Project: JCB #: 21-48246, Oak Park Elementary School, OPE, Brentwood Union Free School District, 775 Wisconsin Avenue, Bay Shore, NY

Analytical Results

Client Sample Description BRTWD-2789 **Collected:** 8/24/2022 **Lab ID:** 062218291-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Oak Park Elementary School

OPE

062225148

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3083	HA	1040	Corridor Main Office To Receiving Room	WC	12/8/2022	7:41:00 AM
BRTWD-3084	HA	1040	Corridor Main Office To Receiving Room	WF	12/8/2022	7:42:00 AM
BRTWD-3085	HA	1040	Corridor Main Office To Receiving Room	WC	12/8/2022	7:43:00 AM
BRTWD-3086	HA	1040	Corridor Main Office To Receiving Room	WF	12/8/2022	7:44:00 AM

Samples Submitted 4

Pb Bern AK
200.5 12/10/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC - 8 P 4:41

Building Address

775 Wisconsin Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: Alex Kusch 12/8/22

Signature: [Signature] 4:41 PM

Samplers Name: Aileen McNamee

Samplers Signature: [Signature]

JCB Project Manager: Meghan Gryan



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/12/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/8/2022. The results are tabulated on the attached data pages for the following client designated project:

**#: 22-53405, Oak Park Elementary School, Brentwood Union Free
School District, 775 Wisonsin Avenue, Bay Shore NY 11706**

The reference number for these samples is EMSL Order #062225148. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225148

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/8/2022 04:41 PM
Collected: 12/8/2022

Project: #: 22-53405, Oak Park Elementary School, Brentwood Union Free School District, 775 Wisonsin Avenue, Bay Shore NY 11706

Analytical Results

Client Sample Description BRTWD-3083 **Collected:** 12/8/2022 **Lab ID:** 062225148-0001

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3084 **Collected:** 12/8/2022 **Lab ID:** 062225148-0002

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3085 **Collected:** 12/8/2022 **Lab ID:** 062225148-0003

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3086 **Collected:** 12/8/2022 **Lab ID:** 062225148-0004

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/9/2022	CM	12/10/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062021260

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Pine Park Elementary School
PPES

Client: Brentwood Union Free School District
Retest/New Install []
Turn Around: (Normal 1 wk) Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2085	Classroom	N/A	Room 33	CF	11/13/2020	5:49:00 AM
BRTWD-2086	Classroom	N/A	Room 33	DW	11/13/2020	5:49:00 AM
BRTWD-2087	Bathroom	N/A	Room 33 Bathroom	BF	11/13/2020	5:50:00 AM
BRTWD-2088	Bathroom	N/A	Faculty Room	BF	11/13/2020	5:52:00 AM
BRTWD-2089	Classroom	N/A	Room 35	CF	11/13/2020	5:53:00 AM
BRTWD-2090	Classroom	N/A	Room 35	DW	11/13/2020	5:53:00 AM
BRTWD-2091	Bathroom	N/A	Room 35 Bathroom	BF	11/13/2020	5:53:00 AM
BRTWD-2092	Classroom	N/A	Room 36	CF	11/13/2020	5:56:00 AM
BRTWD-2093	Classroom	N/A	Room 36	DW	11/13/2020	5:56:00 AM
BRTWD-2094	Bathroom	N/A	Room 36 Bathroom	BF	11/13/2020	5:57:00 AM
BRTWD-2096	Classroom	N/A	Room 34	CF	11/13/2020	5:59:00 AM
BRTWD-2097	Classroom	N/A	Room 34	DW	11/13/2020	5:59:00 AM
BRTWD-2098	Bathroom	N/A	Room 34 Bathroom	BF	11/13/2020	6:00:00 AM
BRTWD-2099	Classroom	N/A	Room 32	CF	11/13/2020	6:03:00 AM
BRTWD-2100	Classroom	N/A	Room 32	DW	11/13/2020	6:03:00 AM
BRTWD-2101	Classroom	N/A	Room 32 Bathroom	DW	11/13/2020	6:04:00 AM
BRTWD-2102	Classroom	1001	Room 1	CF	11/13/2020	6:06:00 AM
BRTWD-2103	Classroom	1001	Room 1	DW	11/13/2020	6:06:00 AM

Building Address
1 Mur Place
Brentwood, NY 11717

PO 200.5 007 *[Signature]* 12/14/2020
Analysis Type: ELAP 200.5
Lab Received: _____
Signature: _____

Samplers Name: *Alina Castellano*
Samplers Signature: *Alina Castellano*
JCB Project Manager: *Meghan Gwynn*



062021260 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Pine Park Elementary School
PPES

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2104	Bathroom	1001B	Room 1 Bathroom	BF	11/13/2020	6:07:00 AM
BRTWD-2105	Classroom	1003	Room 2	CF	11/13/2020	6:08:00 AM
BRTWD-2106	Classroom	1003	Room 2	DW	11/13/2020	6:08:00 AM
BRTWD-2107	Bathroom	1003A	Room 2 Bathroom	BF	11/13/2020	6:09:00 AM
BRTWD-2108	Classroom	1004	Room 3	CF	11/13/2020	6:10:00 AM
BRTWD-2109	Classroom	1004	Room 3	DW	11/13/2020	6:10:00 AM
BRTWD-2110	Classroom	1005	Room 4	CF	11/13/2020	6:12:00 AM
BRTWD-2111	Classroom	1005	Room 4	DW	11/13/2020	6:13:00 AM
BRTWD-2112	Classroom	1006	Room 5	CF	11/13/2020	6:14:00 AM
BRTWD-2113	Classroom	1006	Room 5	DW	11/13/2020	6:14:00 AM
BRTWD-2114	Classroom	1007	Room 6	CF	11/13/2020	6:15:00 AM
BRTWD-2115	Classroom	1007	Room 6	DW	11/13/2020	6:16:00 AM
BRTWD-2116	Classroom	1003	Room 7	CF	11/13/2020	6:17:00 AM
BRTWD-2117	Classroom	1003	Room 7	DW	11/13/2020	6:17:00 AM
BRTWD-2118	Classroom	1009	Room 8	CF	11/13/2020	6:18:00 AM
BRTWD-2119	Classroom	1009	Room 8	DW	11/13/2020	6:19:00 AM
BRTWD-2120	Classroom	1010	Room 9	CF	11/13/2020	6:20:00 AM
BRTWD-2121	Classroom	1010	Room 9	DW	11/13/2020	6:21:00 AM

Building Address

1 Mur Place

Brentwood, NY 11717

Pb 200.5 DOG
12/14/2020

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: Alina Gwyne

Samplers Signature: Alina Gwyne

JCB Project Manager: Meghan Gwynn



062021260 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Pine Park Elementary School

PPES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 3 of 6

OrderID: 062021260

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2122	Classroom	1011	Room 10	CF	11/13/2020	6:23:00 AM
BRTWD-2123	Classroom	1011	Room 10	DW	11/13/2020	6:23:00 AM
BRTWD-2124	Classroom	1012	Room 11	CF	11/13/2020	6:26:00 AM
BRTWD-2125	Classroom	1012	Room 11	DW	11/13/2020	6:26:00 AM
BRTWD-2126	Classroom	1013	Room 12	CF	11/13/2020	6:27:00 AM
BRTWD-2127	Classroom	1013	Room 12	DW	11/13/2020	6:27:00 AM
BRTWD-2128	Classroom	1014	Room 13	CF	11/13/2020	6:30:00 AM
BRTWD-2129	Classroom	1014	Room 13	DW	11/13/2020	6:30:00 AM
BRTWD-2130	Classroom	1015	Room 14	CF	11/13/2020	6:31:00 AM
BRTWD-2131	Classroom	1015	Room 14	DW	11/13/2020	6:31:00 AM
BRTWD-2132	Classroom	1016	Room 15	CF	11/13/2020	6:33:00 AM
BRTWD-2133	Classroom	1016	Room 15	DW	11/13/2020	6:33:00 AM
BRTWD-2134	Bathroom	1022	Women's Faculty Bathroom	BF	11/13/2020	6:51:00 AM
BRTWD-2135	Hallway	1061	Corridor Adjacent Women's Bathroom (1022)	WC	11/13/2020	6:52:00 AM
BRTWD-2136	Bathroom	1023	Men's Faculty Bathroom	BF	11/13/2020	6:53:00 AM
BRTWD-2137	Office	1024B	Rear Psychologist Office	CF	11/13/2020	6:54:00 AM
BRTWD-2138	Bathroom	1025A	Nurse's Office Bathroom	BF	11/13/2020	6:55:00 AM
BRTWD-2139	Nurse Office	1025	Nurse's Office	NS	11/13/2020	6:55:00 AM

Building Address

1 Mur Place

Brentwood, NY 11717

Pb 200.5 done
12/14/2020

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: Alina Castellan

Samplers Signature: Alina Castellan

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Pine Park Elementary School
PPES

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2141	Faculty Lounge	1033	Faculty Room	CF	11/13/2020	7:03:00 AM
BRTWD-2143	Hallway	1061	Corridor Near Faculty Room (1033)	WC	11/13/2020	7:06:00 AM
BRTWD-2144	Kitchen	1036	Kitchen	KC	11/13/2020	5:32:00 AM
BRTWD-2145	Kitchen	1036	Kitchen	KC	11/13/2020	5:32:00 AM
BRTWD-2146	Kitchen	1036	Kitchen	HW	11/13/2020	5:34:00 AM
BRTWD-2147	Kitchen	1036	Kitchen	PK	11/13/2020	5:35:00 AM
BRTWD-2148	Kitchen	1036	Kitchen	KC	11/13/2020	5:35:00 AM
BRTWD-2149	Kitchen	1036	Kitchen	SN	11/13/2020	5:37:00 AM
BRTWD-2150	Kitchen	1036	Kitchen	KC	11/13/2020	5:37:00 AM
BRTWD-2151	Kitchen	1036	Kitchen	KC	11/13/2020	5:38:00 AM
BRTWD-2152	Kitchen	1036	Kitchen	HW	11/13/2020	5:40:00 AM
BRTWD-2153	Bathroom	1036A3	Kitchen Bathroom	BF	11/13/2020	5:41:00 AM
BRTWD-2162	Classroom	1044	Room 16	CF	11/13/2020	7:10:00 AM
BRTWD-2163	Classroom	1044	Room 16	DW	11/13/2020	7:10:00 AM
BRTWD-2164	Classroom	1045	Room 17	CF	11/13/2020	7:11:00 AM
BRTWD-2165	Classroom	1045	Room 17	DW	11/13/2020	7:11:00 AM
BRTWD-2166	Classroom	1046	Room 18	CF	11/13/2020	7:14:00 AM
BRTWD-2167	Classroom	1046	Room 18	DW	11/13/2020	7:14:00 AM

Building Address

1 Mur Place

Brentwood, NY 11717

Pb 200.5 *12/14/20*

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: *Alicia Gastelluzzo*

Samplers Signature: *Alicia Gastelluzzo*

JCB Project Manager: *Meghan Gwynn*



062021260 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Pine Park Elementary School

PPES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2168	Classroom	1047	Room 19	CF	11/13/2020	7:17:00 AM
BRTWD-2169	Classroom	1047	Room 19	DW	11/13/2020	7:17:00 AM
BRTWD-2170	Classroom	1048	Room 20	CF	11/13/2020	7:18:00 AM
BRTWD-2171	Classroom	1048	Room 20	DW	11/13/2020	7:18:00 AM
BRTWD-2172	Classroom	1049	Room 21	CF	11/13/2020	7:20:00 AM
BRTWD-2174	Classroom	1050	Room 22	CF	11/13/2020	7:21:00 AM
BRTWD-2175	Classroom	1050	Room 22	DW	11/13/2020	7:21:00 AM
BRTWD-2176	Classroom	1052	Room 24	CF	11/13/2020	7:22:00 AM
BRTWD-2177	Classroom	1052	Room 24	DW	11/13/2020	7:22:00 AM
BRTWD-2178	Classroom	1053	Room 25	CF	11/13/2020	7:24:00 AM
BRTWD-2179	Classroom	1053	Room 25	DW	11/13/2020	7:24:00 AM
BRTWD-2180	Classroom	1055	Room 27	CF	11/13/2020	7:26:00 AM
BRTWD-2181	Classroom	1055	Room 27	DW	11/13/2020	7:26:00 AM
BRTWD-2182	Classroom	1054	Room 26	CF	11/13/2020	7:27:00 AM
BRTWD-2183	Classroom	1054	Room 26	DW	11/13/2020	7:27:00 AM
BRTWD-2184	Classroom	1057	Room 29	CF	11/13/2020	7:28:00 AM
BRTWD-2185	Classroom	1057	Room 29	DW	11/13/2020	7:28:00 AM
BRTWD-2186	Classroom	1056	Room 28	CF	11/13/2020	7:29:00 AM

Building Address

1 Mur Place

Brentwood, NY 11717

Pb 200.5 por 12/14/2020

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: Arika Costello

Samplers Signature: Arika Costello

JCB Project Manager: Meghan GW 441



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Pine Park Elementary School

PPES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2187	Classroom	1056	Room 28	DW	11/13/2020	7:29:00 AM
BRTWD-2188	Bathroom	1059	Room 31 Bathroom	BF	11/13/2020	7:31:00 AM
BRTWD-2189	Bathroom	1058	Room 30 Bathroom	BF	11/13/2020	7:31:00 AM
BRTWD-2985	OF	1019A	Main Office Copy Room	BW	11/13/2020	6:48:00 AM

Samples Submitted 94

20 NOV 13 PM 3:35
 ANALYTICAL, INC.
 CARLE PLACE, NY

Building Address

1 Mur Place

Brentwood, NY 11717

PB

200.5

12/14/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/13/2020. The results are tabulated on the attached data pages for the following client designated project:

Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717,
Brentwood Union Free School District, 19-45270

The reference number for these samples is EMSL Order #062021260. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2085 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2086 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2087 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2088 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2089 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2090 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2091 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2092 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2092 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2093 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2094 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2096 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2097 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2098 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2099 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/14/2020	DI

Client Sample Description BRTWD-2100 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2100	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2101	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0016		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2102	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0017		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2103	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0018		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2104	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0019		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2105	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0020		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2106	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0021		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2107		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2108		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0023	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2109		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0024	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2110		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0025	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2111		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0026	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2112		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0027	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2113		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0028	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2114		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2115		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0030	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2116		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0031	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2117		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0032	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2118		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0033	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2119		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0034	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2120		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0035	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2121		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2122		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0037	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2123		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0038	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2124		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0039	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2125		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0040	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2126		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0041	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2127		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0042	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2128		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2129		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2130		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2131		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2132		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2133		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2134		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2135		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2135		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2136		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0051	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2137		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0052	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	72	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2138		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0053	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2139		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0054	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2141		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0055	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2143		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0056	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2144		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2144		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2145		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0058	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2146		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0059	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2147		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0060	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	AM	12/14/2020	DI
Client Sample Description		BRTWD-2148		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0061	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2149		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0062	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2150		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0063	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2151		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2152		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0065	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2153		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0066	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2162		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0067	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2163		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0068	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2164		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0069	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-2165		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0070	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
		Lead MDL: 1.0µg/L						

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2166	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0071	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	15	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
Client Sample Description		BRTWD-2167	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0072	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	8.0	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
Client Sample Description		BRTWD-2168	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0073	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
Client Sample Description		BRTWD-2169	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0074	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	2.5 J	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
		Lead MDL: 1.0µg/L					
Client Sample Description		BRTWD-2170	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0075	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
Client Sample Description		BRTWD-2171	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0076	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	1.8 J	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
		Lead MDL: 1.0µg/L					
Client Sample Description		BRTWD-2172	Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0077	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	1.5 J	3.0	µg/L	12/11/2020	OR	12/14/2020 DI
		Lead MDL: 1.0µg/L					

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2174		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0078	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2175		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0079	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2176		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0080	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/14/2020	DI
Client Sample Description		BRTWD-2177		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0081	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2178		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0082	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2179		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0083	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2180		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0084	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description		BRTWD-2181		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0085	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2182		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0086	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2183		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0087	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2184		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0088	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2185		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0089	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2186		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0090	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2187		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0091	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM
Client Sample Description		BRTWD-2188		Collected:	11/13/2020 5:59:00 AM	Lab ID:	062021260-0092	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021260

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/13/2020 03:35 PM
 Collected: 11/13/2020

Project: **Pine Park Elementary School, 1 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-2188 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/11/2020	AM

Client Sample Description BRTWD-2189 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/11/2020	AM

Client Sample Description BRTWD-2985 **Collected:** 11/13/2020 5:59:00 AM **Lab ID:** 062021260-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	OR	12/11/2020	AM

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~19-45270~~ 21-48246

Building: Pine Park Elementary School

PPES

062110641

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2137	Office	1024B	Rear Psychologist Office	CF	6/17/2021	6:56:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4: 03

Building Address

1 Mur Place

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Samplers Name: *Alina Castelluzzo*

Samplers Signature: *Alina Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, Pine Park Elementary School, Brentwood Union Free
School District, 1 Mur Place, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062110641. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110641

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:03 PM
Collected: 6/17/2021

Project: #21-48246, Pine Park Elementary School, Brentwood Union Free School District, 1 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2137 **Collected:** 6/17/2021 **Lab ID:** 062110641-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	49	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRÖDERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Pine Park Elementary School

PPES

0622 24979

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3047	HA	1061	Corridor Custodial Receiving Room To Main Office	WC	12/6/2022	6:43:00 AM
BRTWD-3048	HA	1061	Corridor Custodial Receiving Room To Main Office	WF	12/6/2022	6:44:00 AM
BRTWD-3049	HA	1061	Corridor Custodial Receiving Room To Main Office	WC	12/6/2022	6:47:00 AM
BRTWD-3050	HA	1061	Corridor Custodial Receiving Room To Main Office	WF	12/6/2022	6:48:00 AM

Samples Submitted 4

P6 200.5

Bom ARtr 12/8/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC - 6 P 2:55

Building Address

1 Mur Place

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Alex Roden 12/6/22

Signature: [Signature] 2:55 PM

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/8/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/6/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Pine Park Elementary School, Brentwood Union
Free School District, 1 Mur Place, Brentwood NY 11717

The reference number for these samples is EMSL Order #062224979. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062224979

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/6/2022 02:55 PM
 Collected: 12/6/2022

Project: #: 22-53405, Pine Park Elementary School, Brentwood Union Free School District, 1 Mur Place, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3047 **Collected:** 12/6/2022 **Lab ID:** 062224979-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3048 **Collected:** 12/6/2022 **Lab ID:** 062224979-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3049 **Collected:** 12/6/2022 **Lab ID:** 062224979-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3050 **Collected:** 12/6/2022 **Lab ID:** 062224979-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

062021268



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Pine Park Warehouse

PINE

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2980	Bathroom	1003	Men's Bathroom	BF	11/13/2020	7:52:00 AM
BRTWD-2981	Bathroom	1004	Women's Bathroom	BF	11/13/2020	7:52:00 AM

Samples Submitted 2

RECEIVED
JCB ANALYTICAL, INC.
CARLE PLACE, NY
20 NOV 13 PM 3:52

Building Address

1 Mur Place

Brentwood, NY 11717

Pb 200.5
Don't
11/18/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Joanne Gauthier
Joanne Gauthier
11/13/20 3:52pm

Samplers Name: Alina CastellonSamplers Signature: Alina Castellon

JCB Project Manager:

Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/13/2020. The results are tabulated on the attached data pages for the following client designated project:

**19-45270, Pine Park Warehouse, Pine, Brentwood Union Free
School District, 1 Mur Place, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062021268. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021268

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/13/2020 03:52 PM
Collected: 11/13/2020

Project: 19-45270, Pine Park Warehouse, Pine, Brentwood Union Free School District, 1 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2980 **Collected:** 11/13/2020 **Lab ID:** 062021268-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	11/18/2020	OR	11/18/2020	DI

Client Sample Description BRTWD-2981 **Collected:** 11/13/2020 **Lab ID:** 062021268-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/18/2020	OR	11/18/2020	DI

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: South Middle School

SMS

062022441

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 1 of 3

OrderID: 062022441

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1799	Hallway	1050	Corridor Near Auditorium (1051)	DW	12/2/2020	5:48:00 AM
BRTWD-1809	Hallway	1047	Corridor Near Room 123 (1042)	DW	12/2/2020	5:50:00 AM
BRTWD-1813	Hallway	1047	Corridor Near Room 116 (1036)	DW	12/2/2020	5:53:00 AM
BRTWD-1818	Hallway	N/A	Corridor Near Bathrooms	WC	12/2/2020	5:57:00 AM
BRTWD-1827	Hallway	N/A	Corridor Near Room 146	WC	12/2/2020	5:59:00 AM
BRTWD-1828	Hallway	N/A	Corridor Near Room 146	WC	12/2/2020	6:00:00 AM
BRTWD-1829	Bathroom	1028B	Faculty Room Women's Bathroom	BF	12/2/2020	6:03:00 AM
BRTWD-1830	Faculty Lounge	1028	Faculty Room	CF	12/2/2020	6:04:00 AM
BRTWD-1831	Bathroom	1028A	Faculty Room Men's Bathroom	BF	12/2/2020	6:04:00 AM
BRTWD-1832	Hallway	1029	Corridor Near Faculty Room (1028)	DW	12/2/2020	6:06:00 AM
BRTWD-1833	Bathroom	1027	Boys Bathroom	BF	12/2/2020	6:07:00 AM
BRTWD-1834	Nurse Office	1025	Nurse's Office	NS	12/2/2020	6:10:00 AM
BRTWD-1835	Bathroom	1025B	Nurse's Office Bathroom	BF	12/2/2020	6:10:00 AM
BRTWD-1838	Hallway	1029	Corridor Near Girls Locker Room (1022)	WC	12/2/2020	6:12:00 AM
BRTWD-1839	Hallway	1029	Corridor Near Girls Locker Room (1022)	WF	12/2/2020	6:13:00 AM
BRTWD-1842	Locker Room	1022	Girls Locker Room	DW	12/2/2020	6:15:00 AM
BRTWD-1843	Bathroom	1022A1	Girls Coach's Office Bathroom	BF	12/2/2020	6:16:00 AM
BRTWD-1844	Kitchen	1021	Kitchen	KC	12/2/2020	5:36:00 AM

Building Address

785 Candlewood Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: *Alicia Castelluzzo*

Samplers Signature: *Alicia Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: South Middle School

SMS

062022441

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 2 of 3

OrderID: 062022441

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1845	Kitchen	1021	Kitchen	PK	12/2/2020	5:37:00 AM
BRTWD-1846	Kitchen	1021	Kitchen	KC	12/2/2020	5:39:00 AM
BRTWD-1847	Kitchen	1021	Kitchen	HW	12/2/2020	5:39:00 AM
BRTWD-1848	Kitchen	1021	Kitchen	KC	12/2/2020	6:40:00 AM
BRTWD-1849	Kitchen	1021	Kitchen	SN	12/2/2020	5:40:00 AM
BRTWD-1850	Kitchen	1021	Kitchen	KC	12/2/2020	5:40:00 AM
BRTWD-1853	Bathroom	1021A	Kitchen Locker Room	BF	12/2/2020	5:43:00 AM
BRTWD-1854	Hallway	1029	Corridor Near Cafeteria A (1020)	DW	12/2/2020	6:22:00 AM
BRTWD-1855	Bathroom	1015A	Custodial Office Bathroom	BF	12/2/2020	6:23:00 AM
BRTWD-1856	Locker Room	1014	Weight Room	DW	12/2/2020	6:26:00 AM
BRTWD-1859	Bathroom	1014A1	Weight Room Coach's Office Bathroom	BF	12/2/2020	6:26:00 AM
BRTWD-1860	Hallway	1029	Corridor Near Room 110 (1011)	DW	12/2/2020	6:28:00 AM
BRTWD-1861	Home Economics	1007	Room 106	EC	12/2/2020	6:30:00 AM
BRTWD-1862	Home Economics	1007	Room 106	EC	12/2/2020	6:30:00 AM
BRTWD-1863	Home Economics	1007	Room 106	EC	12/2/2020	6:30:00 AM
BRTWD-1868	Home Economics	1004	Room 104	EC	12/2/2020	6:32:00 AM
BRTWD-1869	Home Economics	1004	Room 104	EC	12/2/2020	6:33:00 AM
BRTWD-1870	Home Economics	1004	Room 104	EC	12/2/2020	6:33:00 AM

Building Address

785 Candlewood Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: South Middle School

SMS

062 022441

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 3 of 3

OrderID: 062022441

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1871	Home Economics	1004	Room 104	EC	12/2/2020	6:34:00 AM
BRTWD-1872	Storage	1004A	Room 104 Laundry Room/Storage	CF	12/2/2020	6:34:00 AM
BRTWD-1873	Hallway	1029	Corridor Near Room 104 (1004)	DW	12/2/2020	6:35:00 AM
BRTWD-1883	Hallway	2042	Corridor Near Room 202 (2038)	DW	12/2/2020	6:44:00 AM
BRTWD-1895	Hallway	2042	Corridor Near Stairwell (2029)	DW	12/2/2020	6:46:00 AM
BRTWD-1896	Office	2021A	Library Work Room	CF	12/2/2020	7:07:00 AM
BRTWD-1897	Hallway	2042	Corridor Near Room 216 (2020)	WC	12/2/2020	6:48:00 AM
BRTWD-1898	Hallway	2042	Corridor Near Room 216 (2020)	WF	12/2/2020	6:48:00 AM
BRTWD-1904	Hallway	N/A	Corridor Near Bathrooms	WC	12/2/2020	6:52:00 AM
BRTWD-1910	Hallway	N/A	Corridor Near Room 248	WC	12/2/2020	6:55:00 AM
BRTWD-1911	Hallway	N/A	Corridor Near Room 248	WC	12/2/2020	6:56:00 AM
BRTWD-1912	Hallway	2025	Corridor Near Room 218 (2016)	DW	12/2/2020	6:58:00 AM
BRTWD-1916	Hallway	2025	Corridor Near Room 226 (2008)	DW	12/2/2020	7:00:00 AM

Samples Submitted 49

Building Address

785 Candlewood Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alicia Castellano

Samplers Signature: Alicia Castellano

JCB Project Manager: Meghan Gwin

20 DEC - 2 11:11 AM
CARLE PLANT



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/2/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45270, South Middle School, Brentwood Union Free School
District, 785 Candlewood Road, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062022441. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1799 **Collected:** 12/2/2020 **Lab ID:** 062022441-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1809 **Collected:** 12/2/2020 **Lab ID:** 062022441-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1813 **Collected:** 12/2/2020 **Lab ID:** 062022441-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1818 **Collected:** 12/2/2020 **Lab ID:** 062022441-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1827 **Collected:** 12/2/2020 **Lab ID:** 062022441-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1828 **Collected:** 12/2/2020 **Lab ID:** 062022441-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1829 **Collected:** 12/2/2020 **Lab ID:** 062022441-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1830 **Collected:** 12/2/2020 **Lab ID:** 062022441-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1830 **Collected:** 12/2/2020 **Lab ID:** 062022441-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1831 **Collected:** 12/2/2020 **Lab ID:** 062022441-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1832 **Collected:** 12/2/2020 **Lab ID:** 062022441-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1833 **Collected:** 12/2/2020 **Lab ID:** 062022441-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1834 **Collected:** 12/2/2020 **Lab ID:** 062022441-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1835 **Collected:** 12/2/2020 **Lab ID:** 062022441-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1838 **Collected:** 12/2/2020 **Lab ID:** 062022441-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1839		Collected:	12/2/2020	Lab ID:	062022441-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1842		Collected:	12/2/2020	Lab ID:	062022441-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1843		Collected:	12/2/2020	Lab ID:	062022441-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1844		Collected:	12/2/2020	Lab ID:	062022441-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1845		Collected:	12/2/2020	Lab ID:	062022441-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.7	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1846		Collected:	12/2/2020	Lab ID:	062022441-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1847		Collected:	12/2/2020	Lab ID:	062022441-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1848 **Collected:** 12/2/2020 **Lab ID:** 062022441-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1849 **Collected:** 12/2/2020 **Lab ID:** 062022441-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1850 **Collected:** 12/2/2020 **Lab ID:** 062022441-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1853 **Collected:** 12/2/2020 **Lab ID:** 062022441-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1854 **Collected:** 12/2/2020 **Lab ID:** 062022441-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1855 **Collected:** 12/2/2020 **Lab ID:** 062022441-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1856 **Collected:** 12/2/2020 **Lab ID:** 062022441-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1859		Collected:	12/2/2020	Lab ID:	062022441-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1860		Collected:	12/2/2020	Lab ID:	062022441-0030	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1861		Collected:	12/2/2020	Lab ID:	062022441-0031	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1862		Collected:	12/2/2020	Lab ID:	062022441-0032	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1863		Collected:	12/2/2020	Lab ID:	062022441-0033	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1868		Collected:	12/2/2020	Lab ID:	062022441-0034	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1869		Collected:	12/2/2020	Lab ID:	062022441-0035	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1870 **Collected:** 12/2/2020 **Lab ID:** 062022441-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1871 **Collected:** 12/2/2020 **Lab ID:** 062022441-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1872 **Collected:** 12/2/2020 **Lab ID:** 062022441-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1873 **Collected:** 12/2/2020 **Lab ID:** 062022441-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1883 **Collected:** 12/2/2020 **Lab ID:** 062022441-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1895 **Collected:** 12/2/2020 **Lab ID:** 062022441-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/6/2021	AM	1/7/2021	AL

Client Sample Description BRTWD-1896 **Collected:** 12/2/2020 **Lab ID:** 062022441-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022441

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/2/2020 02:30 PM
 Collected: 12/2/2020

Project: #19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description		BRTWD-1897		Collected:	12/2/2020	Lab ID:	062022441-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1898		Collected:	12/2/2020	Lab ID:	062022441-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1904		Collected:	12/2/2020	Lab ID:	062022441-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1910		Collected:	12/2/2020	Lab ID:	062022441-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1911		Collected:	12/2/2020	Lab ID:	062022441-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Client Sample Description		BRTWD-1912		Collected:	12/2/2020	Lab ID:	062022441-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	1/6/2021	AM	1/7/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1916		Collected:	12/2/2020	Lab ID:	062022441-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	1/6/2021	AM	1/7/2021	AL



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062022441
CustomerID: JCBR50
CustomerPO:
ProjectID:

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 49-45270 21-48246
Building: South Middle School
SMS

Client:
Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1849	Kitchen	1021	Kitchen	SN	3/25/2021	6:32:00 AM

Samples Submitted 1

062105333

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 25 AM 9:20

Building Address
785 Candlewood Road
Brentwood, NY 11717

Pb 200.5 -
A. Young 03/29/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Erin Todzia

Samplers Signature: *E. Todzia*

JCB Project Manager: Meghan Owyne



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/25/2021. The results are tabulated on the attached data pages for the following client designated project:

21-48246, South Middle School, Brentwood Union Free School
District, 785 Candlewood Road, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062105333. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105333

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/25/2021 09:20 AM
Collected: 3/25/2021

Project: 21-48246, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1849 **Collected:** 3/25/2021 **Lab ID:** 062105333-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	3/26/2021	AL	3/29/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: South Middle School

SMS

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal ~~1 wk~~ Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1843	Bathroom	1022A1	Girls Coach's Office Bathroom	BF	5/5/2021	7:01:00 AM
BRTWD-1859	Bathroom	1014A1	Weight Room Coach's Office Bathroom	BF	5/5/2021	7:04:00 AM

Samples Submitted 2

062107997

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY

21 MAY - 5 PM 4:41

Building Address

785 Candlewood Road

Brentwood, NY 11717

Pb 200.5-

A. J. J. 05/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria Orlassino

Samplers Signature: A. Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/11/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/5/2021. The results are tabulated on the attached data pages for the following client designated project:

**19-45270, South Middle School, Brentwood Union Free School
District, 785 Candlewood Road, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062107997. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062107997

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/05/21 4:41 PM
Collected: 5/5/2021

Project: 19-45270, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1843 **Collected:** 5/5/2021 **Lab ID:** 062107997-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Client Sample Description BRTWD-1859 **Collected:** 5/5/2021 **Lab ID:** 062107997-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0 µg/L	5/7/2021	AM	5/10/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062121661 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: South Middle School

SMS

Client:

Brentwood Union Free School District

Retest/New Install ☒ MTurn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3002	CR	1042	Room 123 Life Skills	EC	10/28/2021	6:35:00 AM

Samples Submitted 1

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 OCT 28 P 12:06

ELAP 200.5
Tung
11/2/21

Building Address

785 Candlewood Road

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Recieved: Unique McKaySignature: UMSamplers Name: Meghan GwynnSamplers Signature: Meghan GwynnJCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

11/2/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/28/2021. The results are tabulated on the attached data pages for the following client designated project:

South Middle School, 785 Candlewood Road, Brentwood, NY
11717, Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062121661. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062121661

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/28/2021 12:06 PM
Collected: 10/28/2021

Project: **South Middle School, 785 Candlewood Road, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-3002 **Collected:** 10/28/2021 **Lab ID:** 062121661-0001
Room 123 Life Skills

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	11/2/2021	TH	11/2/2021	TH
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: South Middle School

SMS

062222199

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk / Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3022	HA	1050	Auditorium Lobby	WC	10/18/2022	7:11:00 AM
BRTWD-3023	HA	1050	Auditorium Lobby	WF	10/18/2022	7:12:00 AM
BRTWD-3024	HA	2025	Corridor Near Room 226 (2008)	WC	10/18/2022	7:14:00 AM
BRTWD-3025	HA	2025	Corridor Near Room 226 (2008)	WF	10/18/2022	7:14:00 AM
BRTWD-3026	HA	1029	Corridor Near Cafeteria A (1020)	WC	10/18/2022	7:17:00 AM
BRTWD-3027	HA	1029	Corridor Near Cafeteria A (1020)	WF	10/18/2022	7:18:00 AM

Samples Submitted 6

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 OCT 18 P 12: 26

Building Address

785 Candlewood Road
Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Max Insler 10/18/22
12:26pm

Samplers Name: Meghan Gwynn

Samplers Signature:

JCB Project Manager:

Meghan Gwynn
Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

10/22/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/18/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 21-48246, South Middle School, Brentwood Union Free School
District, 785 Candlewood Road, Brentwood NY 11717

The reference number for these samples is EMSL Order #062222199. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062222199

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/18/2022 12:26 PM
 Collected: 10/18/2022

Project: #: 21-48246, South Middle School, Brentwood Union Free School District, 785 Candlewood Road, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3022 **Collected:** 10/18/2022 **Lab ID:** 062222199-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3023 **Collected:** 10/18/2022 **Lab ID:** 062222199-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3024 **Collected:** 10/18/2022 **Lab ID:** 062222199-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3025 **Collected:** 10/18/2022 **Lab ID:** 062222199-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3026 **Collected:** 10/18/2022 **Lab ID:** 062222199-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3027 **Collected:** 10/18/2022 **Lab ID:** 062222199-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Southeast Elementary School
SES

062022284

Page 1 of 4

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2664	Classroom	1001	Room 101	CF	12/1/2020	6:02:00 AM
BRTWD-2665	Classroom	1001	Room 101	DW	12/1/2020	6:02:00 AM
BRTWD-2666	Bathroom	1001B	Room 101 Bathroom	BF	12/1/2020	6:02:00 AM
BRTWD-2667	Classroom	1002	Room 102	CF	12/1/2020	6:05:00 AM
BRTWD-2668	Classroom	1002	Room 102	DW	12/1/2020	6:05:00 AM
BRTWD-2669	Bathroom	1002B	Room 102 Bathroom	BF	12/1/2020	6:05:00 AM
BRTWD-2670	Classroom	1004	Room 11	CF	12/1/2020	6:07:00 AM
BRTWD-2671	Classroom	1004	Room 11	DW	12/1/2020	6:07:00 AM
BRTWD-2672	Classroom	1005	Room 12	CF	12/1/2020	6:08:00 AM
BRTWD-2673	Classroom	1005	Room 12	DW	12/1/2020	6:08:00 AM
BRTWD-2674	Classroom	1006	Room 9	CF	12/1/2020	6:09:00 AM
BRTWD-2675	Classroom	1006	Room 9	DW	12/1/2020	6:09:00 AM
BRTWD-2676	Classroom	1007	Room 10	CF	12/1/2020	6:11:00 AM
BRTWD-2677	Classroom	1007	Room 10	DW	12/1/2020	6:11:00 AM
BRTWD-2678	Classroom	1008	Room 7	CF	12/1/2020	6:12:00 AM
BRTWD-2679	Classroom	1008	Room 7	DW	12/1/2020	6:12:00 AM
BRTWD-2680	Classroom	1009	Room 8	CF	12/1/2020	6:14:00 AM
BRTWD-2681	Classroom	1009	Room 8	DW	12/1/2020	6:14:00 AM

Building Address

1 Melody Lane

Brentwood, NY 11717

Amy McDonald 1/13/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: *Alina Costello*

Samplers Signature: *Alina Costello*

JCB Project Manager: *Meghan Gwynn*

OrderID: 062022284

Page 1 Of 4



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southeast Elementary School

SES

062 022284

Page 2 of 4

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2682	Classroom	1010	Room 5	CF	12/1/2020	6:15:00 AM
BRTWD-2684	Classroom	1011	Room 6	CF	12/1/2020	6:17:00 AM
BRTWD-2685	Classroom	1011	Room 6	DW	12/1/2020	6:17:00 AM
BRTWD-2686	Classroom	1012	Room 3	CF	12/1/2020	6:19:00 AM
BRTWD-2687	Classroom	1012	Room 3	DW	12/1/2020	6:19:00 AM
BRTWD-2688	Classroom	1013	Room 4	CF	12/1/2020	6:20:00 AM
BRTWD-2689	Classroom	1013	Room 4	DW	12/1/2020	6:20:00 AM
BRTWD-2690	Classroom	1014	Room 1	CF	12/1/2020	6:22:00 AM
BRTWD-2691	Classroom	1014	Room 1	DW	12/1/2020	6:22:00 AM
BRTWD-2692	Bathroom	1017	Men's Bathroom	BF	12/1/2020	6:23:00 AM
BRTWD-2694	Bathroom	1020	Women's Bathroom	BF	12/1/2020	6:24:00 AM
BRTWD-2695	Nurse Office	1000	Nurse's Office	NS	12/1/2020	6:28:00 AM
BRTWD-2696	Bathroom	1000B	Nurse's Office Bathroom	BF	12/1/2020	6:28:00 AM
BRTWD-2697	Hallway	1032	Corridor Near Gymnasium (1025)	DW	12/1/2020	6:29:00 AM
BRTWD-2699	Hallway	1032	Corridor Near Cafeteria (1028)	DW	12/1/2020	6:40:00 AM
BRTWD-2700	Kitchen	1029	Kitchen	HW	12/1/2020	5:43:00 AM
BRTWD-2701	Kitchen	1029	Kitchen	PK	12/1/2020	5:43:00 AM
BRTWD-2702	Kitchen	1029	Kitchen	KC	12/1/2020	5:45:00 AM

Building Address

1 Melody Lane

Brentwood, NY 11717

Alissa McDonald 11/13/21

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: *Alina Custell 4220*

Samplers Signature: *Alina Custell*

JCB Project Manager: *Meghan Gwynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southeast Elementary School

SES

062 022284

Page 3 of 4

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2704	Kitchen	1029	Kitchen	KC	12/1/2020	5:45:00 AM
BRTWD-2705	Kitchen	1029	Kitchen	HW	12/1/2020	5:47:00 AM
BRTWD-2707	Bathroom	1030A	Custodial Office Bathroom	BF	12/1/2020	5:49:00 AM
BRTWD-2708	Faculty Lounge	1035	Faculty Room	CF	12/1/2020	6:42:00 AM
BRTWD-2716	Classroom	1040	Room 16	CF	12/1/2020	6:44:00 AM
BRTWD-2717	Classroom	1040	Room 16	DW	12/1/2020	6:44:00 AM
BRTWD-2718	Classroom	1041	Room 13	CF	12/1/2020	6:45:00 AM
BRTWD-2719	Classroom	1041	Room 13	DW	12/1/2020	6:45:00 AM
BRTWD-2720	Classroom	1042	Room 18	CF	12/1/2020	6:47:00 AM
BRTWD-2721	Classroom	1042	Room 18	DW	12/1/2020	6:47:00 AM
BRTWD-2722	Classroom	1043	Room 15	CF	12/1/2020	6:49:00 AM
BRTWD-2723	Classroom	1043	Room 15	DW	12/1/2020	6:49:00 AM
BRTWD-2724	Classroom	1044	Room 20	CF	12/1/2020	6:50:00 AM
BRTWD-2725	Classroom	1044	Room 20	DW	12/1/2020	6:50:00 AM
BRTWD-2726	Classroom	1045	Room 17	CF	12/1/2020	6:54:00 AM
BRTWD-2727	Classroom	1045	Room 17	DW	12/1/2020	6:54:00 AM
BRTWD-2728	Classroom	1046	Room 22	CF	12/1/2020	6:55:00 AM
BRTWD-2729	Classroom	1046	Room 22	DW	12/1/2020	6:55:00 AM

Building Address

1 Melody Lane

Brentwood, NY 11717

Auppa McDonald 1/13/21

Analysis Type: ELAP 200.5

Lab Received: *Qaele*

Signature: *[Signature]*

Samplers Name: *Alicia Castelluzzo*

Samplers Signature: *Alicia Castelluzzo*

JCB Project Manager: *Meghan GWynn*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southeast Elementary School

SES

062 022284

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2730	Classroom	1047	Room 19	CF	12/1/2020	6:57:00 AM
BRTWD-2731	Classroom	1047	Room 19	DW	12/1/2020	6:57:00 AM
BRTWD-2732	Classroom	1048	Room 24	CF	12/1/2020	6:58:00 AM
BRTWD-2733	Classroom	1048	Room 24	DW	12/1/2020	6:58:00 AM
BRTWD-2734	Classroom	1054	Room 25	CF	12/1/2020	6:59:00 AM
BRTWD-2735	Classroom	1055	Room 26	CF	12/1/2020	7:02:00 AM
BRTWD-2736	Classroom	1055	Room 26	DW	12/1/2020	7:02:00 AM
BRTWD-2737	Bathroom	N/A	Room 27 Bathroom	BF	12/1/2020	7:07:00 AM
BRTWD-2739	Bathroom	N/A	Room 29 Bathroom	BF	12/1/2020	7:09:00 AM
BRTWD-2740	Bathroom	N/A	Room 30 Bathroom	BF	12/1/2020	7:10:00 AM
BRTWD-2988	KI	1029	Kitchen	HW	12/1/2020	5:52:00 AM

Samples Submitted 65

20 DEC -1 PM 3:48
ANALYTICAL, INC.
CARLE PLACE, NY

Building Address

1 Melody Lane

Brentwood, NY 11717

Ampex McDonald 11/13/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: *Alina Castelluzzo*

Samplers Signature: *Alina Castelluzzo*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/1/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-45270, Southeast Elementary School, Brentwood Union Free
School District, 1 Melody Lane, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062022284. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2664 **Collected:** 12/1/2020 **Lab ID:** 062022284-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2665 **Collected:** 12/1/2020 **Lab ID:** 062022284-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2666 **Collected:** 12/1/2020 **Lab ID:** 062022284-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2667 **Collected:** 12/1/2020 **Lab ID:** 062022284-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2668 **Collected:** 12/1/2020 **Lab ID:** 062022284-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2669 **Collected:** 12/1/2020 **Lab ID:** 062022284-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2670 **Collected:** 12/1/2020 **Lab ID:** 062022284-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2671 **Collected:** 12/1/2020 **Lab ID:** 062022284-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2671 **Collected:** 12/1/2020 **Lab ID:** 062022284-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2672 **Collected:** 12/1/2020 **Lab ID:** 062022284-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2673 **Collected:** 12/1/2020 **Lab ID:** 062022284-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2674 **Collected:** 12/1/2020 **Lab ID:** 062022284-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2675 **Collected:** 12/1/2020 **Lab ID:** 062022284-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2676 **Collected:** 12/1/2020 **Lab ID:** 062022284-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2677 **Collected:** 12/1/2020 **Lab ID:** 062022284-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2678 **Collected:** 12/1/2020 **Lab ID:** 062022284-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2678 **Collected:** 12/1/2020 **Lab ID:** 062022284-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2679 **Collected:** 12/1/2020 **Lab ID:** 062022284-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.0	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2680 **Collected:** 12/1/2020 **Lab ID:** 062022284-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2681 **Collected:** 12/1/2020 **Lab ID:** 062022284-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2682 **Collected:** 12/1/2020 **Lab ID:** 062022284-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2684 **Collected:** 12/1/2020 **Lab ID:** 062022284-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2685 **Collected:** 12/1/2020 **Lab ID:** 062022284-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2686 **Collected:** 12/1/2020 **Lab ID:** 062022284-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2686 **Collected:** 12/1/2020 **Lab ID:** 062022284-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2687 **Collected:** 12/1/2020 **Lab ID:** 062022284-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2688 **Collected:** 12/1/2020 **Lab ID:** 062022284-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2689 **Collected:** 12/1/2020 **Lab ID:** 062022284-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.5	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2690 **Collected:** 12/1/2020 **Lab ID:** 062022284-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2691 **Collected:** 12/1/2020 **Lab ID:** 062022284-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2692 **Collected:** 12/1/2020 **Lab ID:** 062022284-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2694 **Collected:** 12/1/2020 **Lab ID:** 062022284-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2695 **Collected:** 12/1/2020 **Lab ID:** 062022284-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2696 **Collected:** 12/1/2020 **Lab ID:** 062022284-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2697 **Collected:** 12/1/2020 **Lab ID:** 062022284-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2699 **Collected:** 12/1/2020 **Lab ID:** 062022284-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2700 **Collected:** 12/1/2020 **Lab ID:** 062022284-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2701 **Collected:** 12/1/2020 **Lab ID:** 062022284-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2702 **Collected:** 12/1/2020 **Lab ID:** 062022284-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2702 **Collected:** 12/1/2020 **Lab ID:** 062022284-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2704 **Collected:** 12/1/2020 **Lab ID:** 062022284-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2705 **Collected:** 12/1/2020 **Lab ID:** 062022284-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	29	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2707 **Collected:** 12/1/2020 **Lab ID:** 062022284-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2708 **Collected:** 12/1/2020 **Lab ID:** 062022284-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2716 **Collected:** 12/1/2020 **Lab ID:** 062022284-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2717 **Collected:** 12/1/2020 **Lab ID:** 062022284-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2718 **Collected:** 12/1/2020 **Lab ID:** 062022284-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2719 **Collected:** 12/1/2020 **Lab ID:** 062022284-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2720 **Collected:** 12/1/2020 **Lab ID:** 062022284-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2721 **Collected:** 12/1/2020 **Lab ID:** 062022284-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2722 **Collected:** 12/1/2020 **Lab ID:** 062022284-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2723 **Collected:** 12/1/2020 **Lab ID:** 062022284-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2724 **Collected:** 12/1/2020 **Lab ID:** 062022284-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2725 **Collected:** 12/1/2020 **Lab ID:** 062022284-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2725 **Collected:** 12/1/2020 **Lab ID:** 062022284-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2726 **Collected:** 12/1/2020 **Lab ID:** 062022284-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2727 **Collected:** 12/1/2020 **Lab ID:** 062022284-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2728 **Collected:** 12/1/2020 **Lab ID:** 062022284-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2729 **Collected:** 12/1/2020 **Lab ID:** 062022284-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2730 **Collected:** 12/1/2020 **Lab ID:** 062022284-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2731 **Collected:** 12/1/2020 **Lab ID:** 062022284-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.5	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2732 **Collected:** 12/1/2020 **Lab ID:** 062022284-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/1/2020 03:48 PM
 Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2732 **Collected:** 12/1/2020 **Lab ID:** 062022284-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2733 **Collected:** 12/1/2020 **Lab ID:** 062022284-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2734 **Collected:** 12/1/2020 **Lab ID:** 062022284-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2735 **Collected:** 12/1/2020 **Lab ID:** 062022284-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2736 **Collected:** 12/1/2020 **Lab ID:** 062022284-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2737 **Collected:** 12/1/2020 **Lab ID:** 062022284-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2739 **Collected:** 12/1/2020 **Lab ID:** 062022284-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2740 **Collected:** 12/1/2020 **Lab ID:** 062022284-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022284

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/1/2020 03:48 PM
Collected: 12/1/2020

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2740 **Collected:** 12/1/2020 **Lab ID:** 062022284-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Client Sample Description BRTWD-2988 **Collected:** 12/1/2020 **Lab ID:** 062022284-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/7/2021	AM	1/11/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southeast Elementary School

SES

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2672	Classroom	1005	Room 12	CF	5/7/2021	7:27:00 AM
BRTWD-2705	Kitchen	1029	Kitchen	HW	5/7/2021	7:18:00 AM
BRTWD-2720	Classroom	1042	Room 18	CF	5/7/2021	7:21:00 AM
BRTWD-2722	Classroom	1043	Room 15	CF	5/7/2021	7:22:00 AM
BRTWD-2729	Classroom	1046	Room 22	DW	5/7/2021	7:23:00 AM

Samples Submitted 5

062108230

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 7 PM 3:47

Building Address

1 Melody Lane

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 

Signature: 

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/7/2021. The results are tabulated on the attached data pages for the following client designated project:

**#19-45270, Southeast Elementary School, Brentwood Union Free
School District, 1 Melody Lane, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062108230. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108230

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 05/07/21 3:47 PM
 Collected: 5/7/2021

Project: #19-45270, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2672 **Collected:** 5/7/2021 **Lab ID:** 062108230-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD-2705 **Collected:** 5/7/2021 **Lab ID:** 062108230-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD-2720 **Collected:** 5/7/2021 **Lab ID:** 062108230-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2722 **Collected:** 5/7/2021 **Lab ID:** 062108230-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD-2729 **Collected:** 5/7/2021 **Lab ID:** 062108230-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~40-45270~~ 21-48246

Building: Southeast Elementary School

SES

062110602

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2666	Bathroom	1001B	Room 101 Bathroom	BF	6/16/2021	7:08:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 16 P 3:15

Building Address

1 Melody Lane

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Samplers Name: *Alina Castellano*

Samplers Signature: *Alina Castellano*

JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/16/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, Southeast Elementary School, Brentwood Union Free
School District, 1 Melody Lane, Brentwood, NY 11717**

The reference number for these samples is EMSL Order #062110602. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110602

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/16/21 3:15 PM
Collected: 6/16/2021

Project: #21-48246, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-2666 **Collected:** 6/16/2021 **Lab ID:** 062110602-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

21-48246

Building:

Southeast Elementary School

SES

Client:

Brentwood Union Free School District

~~Retest~~ New Install []

Turn Around: Normal wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2729	Classroom	1046	Room 22	DW	8/24/2022	6:55:00 AM

Samples Submitted 1

Pl 200.5
[Signature]
8/29/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 24 P 5:21



Building Address

1 Melody Lane

Brentwood, NY 11717

Analysis Type: ELAP 200.5^{AN}

Lab Received:

8/24/22

Signature:

[Signature]

Samplers Name: Lon Michalowski

Samplers Signature:

[Signature]

JCB Project Manager:

Meghan Emynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 21-48246, Southeast Elementary School, Brentwood Union
Free School District, 1 Melody Lane, Brentwood NY 11717

The reference number for these samples is EMSL Order #062218355. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218355

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/24/2022 05:27 PM
Collected: 8/24/2022

Project: #: 21-48246, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-2729 **Collected:** 8/24/2022 **Lab ID:** 062218355-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Southeast Elementary School

SES

062225067



Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3067	HA	1032	Gym Corridor	WC	12/7/2022	7:13:00 AM
BRTWD-3068	HA	1032	Gym Corridor	WF	12/7/2022	7:14:00 AM
BRTWD-3069	HA	1032	Gym Corridor	WC	12/7/2022	7:16:00 AM
BRTWD-3070	HA	1032	Gym Corridor	WF	12/7/2022	7:17:00 AM

Samples Submitted 4

Pb 200.5
Ben Akter 12/18/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC -7 P. 2:42

Building Address

1 Melody Lane

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 12/11/22

Signature: 2:42 PM

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/8/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/7/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Southeast Elementary School, Brentwood Union
Free School District, 1 Melody Lane, Brentwood NY 11717

The reference number for these samples is EMSL Order #062225057. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225057

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/7/2022 02:42 PM
Collected: 12/7/2022

Project: #: 22-53405, Southeast Elementary School, Brentwood Union Free School District, 1 Melody Lane, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3067 **Collected:** 12/7/2022 **Lab ID:** 062225057-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3068 **Collected:** 12/7/2022 **Lab ID:** 062225057-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3069 **Collected:** 12/7/2022 **Lab ID:** 062225057-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Client Sample Description BRTWD-3070 **Collected:** 12/7/2022 **Lab ID:** 062225057-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/8/2022	BA	12/8/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0713	Classroom	1005	Kindergarten Room 2A	CF	11/5/2020	5:48:00 AM
BRTWD-0714	Classroom	1005	Kindergarten Room 2A	DW	11/5/2020	5:48:00 AM
BRTWD-0716	Classroom	1006	Kindergarten Room 1A	CF	11/5/2020	5:52:00 AM
BRTWD-0717	Classroom	1006	Kindergarten Room 1A	DW	11/5/2020	5:53:00 AM
BRTWD-0719	Classroom	1007	Room 3A	CF	11/5/2020	5:56:00 AM
BRTWD-0720	Classroom	1007	Room 3A	DW	11/5/2020	5:56:00 AM
BRTWD-0721	Classroom	1008	Room 4A	CF	11/5/2020	5:58:00 AM
BRTWD-0722	Classroom	1008	Room 4A	DW	11/5/2020	5:58:00 AM
BRTWD-0723	Classroom	1009	Room 5A	CF	11/5/2020	6:00:00 AM
BRTWD-0724	Classroom	1009	Room 5A	DW	11/5/2020	6:00:00 AM
BRTWD-0725	Classroom	1010	Room 6A	CF	11/5/2020	6:03:00 AM
BRTWD-0726	Classroom	1010	Room 6A	DW	11/5/2020	6:03:00 AM
BRTWD-0727	Classroom	1011	Room 7A	CF	11/5/2020	6:04:00 AM
BRTWD-0728	Classroom	1011	Room 7A	DW	11/5/2020	6:05:00 AM
BRTWD-0729	Classroom	1012	Room 8A	CF	11/5/2020	6:07:00 AM
BRTWD-0730	Classroom	1012	Room 8A	DW	11/5/2020	6:07:00 AM
BRTWD-0731	Classroom	1013	Room 9A	CF	11/5/2020	6:08:00 AM
BRTWD-0732	Classroom	1013	Room 9A	DW	11/5/2020	6:09:00 AM

Pb 200.5 - *A. Lamy* 12/01/20

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5 AL

Lab Received: Unique McKay

Signature: um 11/5/20 @ 12:39 pm

Samplers Name: A. Lina Castellano

Samplers Signature: A. Lina Castellano

JCB Project Manager: Meghan Gwynn

OrderID: 062020693

062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0733	Classroom	1014	Room 10A	CF	11/5/2020	6:11:00 AM
BRTWD-0734	Classroom	1014	Room 10A	DW	11/5/2020	6:11:00 AM
BRTWD-0735	Classroom	1016	Room 11A	CF	11/5/2020	6:13:00 AM
BRTWD-0736	Classroom	1016	Room 11A	DW	11/5/2020	6:13:00 AM
BRTWD-0737	Bathroom	1017	Men's Bathroom	BF	11/5/2020	6:15:00 AM
BRTWD-0738	Bathroom	1018	Women's Bathroom	BF	11/5/2020	6:15:00 AM
BRTWD-0739	Hallway	1021	Corridor Near Main Office (1020)	WC	11/5/2020	6:17:00 AM
BRTWD-0740	Nurse Office	1022B	Cafeteria Nurse's Office	NS	11/5/2020	6:19:00 AM
BRTWD-0741	Bathroom	1022B2	Cafeteria Nurse's Office Bathroom	BF	11/5/2020	6:19:00 AM
BRTWD-0743	Kitchen	1022D	Kitchen	HW	11/5/2020	6:22:00 AM
BRTWD-0744	Kitchen	1022D	Kitchen	SN	11/5/2020	6:24:00 AM
BRTWD-0745	Kitchen	1022D	Kitchen	KC	11/5/2020	6:24:00 AM
BRTWD-0748	Classroom	1025	Math Lab (Room 2)	CF	11/5/2020	6:28:00 AM
BRTWD-0749	Classroom	1025	Math Lab (Room 2)	DW	11/5/2020	6:29:00 AM
BRTWD-0750	Library	1026	Library	CF	11/5/2020	6:30:00 AM
BRTWD-0751	Classroom	1027	Room 4	CF	11/5/2020	6:32:00 AM
BRTWD-0752	Classroom	1027	Room 4	DW	11/5/2020	6:33:00 AM
BRTWD-0753	Classroom	1029B	Speech Room 6 Work Room 2	CF	11/5/2020	6:37:00 AM

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Pb200.5 -

Analysis Type: ELAP 200.5 @

Lab Received: Unique McKay

Signature: UM 11/5/20 @ 12:39 PM

Samplers Name: Alina CastellanoSamplers Signature: Alina CastellanoJCB Project Manager: Meghan Gwynn

OrderID: 062020693

062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: Southwest Elementary School
SWES

Client:
Brentwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0754	Classroom	1029B	Speech Room 6 Work Room 2	DW	11/5/2020	6:37:00 AM
BRTWD-0755	Classroom	1030	Math Lab Room 7	CF	11/5/2020	6:38:00 AM
BRTWD-0756	Classroom	1031	Room 8	CF	11/5/2020	6:39:00 AM
BRTWD-0757	Bathroom	1034	Men's Bathroom	BF	11/5/2020	6:40:00 AM
BRTWD-0758	Classroom	1041	Room 31	CF	11/5/2020	6:45:00 AM
BRTWD-0759	Classroom	1041	Room 31	DW	11/5/2020	6:46:00 AM
BRTWD-0760	Classroom	1042	Room 33	CF	11/5/2020	6:50:00 AM
BRTWD-0761	Classroom	1042	Room 33	DW	11/5/2020	6:51:00 AM
BRTWD-0762	Classroom	1043	Room 35	CF	11/5/2020	6:55:00 AM
BRTWD-0763	Classroom	1043	Room 35	DW	11/5/2020	6:55:00 AM
BRTWD-0764	Classroom	1045	Room 34	CF	11/5/2020	6:56:00 AM
BRTWD-0765	Classroom	1045	Room 34	DW	11/5/2020	6:57:00 AM
BRTWD-0766	Classroom	1046	Room 32	CF	11/5/2020	6:52:00 AM
BRTWD-0767	Classroom	1046	Room 32	DW	11/5/2020	6:53:00 AM
BRTWD-0768	Classroom	1047	Room 32	CF	11/5/2020	6:48:00 AM
BRTWD-0769	Classroom	1047	Room 30	DW	11/5/2020	6:49:00 AM
BRTWD-0770	Bathroom	1048	Women's Bathroom	BF	11/5/2020	6:58:00 AM
BRTWD-0772	Bathroom	1051	Men's Bathroom	BF	11/5/2020	7:00:00 AM

Building Address
1095 Joselson Avenue
Bay Shore, NY 11706

Ph 200.5 -
A. Lamy 12/01/20

Analysis Type: ELAP 200.5 (AU)
Lab Received: Unique McKay
Signature: um 11/5/20 @ 12:29 PM

Samplers Name: Arika Castelluzzo
Samplers Signature: Arika Castelluzzo
JCB Project Manager: Meghan Gwynn

062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0773	Cafeteria	1058	Cafeteria	WC	11/5/2020	7:02:00 AM
BRTWD-0775	Hallway	1066	Corridor Near Custodial Closet (1059)	DW	11/5/2020	7:05:00 AM
BRTWD-0776	Bathroom	1060	Women's Bathroom	BF	11/5/2020	6:43:00 AM
BRTWD-0777	Faculty Lounge	1063	Faculty Room	KC	11/5/2020	7:06:00 AM
BRTWD-0779	Nurse Office	1065	Nurse's Office	NS	11/5/2020	7:08:00 AM
BRTWD-0780	Bathroom	1065A	Nurse's Office Bathroom	BF	11/5/2020	7:07:00 AM
BRTWD-0786	Classroom	1071	Room 15	CF	11/5/2020	7:13:00 AM
BRTWD-0787	Classroom	1071	Room 15	DW	11/5/2020	7:13:00 AM
BRTWD-0788	Classroom	1072	Room 16	CF	11/5/2020	7:15:00 AM
BRTWD-0789	Classroom	1072	Room 16	DW	11/5/2020	7:15:00 AM
BRTWD-0790	Classroom	1073	Room 17	CF	11/5/2020	7:16:00 AM
BRTWD-0791	Classroom	1073	Room 17	DW	11/5/2020	7:16:00 AM
BRTWD-0792	Classroom	1074	Room 18	CF	11/5/2020	7:17:00 AM
BRTWD-0793	Classroom	1074	Room 18	DW	11/5/2020	7:17:00 AM
BRTWD-0794	Classroom	1075	Room 19	CF	11/5/2020	7:18:00 AM
BRTWD-0796	Classroom	1076	Room 20	CF	11/5/2020	7:20:00 AM
BRTWD-0797	Classroom	1076	Room 20	DW	11/5/2020	7:20:00 AM
BRTWD-0798	Bathroom	1077A1	Room 20X Bathroom	BF	11/5/2020	7:21:00 AM

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5 AD

Lab Received: Unique McKay

Signature: UM 11/5/20 @ 12:39 pm

Samplers Name: Alina Castellan

Samplers Signature: Alina Castellan

JCB Project Manager: Meghan Gwyn

OrderID: 062020693

062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0800	Classroom	1079	Room 21	CF	11/5/2020	7:22:00 AM
BRTWD-0801	Classroom	1079	Room 21	DW	11/5/2020	7:23:00 AM
BRTWD-0802	Classroom	1080	Room 22	CF	11/5/2020	7:24:00 AM
BRTWD-0803	Classroom	1080	Room 22	DW	11/5/2020	7:24:00 AM
BRTWD-0804	Classroom	1081	Room 23	CF	11/5/2020	7:25:00 AM
BRTWD-0805	Classroom	1081	Room 23	DW	11/5/2020	7:25:00 AM
BRTWD-0806	Classroom	1082	Room 24	CF	11/5/2020	7:26:00 AM
BRTWD-0807	Classroom	1082	Room 24	DW	11/5/2020	7:26:00 AM
BRTWD-0808	Classroom	1083	Room 25	CF	11/5/2020	7:29:00 AM
BRTWD-0809	Classroom	1083	Room 25	DW	11/5/2020	7:29:00 AM
BRTWD-0810	Classroom	1084	Room 26	CF	11/5/2020	7:30:00 AM
BRTWD-0815	Hallway	3008	Corridor Near Room 32	WC	11/5/2020	7:31:00 AM
BRTWD-0818	Classroom	3004	Room 36	CF	11/5/2020	7:32:00 AM
BRTWD-0819	Classroom	3004	Room 36	DW	11/5/2020	7:32:00 AM
BRTWD-0820	Classroom	3006	Room 38	DW	11/5/2020	7:33:00 AM
BRTWD-0821	Classroom	3006	Room 38	CF	11/5/2020	7:33:00 AM
BRTWD-0822	Classroom	3005	Room 37	CF	11/5/2020	7:34:00 AM
BRTWD-0823	Classroom	3005	Room 37	DW	11/5/2020	7:34:00 AM

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Pb 200.5 -
A. J. Jany 12/01/20

Analysis Type: ELAP 200.5 (4L)

Lab Received: Unique McKaySignature: um 11/5/20 @ 12:39 AMSamplers Name: Alina CastelliSamplers Signature: Alina CastelliJCB Project Manager: Meghan Gwynn

OrderID: 062020693

062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	ASHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0824	Classroom	3007	Room39	CF	11/5/2020	7:35:00 AM
BRTWD-0825	Classroom	3007	Room 39	DW	11/5/2020	7:35:00 AM
BRTWD-0826	Classroom	2003	Room 13A	CF	11/5/2020	7:42:00 AM
BRTWD-0827	Classroom	2003	Room 13A	DW	11/5/2020	7:42:00 AM
BRTWD-0828	Classroom	2004	Room 12A	CF	11/5/2020	7:44:00 AM
BRTWD-0829	Classroom	2004	Room 12A	DW	11/5/2020	7:44:00 AM
BRTWD-0830	Classroom	2005	Room 15A	CF	11/5/2020	7:46:00 AM
BRTWD-0831	Classroom	2005	Room 15A	DW	11/5/2020	7:46:00 AM
BRTWD-0832	Classroom	2006	Room 14A	CF	11/5/2020	7:47:00 AM
BRTWD-0833	Classroom	2006	Room 14A	DW	11/5/2020	7:47:00 AM
BRTWD-0834	Classroom	2007	Room 17A	CF	11/5/2020	7:48:00 AM
BRTWD-0835	Classroom	2007	Room 17A	DW	11/5/2020	7:48:00 AM
BRTWD-0836	Classroom	2008	Room 16A	CF	11/5/2020	7:49:00 AM
BRTWD-0837	Classroom	2008	Room 16A	DW	11/5/2020	7:49:00 AM
BRTWD-0838	Classroom	2009	Room 19A	CF	11/5/2020	7:50:00 AM
BRTWD-0839	Classroom	2009	Room 19A	DW	11/5/2020	7:50:00 AM
BRTWD-0840	Classroom	2010	Room 18A	CF	11/5/2020	7:51:00 AM
BRTWD-0841	Classroom	2010	Room 18A	DW	11/5/2020	7:51:00 AM

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5 AL

Lab Received: Unique mckay

Signature: um 11/5/20 @ 12:39pm

Samplers Name: Alina Castelluzzo

Samplers Signature: Alina Castelluzzo

JCB Project Manager: Meghan Gwynn

P200.5 -
A. Lany 12/10/20

062020693

OrderID: 062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0842	Classroom	2011	Room 21A	CF	11/5/2020	7:52:00 AM
BRTWD-0843	Classroom	2011	Room 21A	DW	11/5/2020	7:52:00 AM
BRTWD-0844	Classroom	2012	Room 20A	CF	11/5/2020	7:53:00 AM
BRTWD-0845	Classroom	2012	Room 20A	DW	11/5/2020	7:53:00 AM
BRTWD-0846	Classroom	2014	Room 22A	CF	11/5/2020	7:55:00 AM
BRTWD-0847	Classroom	2014	Room 22A	DW	11/5/2020	7:55:00 AM
BRTWD-0848	Bathroom	2015B	ESL Room 23A Bathroom	BF	11/5/2020	7:56:00 AM
BRTWD-0849	Bathroom	2015C	ESL Room 23A Bathroom	BF	11/5/2020	7:57:00 AM
BRTWD-0851	Classroom	2021	Room 46	CF	11/5/2020	8:04:00 AM
BRTWD-0852	Classroom	2021	Room 46	DW	11/5/2020	8:04:00 AM
BRTWD-0853	Classroom	2022	Room 45	CF	11/5/2020	8:06:00 AM
BRTWD-0854	Classroom	2022	Room 45	DW	11/5/2020	8:06:00 AM
BRTWD-0855	Classroom	2023	Room 44	CF	11/5/2020	8:07:00 AM
BRTWD-0856	Classroom	2023	Room 44	DW	11/5/2020	8:07:00 AM
BRTWD-0857	Classroom	2024	Room 43	CF	11/5/2020	8:08:00 AM
BRTWD-0858	Classroom	2024	Room 43	DW	11/5/2020	8:08:00 AM
BRTWD-0859	Classroom	2025	Room 42	CF	11/5/2020	8:09:00 AM
BRTWD-0860	Classroom	2025	Room 42	DW	11/5/2020	8:09:00 AM

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5 AL

Lab Received: Unique Makay

Signature: um 11/5/20 @ 12:39pm

Samplers Name: A. Lynn Costello

Samplers Signature: alynn costello

JCB Project Manager: Meaghan Gwynn

PB 200.5 -

A. Lynn 12/01/20

OrderID: 062020693

062020693



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0861	Classroom	2026	Room 41	CF	11/5/2020	8:10:00 AM
BRTWD-0862	Classroom	2026	Room 41	DW	11/5/2020	8:10:00 AM
BRTWD-0870	Classroom	2028	Room 40	CF	11/5/2020	8:11:00 AM
BRTWD-0871	Classroom	2028	Room 40	DW	11/5/2020	8:11:00 AM
BRTWD-0872	Kitchen	1058A	Kitchen	HW	11/5/2020	5:32:00 AM
BRTWD-0873	Kitchen	1058A	Kitchen	SN	11/5/2020	5:33:00 AM
BRTWD-0874	Kitchen	1058A	Kitchen	KC	11/5/2020	5:34:00 AM
BRTWD-0875	Kitchen	1058A	Kitchen	PK	11/5/2020	5:36:00 AM
BRTWD-0876	Kitchen	1058A	Kitchen	KC	11/5/2020	5:37:00 AM
BRTWD-0877	Kitchen	1058A	Kitchen	SN	11/5/2020	5:38:00 AM
BRTWD-0878	Kitchen	1058A	Kitchen	KC	11/5/2020	5:38:00 AM
BRTWD-0879	Kitchen	1058A	Kitchen	KC	11/5/2020	5:39:00 AM
BRTWD-0880	Kitchen	1058A	Kitchen	HW	11/5/2020	5:39:00 AM
BRTWD-0884	Bathroom	1058F	Kitchen Bathroom	BF	11/5/2020	5:40:00 AM
BRTWD-0885	Classroom	1028	Room 5	CF	11/5/2020	6:34:00 AM
BRTWD-0886	Classroom	1028	Room 5	DW	11/5/2020	6:35:00 AM

Samples Submitted 142

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5 AL

Lab Received: Unique McKay

Signature: um 11/5/20 @ 12:39 PM

Samplers Name: A. Lina Castellan

Samplers Signature: A. Lina Castellan

JCB Project Manager: Meghan Gwynn

Pb200.5 -
A. Lina Castellan 12/01/20

OrderID: 062020693

062020693



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/5/2020. The results are tabulated on the attached data pages for the following client designated project:

Southwest Elementary School, 1095 Joselson Avenue, Bay
Shore, NY 11706, Brentwood Union Free School District, 19-45270

The reference number for these samples is EMSL Order #062020693. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0713
 Kindergarten Room 2A
Collected: 11/5/2020 **Lab ID:** 062020693-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0714
 Kindergarten Room 2A
Collected: 11/5/2020 **Lab ID:** 062020693-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0716
 Kindergarten Room 1A
Collected: 11/5/2020 **Lab ID:** 062020693-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0717
 Kindergarten Room 1A
Collected: 11/5/2020 **Lab ID:** 062020693-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0719
 Room 3A
Collected: 11/5/2020 **Lab ID:** 062020693-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0720
 Room 3A
Collected: 11/5/2020 **Lab ID:** 062020693-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0721
 Room 4A
Collected: 11/5/2020 **Lab ID:** 062020693-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0722 Room 4A	Collected:		11/5/2020	Lab ID:		062020693-0008
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0723 Room 5A	Collected:		11/5/2020	Lab ID:		062020693-0009
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0724 Room 5A	Collected:		11/5/2020	Lab ID:		062020693-0010
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0725 Room 6A	Collected:		11/5/2020	Lab ID:		062020693-0011
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0726 Room 6A	Collected:		11/5/2020	Lab ID:		062020693-0012
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0727 Room 7A	Collected:		11/5/2020	Lab ID:		062020693-0013
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0728 Room 7A	Collected:		11/5/2020	Lab ID:		062020693-0014
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0729 Room 8A	Collected:		11/5/2020	Lab ID:		062020693-0015
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0729 Room 8A		Collected:	11/5/2020	Lab ID:	062020693-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.7	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0730 Room 8A		Collected:	11/5/2020	Lab ID:	062020693-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0731 Room 9A		Collected:	11/5/2020	Lab ID:	062020693-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0732 Room 9A		Collected:	11/5/2020	Lab ID:	062020693-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0733 Room 10A		Collected:	11/5/2020	Lab ID:	062020693-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0734 Room 10A		Collected:	11/5/2020	Lab ID:	062020693-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0735 Room 11A		Collected:	11/5/2020	Lab ID:	062020693-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0736 Room 11A	Collected:	11/5/2020	Lab ID:	062020693-0022		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0737 Men's Bathroom	Collected:	11/5/2020	Lab ID:	062020693-0023		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0738 Women's Bathroom	Collected:	11/5/2020	Lab ID:	062020693-0024		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0739 Corridor Near Main Office (1020)	Collected:	11/5/2020	Lab ID:	062020693-0025		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0740 Cafeteria Nurse's Office	Collected:	11/5/2020	Lab ID:	062020693-0026		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0741 Cafeteria Nurse's Office Bathroom	Collected:	11/5/2020	Lab ID:	062020693-0027		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0743 Kitchen	Collected:	11/5/2020	Lab ID:	062020693-0028		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0	µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0744
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0745
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0748
Math Lab (Room 2)
Collected: 11/5/2020
Lab ID: 062020693-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0749
Math Lab (Room 2)
Collected: 11/5/2020
Lab ID: 062020693-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0750
Library
Collected: 11/5/2020
Lab ID: 062020693-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0751
Room 4
Collected: 11/5/2020
Lab ID: 062020693-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0752
Room 4
Collected: 11/5/2020
Lab ID: 062020693-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0753
Speech Room 6 Work Room 2
Collected: 11/5/2020
Lab ID: 062020693-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0754
Speech Room 6 Work Room 2
Collected: 11/5/2020
Lab ID: 062020693-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0755
Math Lab Room 7
Collected: 11/5/2020
Lab ID: 062020693-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0756
Room 8
Collected: 11/5/2020
Lab ID: 062020693-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0757
Men's Bathroom
Collected: 11/5/2020
Lab ID: 062020693-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0758
Room 31
Collected: 11/5/2020
Lab ID: 062020693-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0759
Room 31
Collected: 11/5/2020
Lab ID: 062020693-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0760
Room 33
Collected: 11/5/2020
Lab ID: 062020693-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0760 Room 33	Collected:	11/5/2020	Lab ID:	062020693-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0761 Room 33	Collected:	11/5/2020	Lab ID:	062020693-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0762 Room 35	Collected:	11/5/2020	Lab ID:	062020693-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0763 Room 35	Collected:	11/5/2020	Lab ID:	062020693-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0764 Room 34	Collected:	11/5/2020	Lab ID:	062020693-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0765 Room 34	Collected:	11/5/2020	Lab ID:	062020693-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0766 Room 32	Collected:	11/5/2020	Lab ID:	062020693-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0767 Room 32	Collected:	11/5/2020	Lab ID:	062020693-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0767 Room 32	Collected:	11/5/2020	Lab ID:	062020693-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0768 Room 32	Collected:	11/5/2020	Lab ID:	062020693-0051		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0769 Room 30	Collected:	11/5/2020	Lab ID:	062020693-0052		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0770 Women's Bathroom	Collected:	11/5/2020	Lab ID:	062020693-0053		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0772 Men's Bathroom	Collected:	11/5/2020	Lab ID:	062020693-0054		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0773 Cafeteria	Collected:	11/5/2020	Lab ID:	062020693-0055		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0775 Corridor Near Custodial Closet (1059)	Collected:	11/5/2020	Lab ID:	062020693-0056		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	11/27/2020	DI	11/30/2020	AL
Client Sample Description		BRTWD-0776 Women's Bathroom	Collected:	11/5/2020	Lab ID:	062020693-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0776
Women's Bathroom
Collected: 11/5/2020
Lab ID: 062020693-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0777
Faculty Room
Collected: 11/5/2020
Lab ID: 062020693-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0779
Nurse's Office
Collected: 11/5/2020
Lab ID: 062020693-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0780
Nurse's Office Bathroom
Collected: 11/5/2020
Lab ID: 062020693-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0786
Room 15
Collected: 11/5/2020
Lab ID: 062020693-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0787
Room 15
Collected: 11/5/2020
Lab ID: 062020693-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0788
Room 16
Collected: 11/5/2020
Lab ID: 062020693-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0789
Room 16
Collected: 11/5/2020
Lab ID: 062020693-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0790
Room 17
Collected: 11/5/2020
Lab ID: 062020693-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0791
Room 17
Collected: 11/5/2020
Lab ID: 062020693-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0792
Room 18
Collected: 11/5/2020
Lab ID: 062020693-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0793
Room 18
Collected: 11/5/2020
Lab ID: 062020693-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0794
Room 19
Collected: 11/5/2020
Lab ID: 062020693-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0796
Room 20
Collected: 11/5/2020
Lab ID: 062020693-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0797
Room 20
Collected: 11/5/2020
Lab ID: 062020693-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0797
Room 20
Collected: 11/5/2020
Lab ID: 062020693-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0798
Room 20X Bathroom
Collected: 11/5/2020
Lab ID: 062020693-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0800
Room 21
Collected: 11/5/2020
Lab ID: 062020693-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0801
Room 21
Collected: 11/5/2020
Lab ID: 062020693-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0802
Room 22
Collected: 11/5/2020
Lab ID: 062020693-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0803
Room 22
Collected: 11/5/2020
Lab ID: 062020693-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0804
Room 23
Collected: 11/5/2020
Lab ID: 062020693-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0805
Room 23
Collected: 11/5/2020
Lab ID: 062020693-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0806
Room 24
Collected: 11/5/2020
Lab ID: 062020693-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0807
Room 24
Collected: 11/5/2020
Lab ID: 062020693-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Client Sample Description BRTWD-0808
Room 25
Collected: 11/5/2020
Lab ID: 062020693-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0809
Room 25
Collected: 11/5/2020
Lab ID: 062020693-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0810
Room 26
Collected: 11/5/2020
Lab ID: 062020693-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0815
Corridor Near Room 32
Collected: 11/5/2020
Lab ID: 062020693-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0818
Room 36
Collected: 11/5/2020
Lab ID: 062020693-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0819
Room 36
Collected: 11/5/2020
Lab ID: 062020693-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0820
Room 38
Collected: 11/5/2020
Lab ID: 062020693-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0821
Room 38
Collected: 11/5/2020
Lab ID: 062020693-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0822
Room 37
Collected: 11/5/2020
Lab ID: 062020693-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0823
Room 37
Collected: 11/5/2020
Lab ID: 062020693-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0824
Room 39
Collected: 11/5/2020
Lab ID: 062020693-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0825
Room 39
Collected: 11/5/2020
Lab ID: 062020693-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0826
Room 13A
Collected: 11/5/2020
Lab ID: 062020693-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0827
Room 13A
Collected: 11/5/2020
Lab ID: 062020693-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0828
Room 12A
Collected: 11/5/2020
Lab ID: 062020693-0095

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0829
Room 12A
Collected: 11/5/2020
Lab ID: 062020693-0096

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0830
Room 15A
Collected: 11/5/2020
Lab ID: 062020693-0097

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0831
Room 15A
Collected: 11/5/2020
Lab ID: 062020693-0098

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0832 Room 14A	Collected:	11/5/2020	Lab ID:	062020693-0099		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0833 Room 14A	Collected:	11/5/2020	Lab ID:	062020693-0100		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0834 Room 17A	Collected:	11/5/2020	Lab ID:	062020693-0101		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.8	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0835 Room 17A	Collected:	11/5/2020	Lab ID:	062020693-0102		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0836 Room 16A	Collected:	11/5/2020	Lab ID:	062020693-0103		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.5	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0837 Room 16A	Collected:	11/5/2020	Lab ID:	062020693-0104		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0838 Room 19A	Collected:	11/5/2020	Lab ID:	062020693-0105		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0	µg/L	11/30/2020	DI	12/1/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0839 Room 19A	Collected:	11/5/2020	Lab ID:	062020693-0106		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0840 Room 18A	Collected:	11/5/2020	Lab ID:	062020693-0107		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0841 Room 18A	Collected:	11/5/2020	Lab ID:	062020693-0108		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		BRTWD-0842 Room 21A	Collected:	11/5/2020	Lab ID:	062020693-0109		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0843 Room 21A	Collected:	11/5/2020	Lab ID:	062020693-0110		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0844 Room 20A	Collected:	11/5/2020	Lab ID:	062020693-0111		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
Client Sample Description		BRTWD-0845 Room 20A	Collected:	11/5/2020	Lab ID:	062020693-0112		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	11/30/2020	DI	12/1/2020	AL
		Lead MDL: 1.0µg/L						

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description		BRTWD-0846 Room 22A		Collected:	11/5/2020	Lab ID:	062020693-0113	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	12	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Client Sample Description		BRTWD-0847 Room 22A		Collected:	11/5/2020	Lab ID:	062020693-0114	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	1.6 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0848 ESL Room 23 A Bathroom		Collected:	11/5/2020	Lab ID:	062020693-0115	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	6.7	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Client Sample Description		BRTWD-0849 ESL Room 23 A Bathroom		Collected:	11/5/2020	Lab ID:	062020693-0116	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	5.8	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Client Sample Description		BRTWD-0851 Room 46		Collected:	11/5/2020	Lab ID:	062020693-0117	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	1.8 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0852 Room 46		Collected:	11/5/2020	Lab ID:	062020693-0118	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	1.1 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-0853 Room 45		Collected:	11/5/2020	Lab ID:	062020693-0119	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	2.1 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL	
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0854
Room 45
Collected: 11/5/2020
Lab ID: 062020693-0120

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0855
Room 44
Collected: 11/5/2020
Lab ID: 062020693-0121

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0856
Room 44
Collected: 11/5/2020
Lab ID: 062020693-0122

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0857
Room 43
Collected: 11/5/2020
Lab ID: 062020693-0123

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	40	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0858
Room 43
Collected: 11/5/2020
Lab ID: 062020693-0124

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0859
Room 42
Collected: 11/5/2020
Lab ID: 062020693-0125

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0860
Room 42
Collected: 11/5/2020
Lab ID: 062020693-0126

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: **Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270**

Analytical Results

Client Sample Description BRTWD-0861
Room 41
Collected: 11/5/2020
Lab ID: 062020693-0127

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0862
Room 41
Collected: 11/5/2020
Lab ID: 062020693-0128

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0870
Room 40
Collected: 11/5/2020
Lab ID: 062020693-0129

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0871
Room 40
Collected: 11/5/2020
Lab ID: 062020693-0130

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0872
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0131

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.2	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0873
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0132

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0874
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0133

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/5/2020 12:39 PM
 Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0875
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0134

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Client Sample Description BRTWD-0876
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0135

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0877
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0136

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0878
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0137

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0879
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0138

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0880
Kitchen
Collected: 11/5/2020
Lab ID: 062020693-0139

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0884
Kitchen Bathroom
Collected: 11/5/2020
Lab ID: 062020693-0140

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/30/2020	DI	12/1/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020693

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/5/2020 12:39 PM
Collected: 11/5/2020

Project: Southwest Elementary School, 1095 Joselson Avenue, Bay Shore, NY 11706, Brentwood Union Free School District, 19-45270

Analytical Results

Client Sample Description BRTWD-0885 **Collected:** 11/5/2020 **Lab ID:** 062020693-0141
Room 5

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/27/2020	DI	11/30/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0886 **Collected:** 11/5/2020 **Lab ID:** 062020693-0142
Room 5

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	11/27/2020	DI	11/30/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: Southwest Elementary School

SWES

062110640

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0735	Classroom	1016	Room 11A	CF	6/17/2021	7:19:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4: 04

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: Alyssa McDonald

Signature: Alyssa McDonald

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, Southwest Elementary School, Brentwood Union Free
School District, 1095 Joselson Avenue, Bay Shore, NY 11706**

The reference number for these samples is EMSL Order #062110640. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110640

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:04 PM
Collected: 6/17/2021

Project: #21-48246, Southwest Elementary School, Brentwood Union Free School District, 1095 Joselson Avenue, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-0735 **Collected:** 6/17/2021 **Lab ID:** 062110640-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

21-48246

Building:

Southwest Elementary School

SWES

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0842	Classroom	2011	Room 21A	CF	8/23/2022	8:16:00 AM
BRTWD-0857	Classroom	2024	Room 43	CF	8/23/2022	8:12:00 AM

Samples Submitted 2

Pb 200.5
[Signature]
8/29/22

RECEIVED
ENHANCED ANALYTICAL, INC.
CARLE PLACE, NY
2022 AUG 23 P 12: 24



Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: 8/23/22 @ 12:24pm

Signature: *[Signature]*

Samplers Name: Meghan Guynn

Samplers Signature: *[Signature]*

JCB Project Manager: Meghan Guynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/23/2022. The results are tabulated on the attached data pages for the following client designated project:

**JCB # 21-48246, Southwest Elementary School, SWES,
Brentwood Union Free School District, 1095 Joselson Avenue
Bay Shore, NY 11706**

The reference number for these samples is EMSL Order #062218237. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218237

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/23/2022 12:24 PM
Collected: 8/23/2022

Project: JCB # 21-48246, Southwest Elementary School, SWES, Brentwood Union Free School District, 1095 Joselson Avenue Bay Shore, NY

Analytical Results

Client Sample Description BRTWD-0842 **Collected:** 8/23/2022 **Lab ID:** 062218237-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Client Sample Description BRTWD-0857 **Collected:** 8/23/2022 **Lab ID:** 062218237-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	8/29/2022	CM	8/29/2022	CM
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53405

Building:

Southwest Elementary School

SWES

062225146

Client:

Brentwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3075	HA	1066	Corridor Main Office To Boiler Room	WC	12/8/2022	7:02:00 AM
BRTWD-3076	HA	1066	Corridor Main Office To Boiler Room	WF	12/8/2022	7:03:00 AM
BRTWD-3077	HA	1021	Kindergarten Rooms Corridor	WC	12/8/2022	7:06:00 AM
BRTWD-3078	HA	1021	Kindergarten Rooms Corridor	WF	12/8/2022	7:07:00 AM

Samples Submitted 4

Pb 200.5

Bernie Akter 12/10/22

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC -8 P 4:42

Building Address

1095 Joselson Avenue

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: Alex Usch

12/8/22

Signature: Alex Usch

4:42 PM

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/12/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/8/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Southwest Elementary School, Brentwood Union
Free School District, 1095 Joselson Avenue, Bay Shore NY 11706

The reference number for these samples is EMSL Order #062225146. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062225146

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/8/2022 04:42 PM
 Collected: 12/8/2022

Project: #: 22-53405, Southwest Elementary School, Brentwood Union Free School District, 1095 Joselson Avenue, Bay Shore NY 11706

Analytical Results

Client Sample Description BRTWD-3075 **Collected:** 12/8/2022 **Lab ID:** 062225146-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3076 **Collected:** 12/8/2022 **Lab ID:** 062225146-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3077 **Collected:** 12/8/2022 **Lab ID:** 062225146-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-3078 **Collected:** 12/8/2022 **Lab ID:** 062225146-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062022448

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Special Services Building

SSB

Client:

Brentwood Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2945	Bathroom	1021A	Offices Bathroom	BF	12/3/2020	7:36:00 AM
BRTWD-2946	Bathroom	1015	Women's Bathroom	BF	12/3/2020	7:37:00 AM
BRTWD-2947	Bathroom	1014	Unisex Bathroom	BF	12/3/2020	7:38:00 AM
BRTWD-2948	Faculty Lounge	1011	Faculty Room	CF	12/3/2020	7:40:00 AM
BRTWD-2950	Faculty Lounge	1011	Faculty Room	BW	12/3/2020	7:40:00 AM

Samples Submitted 5

20 DEC -3 PM 6:25
 ANALYTICAL, INC.
 C/O FILE PLACE, NY

Building Address

775 Wisconsin Avenue

Brentwood, NY 11717

Ampex McDonald 12/11/20

Analysis Type: ELAP 200.5

Lab Received: Unique McKelveySignature: LM 12/3/20 6:25 PMSamplers Name: Alicia CastellanoSamplers Signature: Alicia CastellanoJCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/3/2020. The results are tabulated on the attached data pages for the following client designated project:

**Special Services Building, 775 Wisconsin Avenue, Brentwood,
NY 11717, Brentwood Union Free School District, Project # 19-
45270**

The reference number for these samples is EMSL Order #062022448. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022448

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/3/2020 06:25 PM
 Collected: 12/3/2020

Project: **Special Services Building, 775 Wisconsin Avenue, Brentwood, NY 11717, Brentwood Union Free School District, Project # 19-45270**

Analytical Results

Client Sample Description BRTWD-2945 **Collected:** 12/3/2020 **Lab ID:** 062022448-0001

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM

Client Sample Description BRTWD-2946 **Collected:** 12/3/2020 **Lab ID:** 062022448-0002

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM

Client Sample Description BRTWD-2947 **Collected:** 12/3/2020 **Lab ID:** 062022448-0003

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM

Client Sample Description BRTWD-2948 **Collected:** 12/3/2020 **Lab ID:** 062022448-0004

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM

Client Sample Description BRTWD-2950 **Collected:** 12/3/2020 **Lab ID:** 062022448-0005

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	12/11/2020	OR	12/11/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246
Building: Special Services Building
SSB

Client:
Brentwood Union Free School District
Retest/New Install ☒
Turn Around: Normal 1 wk Rush _____

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3003	FL	1011	Faculty Room	KC	10/28/2021	6:58:00 AM

Samples Submitted 1

Pl. Tang
2005 11/2/21

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
2021 OCT 28 P 12:07

Building Address
775 Wisconsin Avenue
Bayshore, NY 11717

Analysis Type: ELAP 200.5**Lab Received:** Unique McKay**Signature:** LM**Samplers Name:** Meghan Gwynn**Samplers Signature:** Meghan Gwynn**JCB Project Manager:** Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

11/2/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/28/2021. The results are tabulated on the attached data pages for the following client designated project:

Special Services Building, 775 Wisconsin Avenue, Bayshore, NY
11717, Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062121666. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062121666

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/28/2021 12:07 PM
Collected: 10/28/2021

Project: **Special Services Building, 775 Wisconsin Avenue, Bayshore, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-3003 **Collected:** 10/28/2021 **Lab ID:** 062121666-0001
Faculty Room

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/2/2021	TH	11/2/2021	TH

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062021458

Page 1 of 6

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0902	Classroom	N/A	Room 1A	CF	11/17/2020	5:43:00 AM
BRTWD-0903	Classroom	N/A	Room 1A	DW	11/17/2020	5:43:00 AM
BRTWD-0904	Classroom	N/A	Room 2A	DW	11/17/2020	5:45:00 AM
BRTWD-0905	Classroom	N/A	Room 2A	CF	11/17/2020	5:45:00 AM
BRTWD-0906	Classroom	1001	Kindergarten Room 2	CF	11/17/2020	5:47:00 AM
BRTWD-0907	Classroom	1001	Kindergarten Room 2	DW	11/17/2020	5:47:00 AM
BRTWD-0908	Classroom	1000	Room 1	CF	11/17/2020	5:48:00 AM
BRTWD-0909	Classroom	1000	Room 1	DW	11/17/2020	5:48:00 AM
BRTWD-0911	Classroom	1003	Room 3	CF	11/17/2020	5:50:00 AM
BRTWD-0912	Classroom	1003	Room 3	DW	11/17/2020	5:50:00 AM
BRTWD-0913	Classroom	1004	Room 4	CF	11/17/2020	5:52:00 AM
BRTWD-0914	Classroom	1004	Room 4	DW	11/17/2020	5:52:00 AM
BRTWD-0915	Bathroom	1004C	Room 4 Bathroom	BF	11/17/2020	5:52:00 AM
BRTWD-0916	Classroom	1005	Room 5	CF	11/17/2020	5:55:00 AM
BRTWD-0917	Classroom	1005	Room 5	DW	11/17/2020	5:55:00 AM
BRTWD-0918	Classroom	1007	Kindergarten Room 6	BW	11/17/2020	5:56:00 AM
BRTWD-0919	Classroom	1007	Kindergarten Room 6	CF	11/17/2020	5:56:00 AM
BRTWD-0920	Classroom	1007	Kindergarten Room 6	DW	11/17/2020	5:57:00 AM

Building Address

2 Mur Place

Brentwood, NY 11717

Pb 200.5 Dr [Signature]
12/15/2020

Analysis Type: ELAP 200.5

Lab Received: [Signature]

Signature: [Signature]

Samplers Name: Alina Castellan

Samplers Signature: [Signature]

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062021458

Page 2 of 6

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0921	Bathroom	1007C	Kindergarten Room 6 Bathroom	BF	11/17/2020	5:57:00 AM
BRTWD-0922	Classroom	1008	Room 7	CF	11/17/2020	5:59:00 AM
BRTWD-0923	Classroom	1008	Room 7	DW	11/17/2020	5:59:00 AM
BRTWD-0924	Classroom	1009	Room 8	CF	11/17/2020	6:00:00 AM
BRTWD-0925	Classroom	1009	Room 8	DW	11/17/2020	6:01:00 AM
BRTWD-0926	Classroom	1010	Room 9	CF	11/17/2020	6:02:00 AM
BRTWD-0927	Classroom	1010	Room 9	DW	11/17/2020	6:02:00 AM
BRTWD-0928	Classroom	1011	Room 10	CF	11/17/2020	6:03:00 AM
BRTWD-0929	Classroom	1011	Room 10	DW	11/17/2020	6:03:00 AM
BRTWD-0930	Classroom	1012	Room 11	CF	11/17/2020	6:05:00 AM
BRTWD-0931	Classroom	1012	Room 11	DW	11/17/2020	6:05:00 AM
BRTWD-0932	Classroom	1013	Room 12	CF	11/17/2020	6:07:00 AM
BRTWD-0933	Classroom	1013	Room 12	DW	11/17/2020	6:07:00 AM
BRTWD-0934	Classroom	1014	Room 13	CF	11/17/2020	6:08:00 AM
BRTWD-0935	Classroom	1014	Room 13	DW	11/17/2020	6:08:00 AM
BRTWD-0936	Classroom	1016	Room 15A	CF	11/17/2020	6:09:00 AM
BRTWD-0937	Classroom	1016	Room 15A	DW	11/17/2020	6:09:00 AM
BRTWD-0938	Classroom	1015	Computer Room 14	CF	11/17/2020	6:11:00 AM

Building Address

2 Mur Place

Brentwood, NY 11717

Pb 200.5 DOG
12/15/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alicia Costello

Samplers Signature: Alicia Costello

JCB Project Manager: Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062021458

Page 3 of 6

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0939	Classroom	1015	Computer Room 14	DW	11/17/2020	6:11:00 AM
BRTWD-0940	Classroom	1019	Room 16	CF	11/17/2020	6:12:00 AM
BRTWD-0941	Classroom	1019	Room 16	DW	11/17/2020	6:13:00 AM
BRTWD-0947	Nurse Office	1036	Nurse's Office	NS	11/17/2020	6:16:00 AM
BRTWD-0948	Storage	1038	Nurse's Office Back Office	NS	11/17/2020	6:17:00 AM
BRTWD-0949	Bathroom	1036A	Nurse Office Bathroom	BF	11/17/2020	6:18:00 AM
BRTWD-0950	Bathroom	1032A	Girls Locker Room Bathroom	BF	11/17/2020	6:24:00 AM
BRTWD-0952	Bathroom	1034A	Boys Locker Room Bathroom	BF	11/17/2020	6:27:00 AM
BRTWD-0953	Hallway	1044	Corridor Near Custodial Office	DW	11/17/2020	6:29:00 AM
BRTWD-0955	Classroom	1048	Music Room	CF	11/17/2020	6:35:00 AM
BRTWD-0963	Classroom	1052	Room 18	CF	11/17/2020	6:37:00 AM
BRTWD-0964	Classroom	1052	Room 18	DW	11/17/2020	6:37:00 AM
BRTWD-0965	Classroom	1053	Room 17	CF	11/17/2020	6:38:00 AM
BRTWD-0966	Classroom	1053	Room 17	DW	11/17/2020	6:38:00 AM
BRTWD-0967	Classroom	1054	Room 20	CF	11/17/2020	6:40:00 AM
BRTWD-0968	Classroom	1054	Room 20	DW	11/17/2020	6:40:00 AM
BRTWD-0969	Classroom	1055	Room 19	CF	11/17/2020	6:41:00 AM
BRTWD-0970	Classroom	1055	Room 19	DW	11/17/2020	6:41:00 AM

Building Address

2 Mur Place

Brentwood, NY 11717

Pb 200.5
12/15/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Alina Castelluzzo

Alina Castelluzzo

Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062-021458

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 4 of 6

OrderID: 062021458

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0971	Classroom	1056	Room 22	CF	11/17/2020	6:42:00 AM
BRTWD-0972	Classroom	1056	Room 22	DW	11/17/2020	6:43:00 AM
BRTWD-0973	Classroom	1057	Room 21	CF	11/17/2020	6:44:00 AM
BRTWD-0974	Classroom	1057	Room 21	DW	11/17/2020	6:44:00 AM
BRTWD-0975	Classroom	1058	Room 24	CF	11/17/2020	6:45:00 AM
BRTWD-0976	Classroom	1058	Room 24	DW	11/17/2020	6:45:00 AM
BRTWD-0977	Classroom	1059	Room 23	CF	11/17/2020	6:47:00 AM
BRTWD-0979	Classroom	1060	Room 26	CF	11/17/2020	6:48:00 AM
BRTWD-0980	Classroom	1060	Room 26	DW	11/17/2020	6:48:00 AM
BRTWD-0981	Classroom	1061	Room 25	CF	11/17/2020	6:50:00 AM
BRTWD-0982	Classroom	1061	Room 25	DW	11/17/2020	6:50:00 AM
BRTWD-0983	Classroom	1062	Room 28	CF	11/17/2020	6:51:00 AM
BRTWD-0984	Classroom	1062	Room 28	DW	11/17/2020	6:52:00 AM
BRTWD-0985	Classroom	1063	Room 27	CF	11/17/2020	6:53:00 AM
BRTWD-0986	Classroom	1063	Room 27	DW	11/17/2020	6:53:00 AM
BRTWD-0987	Classroom	1064	Room 30	CF	11/17/2020	6:55:00 AM
BRTWD-0988	Classroom	1064	Room 30	DW	11/17/2020	6:55:00 AM
BRTWD-0989	Classroom	1064	Room 30	BW	11/17/2020	6:55:00 AM

Building Address

2 Mur Place

Brentwood, NY 11717

Pb 200.5 DOZ
12/15/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Akina Casper 11/17/20
Akina Casper
MPghan Gw: ym



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062021458

Client:

Brentwood Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush

Page 5 of 6

OrderID: 062021458

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0990	Classroom	1065	Room 29	CF	11/17/2020	6:57:00 AM
BRTWD-0991	Classroom	1065	Room 29	DW	11/17/2020	6:57:00 AM
BRTWD-0996	Hallway	N/A	Corridor Near Bathrooms	WC	11/17/2020	6:58:00 AM
BRTWD-0997	Bathroom	N/A	Unisex Bathroom	BF	11/17/2020	6:59:00 AM
BRTWD-1000	Classroom	N/A	Room 31	CF	11/17/2020	7:01:00 AM
BRTWD-1001	Classroom	N/A	Room 31	DW	11/17/2020	7:01:00 AM
BRTWD-1002	Classroom	N/A	Room 32	CF	11/17/2020	7:02:00 AM
BRTWD-1003	Classroom	N/A	Room 32	DW	11/17/2020	7:02:00 AM
BRTWD-1004	Classroom	N/A	Room 33	CF	11/17/2020	7:04:00 AM
BRTWD-1005	Classroom	N/A	Room 33	DW	11/17/2020	7:04:00 AM
BRTWD-1006	Classroom	N/A	Room 34	DW	11/17/2020	7:06:00 AM
BRTWD-1007	Classroom	N/A	Room 34	CF	11/17/2020	7:06:00 AM
BRTWD-1008	Classroom	N/A	Room 35	CF	11/17/2020	7:07:00 AM
BRTWD-1009	Classroom	N/A	Room 35	DW	11/17/2020	7:07:00 AM
BRTWD-1010	Classroom	N/A	Room 36	CF	11/17/2020	7:09:00 AM
BRTWD-1011	Classroom	N/A	Room 36	DW	11/17/2020	7:09:00 AM
BRTWD-1012	Kitchen	1043	Kitchen	KC	11/17/2020	5:28:00 AM
BRTWD-1013	Kitchen	1043	Kitchen	KC	11/17/2020	5:28:00 AM

Building Address

2 Mur Place

Brentwood, NY 11717

Pb 200.5 12/15/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Arling Castella

Arling Castella

Meghan Gulya



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062021458

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 6 of 6

OrderID: 062021458

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1014	Kitchen	1043	Kitchen	PK	11/17/2020	5:31:00 AM
BRTWD-1015	Kitchen	1043	Kitchen	KC	11/17/2020	5:31:00 AM
BRTWD-1016	Kitchen	1043	Kitchen	SN	11/17/2020	5:33:00 AM
BRTWD-1017	Kitchen	1043	Kitchen	KC	11/17/2020	5:33:00 AM
BRTWD-1018	Kitchen	1043	Kitchen	KC	11/17/2020	5:35:00 AM
BRTWD-1019	Kitchen	1043	Kitchen	HW	11/17/2020	5:35:00 AM
BRTWD-1020	Kitchen	1043	Kitchen	HW	11/17/2020	5:38:00 AM
BRTWD-1021	Bathroom	1043A	Kitchen Locker Room	BF	11/17/2020	5:38:00 AM
BRTWD-1023	Bathroom	N/A	Music Room Bathroom	BF	11/17/2020	7:14:00 AM
BRTWD-1024	Bathroom	N/A	Art Room Bathroom	BF	11/17/2020	7:15:00 AM

Samples Submitted 100

20 NOV 17 PM 12:55
ANALYTICAL, INC.
CARLE PLACE, NY

Building Address

2 Mur Place

Brentwood, NY 11717

Pb 200.5

12/15/2020

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Aline Gysse 114220

Aline Gysse

Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/17/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45270, Twin Pines Elementary School, Brentwood Union
Free School District, 2 Mur Place, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062021458. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0902 **Collected:** 11/17/2020 **Lab ID:** 062021458-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0903 **Collected:** 11/17/2020 **Lab ID:** 062021458-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0904 **Collected:** 11/17/2020 **Lab ID:** 062021458-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0905 **Collected:** 11/17/2020 **Lab ID:** 062021458-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0906 **Collected:** 11/17/2020 **Lab ID:** 062021458-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0907 **Collected:** 11/17/2020 **Lab ID:** 062021458-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0908 **Collected:** 11/17/2020 **Lab ID:** 062021458-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0909 **Collected:** 11/17/2020 **Lab ID:** 062021458-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0909 **Collected:** 11/17/2020 **Lab ID:** 062021458-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0911 **Collected:** 11/17/2020 **Lab ID:** 062021458-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0912 **Collected:** 11/17/2020 **Lab ID:** 062021458-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0913 **Collected:** 11/17/2020 **Lab ID:** 062021458-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0914 **Collected:** 11/17/2020 **Lab ID:** 062021458-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0915 **Collected:** 11/17/2020 **Lab ID:** 062021458-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0916 **Collected:** 11/17/2020 **Lab ID:** 062021458-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0917 **Collected:** 11/17/2020 **Lab ID:** 062021458-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	12/11/2020	AM	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0918 **Collected:** 11/17/2020 **Lab ID:** 062021458-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0919 **Collected:** 11/17/2020 **Lab ID:** 062021458-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0920 **Collected:** 11/17/2020 **Lab ID:** 062021458-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0921 **Collected:** 11/17/2020 **Lab ID:** 062021458-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.2	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0922 **Collected:** 11/17/2020 **Lab ID:** 062021458-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	12/11/2020	AM	12/15/2020	DI

Client Sample Description BRTWD-0923 **Collected:** 11/17/2020 **Lab ID:** 062021458-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0924 **Collected:** 11/17/2020 **Lab ID:** 062021458-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0924 **Collected:** 11/17/2020 **Lab ID:** 062021458-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0925 **Collected:** 11/17/2020 **Lab ID:** 062021458-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0926 **Collected:** 11/17/2020 **Lab ID:** 062021458-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0927 **Collected:** 11/17/2020 **Lab ID:** 062021458-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0928 **Collected:** 11/17/2020 **Lab ID:** 062021458-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0929 **Collected:** 11/17/2020 **Lab ID:** 062021458-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0930 **Collected:** 11/17/2020 **Lab ID:** 062021458-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0931 **Collected:** 11/17/2020 **Lab ID:** 062021458-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0932 **Collected:** 11/17/2020 **Lab ID:** 062021458-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0933 **Collected:** 11/17/2020 **Lab ID:** 062021458-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0934 **Collected:** 11/17/2020 **Lab ID:** 062021458-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0935 **Collected:** 11/17/2020 **Lab ID:** 062021458-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0936 **Collected:** 11/17/2020 **Lab ID:** 062021458-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0937 **Collected:** 11/17/2020 **Lab ID:** 062021458-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0938 **Collected:** 11/17/2020 **Lab ID:** 062021458-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0939 **Collected:** 11/17/2020 **Lab ID:** 062021458-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0940 **Collected:** 11/17/2020 **Lab ID:** 062021458-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0941 **Collected:** 11/17/2020 **Lab ID:** 062021458-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0947 **Collected:** 11/17/2020 **Lab ID:** 062021458-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0948 **Collected:** 11/17/2020 **Lab ID:** 062021458-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	280	6.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0949 **Collected:** 11/17/2020 **Lab ID:** 062021458-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0950 **Collected:** 11/17/2020 **Lab ID:** 062021458-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0950 **Collected:** 11/17/2020 **Lab ID:** 062021458-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0952 **Collected:** 11/17/2020 **Lab ID:** 062021458-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0953 **Collected:** 11/17/2020 **Lab ID:** 062021458-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0955 **Collected:** 11/17/2020 **Lab ID:** 062021458-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0963 **Collected:** 11/17/2020 **Lab ID:** 062021458-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	45	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0964 **Collected:** 11/17/2020 **Lab ID:** 062021458-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	350	6.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0965 **Collected:** 11/17/2020 **Lab ID:** 062021458-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0966 **Collected:** 11/17/2020 **Lab ID:** 062021458-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0966 **Collected:** 11/17/2020 **Lab ID:** 062021458-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0967 **Collected:** 11/17/2020 **Lab ID:** 062021458-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0968 **Collected:** 11/17/2020 **Lab ID:** 062021458-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0969 **Collected:** 11/17/2020 **Lab ID:** 062021458-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0970 **Collected:** 11/17/2020 **Lab ID:** 062021458-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0971 **Collected:** 11/17/2020 **Lab ID:** 062021458-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0972 **Collected:** 11/17/2020 **Lab ID:** 062021458-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0973 **Collected:** 11/17/2020 **Lab ID:** 062021458-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0973 **Collected:** 11/17/2020 **Lab ID:** 062021458-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0974 **Collected:** 11/17/2020 **Lab ID:** 062021458-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-0975 **Collected:** 11/17/2020 **Lab ID:** 062021458-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0976 **Collected:** 11/17/2020 **Lab ID:** 062021458-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0977 **Collected:** 11/17/2020 **Lab ID:** 062021458-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0979 **Collected:** 11/17/2020 **Lab ID:** 062021458-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0980 **Collected:** 11/17/2020 **Lab ID:** 062021458-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0981 **Collected:** 11/17/2020 **Lab ID:** 062021458-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0981 **Collected:** 11/17/2020 **Lab ID:** 062021458-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0982 **Collected:** 11/17/2020 **Lab ID:** 062021458-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.2	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0983 **Collected:** 11/17/2020 **Lab ID:** 062021458-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0984 **Collected:** 11/17/2020 **Lab ID:** 062021458-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0985 **Collected:** 11/17/2020 **Lab ID:** 062021458-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.5	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0986 **Collected:** 11/17/2020 **Lab ID:** 062021458-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0987 **Collected:** 11/17/2020 **Lab ID:** 062021458-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0988 **Collected:** 11/17/2020 **Lab ID:** 062021458-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0988 **Collected:** 11/17/2020 **Lab ID:** 062021458-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0989 **Collected:** 11/17/2020 **Lab ID:** 062021458-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0990 **Collected:** 11/17/2020 **Lab ID:** 062021458-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.6	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0991 **Collected:** 11/17/2020 **Lab ID:** 062021458-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0996 **Collected:** 11/17/2020 **Lab ID:** 062021458-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-0997 **Collected:** 11/17/2020 **Lab ID:** 062021458-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1000 **Collected:** 11/17/2020 **Lab ID:** 062021458-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1001 **Collected:** 11/17/2020 **Lab ID:** 062021458-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1001 **Collected:** 11/17/2020 **Lab ID:** 062021458-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1002 **Collected:** 11/17/2020 **Lab ID:** 062021458-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1003 **Collected:** 11/17/2020 **Lab ID:** 062021458-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1004 **Collected:** 11/17/2020 **Lab ID:** 062021458-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1005 **Collected:** 11/17/2020 **Lab ID:** 062021458-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1006 **Collected:** 11/17/2020 **Lab ID:** 062021458-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1007 **Collected:** 11/17/2020 **Lab ID:** 062021458-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1008 **Collected:** 11/17/2020 **Lab ID:** 062021458-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1008 **Collected:** 11/17/2020 **Lab ID:** 062021458-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1009 **Collected:** 11/17/2020 **Lab ID:** 062021458-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1010 **Collected:** 11/17/2020 **Lab ID:** 062021458-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1011 **Collected:** 11/17/2020 **Lab ID:** 062021458-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1012 **Collected:** 11/17/2020 **Lab ID:** 062021458-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1013 **Collected:** 11/17/2020 **Lab ID:** 062021458-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1014 **Collected:** 11/17/2020 **Lab ID:** 062021458-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1015 **Collected:** 11/17/2020 **Lab ID:** 062021458-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/17/2020 12:55 PM
 Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1015 **Collected:** 11/17/2020 **Lab ID:** 062021458-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	12/14/2020	OR	12/15/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-1016 **Collected:** 11/17/2020 **Lab ID:** 062021458-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1017 **Collected:** 11/17/2020 **Lab ID:** 062021458-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1018 **Collected:** 11/17/2020 **Lab ID:** 062021458-0095

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1019 **Collected:** 11/17/2020 **Lab ID:** 062021458-0096

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1020 **Collected:** 11/17/2020 **Lab ID:** 062021458-0097

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1021 **Collected:** 11/17/2020 **Lab ID:** 062021458-0098

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1023 **Collected:** 11/17/2020 **Lab ID:** 062021458-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062021458

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 11/17/2020 12:55 PM
Collected: 11/17/2020

Project: #19-45270, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-1023 **Collected:** 11/17/2020 **Lab ID:** 062021458-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Client Sample Description BRTWD-1024 **Collected:** 11/17/2020 **Lab ID:** 062021458-0100

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/14/2020	OR	12/15/2020	DI

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062105801

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~19-45270~~ 21-48246

Building: Twin Pines Elementary School

TWIN

Client:

Brentwood Union Free School District

Retest/New Install ☒Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2999	NO	1038	Nurse's Office Back Office	NS	3/26/2021	7:11:00 AM

Samples Submitted 1

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAR 27 PM 3:25

Building Address

2 Mur Place

Brentwood, NY 11717

P6200.5 ~

Alvin Lundy 04/02/21

Analysis Type: ELAP 200.5 *RD*Lab Received: *Unique Mucci*Signature: *um 3/27/21 3:25pm*Samplers Name: *Meghan Gwynn*Samplers Signature: *Meghan Gwynn*JCB Project Manager: *Meghan Gwynn*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

4/6/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/27/2021. The results are tabulated on the attached data pages for the following client designated project:

Twin Pines Elementary School, 2 Mur Place, Brentwood, NY
11717, Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062105801. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062105801

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 3/27/2021 03:25 PM
Collected: 3/26/2021

Project: **Twin Pines Elementary School, 2 Mur Place, Brentwood, NY 11717, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-2999 **Collected:** 3/26/2021 **Lab ID:** 062105801-0001
Nurses office Back Office

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	4/1/2021	DI	4/2/2021	AL
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: Twin Pines Elementary School

TWIN

062108231

Client:

Brentwood Union Free School District

Retest/New Install: ☒

Turn Around: Normal 1 wk Rush ☐

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0964	Classroom	1052	Room 18	DW	5/6/2021	7:59:00 AM

Samples Submitted 1

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 6 PM 2:51

Building Address

2 Mur Place

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: 5/6/21 @ 2:51 pm

Signature:

Samplers Name: Alexandra Orlassino

Samplers Signature: Alexandra Orlassino

JCB Project Manager: Meghan Gwynn

OrderID: 062108231



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/6/2021. The results are tabulated on the attached data pages for the following client designated project:

Brentwood Union Free School District. Twin Pines Elementary
School.TWIN. JCB # 19-45270

The reference number for these samples is EMSL Order #062108231. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108231

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 05/06/21 2:51 PM
Collected: 5/6/2021

Project: **Brentwood Union Free School District. Twin Pines Elementary School.TWIN. JCB # 19-45270**

Analytical Results

Client Sample Description BRTWD - 0964**Collected:** 5/6/2021**Lab ID:** 062108231-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: ~~40-45270~~ 21-48246

Building: Twin Pines Elementary School

TWIN

062110635

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-0920	Classroom	1007	Kindergarten Room 6	DW	6/17/2021	6:44:00 AM
BRTWD-0963	Classroom	1052	Room 18	CF	6/17/2021	6:39:00 AM
BRTWD-0964	Classroom	1052	Room 18	DW	6/17/2021	6:41:00 AM

Samples Submitted 3

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4:03

Page 1 of 1

Building Address

2 Mur Place

Brentwood, NY 11717

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Sampler's Name: *Alina Castellano*

Sampler's Signature: *Alina Castellano*

JCB Project Manager: *Meghan Gwynn*

OrderID: 062110635



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, Twin Pines Elementary School, Brentwood Union
Free School District, 2 Mur Place, Brentwood, NY 11717

The reference number for these samples is EMSL Order #062110635. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110635

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:03 PM
Collected: 6/17/2021

Project: #21-48246, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood, NY 11717

Analytical Results

Client Sample Description BRTWD-0920 **Collected:** 6/17/2021 **Lab ID:** 062110635-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Client Sample Description BRTWD-0963 **Collected:** 6/17/2021 **Lab ID:** 062110635-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-0964 **Collected:** 6/17/2021 **Lab ID:** 062110635-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53405

Building: Twin Pines Elementary School

TWIN

062224977

Page 1 of 1

Client:

Brentwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3043	HA	1044	Corridor Kitchen to Faculty Bathrooms	WC	12/6/2022	6:35:00 AM
BRTWD-3044	HA	1044	Corridor Kitchen to Faculty Bathrooms	WF	12/6/2022	6:36:00 AM
BRTWD-3045	HA	1044	Corridor Kitchen to Faculty Bathrooms	WC	12/6/2022	6:32:00 AM
BRTWD-3046	HA	1044	Corridor Kitchen to Faculty Bathrooms	WF	12/6/2022	6:33:00 AM

Samples Submitted 4

Pb 200.5

Berni Akhtar 12/10/22

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 DEC -6 P 2:56

Building Address

2 Mur Place

Brentwood, NY 11717

Analysis Type: ELAP 200.5

Lab Received: Alex Hsiao / 12/6/22

Signature: [Signature] / 2:56 PM

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Guynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/12/2022

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/6/2022. The results are tabulated on the attached data pages for the following client designated project:

#: 22-53405, Twin Pines Elementary School, Brentwood Union
Free School District, 2 Mur Place, Brentwood NY 11717

The reference number for these samples is EMSL Order #062224977. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

James Han, Chemistry Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062224977

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/6/2022 02:56 PM
Collected: 12/6/2022

Project: #: 22-53405, Twin Pines Elementary School, Brentwood Union Free School District, 2 Mur Place, Brentwood NY 11717

Analytical Results

Client Sample Description BRTWD-3043 **Collected:** 12/6/2022 **Lab ID:** 062224977-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3044 **Collected:** 12/6/2022 **Lab ID:** 062224977-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3045 **Collected:** 12/6/2022 **Lab ID:** 062224977-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Client Sample Description BRTWD-3046 **Collected:** 12/6/2022 **Lab ID:** 062224977-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	12/9/2022	CM	12/10/2022	BA

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: West Middle School

WMS

062023207

Page 1 of 4

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1938	Bathroom	1000	Men's Bathroom	BF	12/9/2020	5:56:00 AM
BRTWD-1939	Bathroom	1000	Men's Bathroom	BF	12/9/2020	5:56:00 AM
BRTWD-1941	Bathroom	1001	Women's Bathroom	BF	12/9/2020	5:58:00 AM
BRTWD-1942	Hallway	1002	Corridor Near Auditorium	DW	12/9/2020	5:59:00 AM
BRTWD-1947	Hallway	1026	Corridor Near Room 124 (1016)	DW	12/9/2020	6:01:00 AM
BRTWD-1953	Classroom	1017	Room 121	CF	12/9/2020	6:02:00 AM
BRTWD-1954	Classroom	1018	Room 122	CF	12/9/2020	6:03:00 AM
BRTWD-1955	Office	1019	Guidance Office	BW	12/9/2020	6:04:00 AM
BRTWD-1956	Hallway	1026	Corridor Near Student Management Office (1023)	DW	12/9/2020	6:06:00 AM
BRTWD-1961	Hallway	N/A	Corridor Near Bathrooms	WC	12/9/2020	6:09:00 AM
BRTWD-1962	Hallway	N/A	Corridor Near Bathrooms	WC	12/9/2020	6:09:00 AM
BRTWD-1970	Hallway	N/A	Corridor Near Room 148	WC	12/9/2020	6:12:00 AM
BRTWD-1971	Hallway	N/A	Corridor Near Room 148	WC	12/9/2020	6:12:00 AM
BRTWD-1972	Bathroom	1027B	Faculty Room Women's Bathroom	BF	12/9/2020	6:15:00 AM
BRTWD-1973	Faculty Lounge	1027	Faculty Room	CF	12/9/2020	6:15:00 AM
BRTWD-1974	Bathroom	1027A	Faculty Room Men's Bathroom	BF	12/9/2020	6:16:00 AM
BRTWD-1975	Hallway	1050	Corridor Near Faculty Room (1027)	DW	12/9/2020	6:17:00 AM
BRTWD-1976	Bathroom	1028	Boys Bathroom	BF	12/9/2020	6:18:00 AM

Building Address

2030 Udall Road

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Aurora McDonald 1/18/21

[Signature]

Arika Castle
Aurora McDonald
Meghan Gwynn

OrderID: 062023207

Page 1 Of 4



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: West Middle School

WMS

062023207

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1977	Nurse Office	1029	Nurse's Office	NS	12/9/2020	6:21:00 AM
BRTWD-1978	Nurse Office	1029C	Nurse's Office - Inner Office	NS	12/9/2020	6:22:00 AM
BRTWD-1979	Bathroom	1029A	Nurse's Bathroom	BF	12/9/2020	6:23:00 AM
BRTWD-1982	Hallway	1050	Corridor Near Girls Locker Room (1030)	DW	12/9/2020	6:24:00 AM
BRTWD-1985	Locker Room	1035B	Girls Locker Room	DW	12/9/2020	6:29:00 AM
BRTWD-1986	Bathroom	1035B1A	Girls Coach's Office Bathroom	BF	12/9/2020	6:31:00 AM
BRTWD-1987	Kitchen	1033	Kitchen	KC	12/9/2020	5:43:00 AM
BRTWD-1988	Kitchen	1033	Kitchen	KC	12/9/2020	5:43:00 AM
BRTWD-1989	Kitchen	1033	Kitchen	HW	12/9/2020	5:46:00 AM
BRTWD-1990	Kitchen	1033	Kitchen	KC	12/9/2020	5:46:00 AM
BRTWD-1991	Kitchen	1033	Kitchen	SN	12/9/2020	5:47:00 AM
BRTWD-1992	Kitchen	1033	Kitchen	KC	12/9/2020	5:47:00 AM
BRTWD-1993	Kitchen	1033	Kitchen	PK	12/9/2020	5:49:00 AM
BRTWD-1994	Kitchen	1033	Kitchen	KC	12/9/2020	5:49:00 AM
BRTWD-1995	Kitchen	1033	Kitchen	HW	12/9/2020	5:50:00 AM
BRTWD-1997	Bathroom	1033B	Kitchen Bathroom	BF	12/9/2020	5:51:00 AM
BRTWD-1998	Hallway	1050	Corridor Near Cafeteria (1034)	DW	12/9/2020	6:32:00 AM
BRTWD-1999	Bathroom	1036A	Custodial Office Bathroom	BF	12/9/2020	6:34:00 AM

Building Address

2030 Udall Road

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: File

Signature: [Signature]

Samplers Name: Alina Castelli

Samplers Signature: [Signature]

JCB Project Manager: Meghan Gwynn

Auppa McDonald 1/18/21



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270

Building: West Middle School

WMS

062023207

Client:

Brentwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2000	Locker Room	1035A	Boys Locker Room	DW	12/9/2020	6:36:00 AM
BRTWD-2003	Bathroom	1035A4A	Boys Coach's Office Bathroom	BF	12/9/2020	6:38:00 AM
BRTWD-2004	Hallway	1050	Corridor Near Room 110 (1039)	DW	12/9/2020	6:40:00 AM
BRTWD-2005	Home Economics	1043	Room 106	EC	12/9/2020	6:42:00 AM
BRTWD-2006	Home Economics	1043	Room 106	EC	12/9/2020	6:42:00 AM
BRTWD-2007	Home Economics	1043	Room 106	EC	12/9/2020	6:42:00 AM
BRTWD-2012	Home Economics	1047	Room 104	EC	12/9/2020	6:44:00 AM
BRTWD-2013	Home Economics	1047	Room 104	EC	12/9/2020	6:44:00 AM
BRTWD-2014	Home Economics	1047	Room 104	EC	12/9/2020	6:45:00 AM
BRTWD-2015	Home Economics	1047	Room 104	EC	12/9/2020	6:45:00 AM
BRTWD-2016	Home Economics	1043A	Room 104/106 Laundry Room	EC	12/9/2020	6:46:00 AM
BRTWD-2017	Hallway	1050	Corridor Near Room 104 (1047)	DW	12/9/2020	6:47:00 AM
BRTWD-2026	Bathroom	2040	Men's Bathroom	BF	12/9/2020	6:57:00 AM
BRTWD-2027	Bathroom	2040	Men's Bathroom	BF	12/9/2020	6:57:00 AM
BRTWD-2028	Hallway	2043	Corridor Near Room 202 (2041)	DW	12/9/2020	7:00:00 AM
BRTWD-2033	Bathroom	2038	Women's Bathroom	BF	12/9/2020	7:01:00 AM
BRTWD-2039	Hallway	2043	Corridor Near Room 210 (2031)	DW	12/9/2020	7:03:00 AM
BRTWD-2040	Office	2022A	Library Work Room	CF	12/9/2020	7:05:00 AM

Building Address

2030 Udall Road

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: A. J. Castellano

Samplers Signature: A. J. Castellano

JCB Project Manager: Meghan Gwynn

Amy McDonald 1/18/21



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: West Middle School
WMS

062023207

Client: Brentwood Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-2041	Hallway	2043	Corridor Near Room 216 (2021)	DW	12/9/2020	7:06:00 AM
BRTWD-2042	Hallway	2019	Corridor Near Room 220 (2016)	DW	12/9/2020	7:07:00 AM
BRTWD-2043	Classroom	2010	Room 226	CF	12/9/2020	7:09:00 AM
BRTWD-2044	Classroom	2009	Room 223	CF	12/9/2020	7:10:00 AM
BRTWD-2047	Hallway	2019	Corridor Near Room 228 (2008)	DW	12/9/2020	7:11:00 AM
BRTWD-2049	Bathroom	2005	Boys Bathroom	BF	12/9/2020	7:13:00 AM
BRTWD-2050	Bathroom	2005	Boys Bathroom	BF	12/9/2020	7:13:00 AM
BRTWD-2051	Bathroom	2005	Boys Bathroom	BF	12/9/2020	7:13:00 AM
BRTWD-2053	Bathroom	2003	Girls Bathroom	BF	12/9/2020	7:15:00 AM
BRTWD-2054	Bathroom	2003	Girls Bathroom	BF	12/9/2020	7:15:00 AM
BRTWD-2060	Hallway	N/A	Corridor Near Bathrooms	WC	12/9/2020	7:20:00 AM
BRTWD-2061	Hallway	N/A	Corridor Near Bathrooms	WC	12/9/2020	7:20:00 AM
BRTWD-2067	Hallway	N/A	Corridor Near Room 248	WC	12/9/2020	7:22:00 AM
BRTWD-2068	Hallway	N/A	Corridor Near Room 248	WC	12/9/2020	7:22:00 AM
BRTWD-2081	Gymnasium	N/A	Wrestling Room	DW	12/9/2020	7:28:00 AM
BRTWD-2082	Bathroom	N/A	Wrestling Room Bathroom	BF	12/9/2020	7:28:00 AM

Samples Submitted 70

Building Address

2030 Udall Road
Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: Chaele

Signature: [Signature]

Samplers Name: Alina Castellano

Samplers Signature: Alina Castellano

JCB Project Manager: Meghan Gwynn

Auppa Mohamed 11/18/21

DEC 9 2020
JCB
J.C. BRODERICK AND ASSOCIATES, INC.
1775 EXPRESSWAY NORTH
HAUPPAUGE, NY 11788
TEL: (631) 584-5492
FAX: (631) 584-3395



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/3/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/9/2020. The results are tabulated on the attached data pages for the following client designated project:

**19-45270, West Middle School, Brentwood Union Free School
District, 2030 Udall Road, Bay Shore, NY 11706**

The reference number for these samples is EMSL Order #062023207. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-1938 **Collected:** 12/9/2020 **Lab ID:** 062023207-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1939 **Collected:** 12/9/2020 **Lab ID:** 062023207-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1941 **Collected:** 12/9/2020 **Lab ID:** 062023207-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1942 **Collected:** 12/9/2020 **Lab ID:** 062023207-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1947 **Collected:** 12/9/2020 **Lab ID:** 062023207-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1953 **Collected:** 12/9/2020 **Lab ID:** 062023207-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1954 **Collected:** 12/9/2020 **Lab ID:** 062023207-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.0	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1955 **Collected:** 12/9/2020 **Lab ID:** 062023207-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-1955 **Collected:** 12/9/2020 **Lab ID:** 062023207-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1956 **Collected:** 12/9/2020 **Lab ID:** 062023207-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	37	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1961 **Collected:** 12/9/2020 **Lab ID:** 062023207-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1962 **Collected:** 12/9/2020 **Lab ID:** 062023207-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.5	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1970 **Collected:** 12/9/2020 **Lab ID:** 062023207-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1971 **Collected:** 12/9/2020 **Lab ID:** 062023207-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1972 **Collected:** 12/9/2020 **Lab ID:** 062023207-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-1973 **Collected:** 12/9/2020 **Lab ID:** 062023207-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1974 **Collected:** 12/9/2020 **Lab ID:** 062023207-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1975 **Collected:** 12/9/2020 **Lab ID:** 062023207-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1976 **Collected:** 12/9/2020 **Lab ID:** 062023207-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1977 **Collected:** 12/9/2020 **Lab ID:** 062023207-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1978 **Collected:** 12/9/2020 **Lab ID:** 062023207-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1979 **Collected:** 12/9/2020 **Lab ID:** 062023207-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1982 **Collected:** 12/9/2020 **Lab ID:** 062023207-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-1982 **Collected:** 12/9/2020 **Lab ID:** 062023207-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1985 **Collected:** 12/9/2020 **Lab ID:** 062023207-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1986 **Collected:** 12/9/2020 **Lab ID:** 062023207-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1987 **Collected:** 12/9/2020 **Lab ID:** 062023207-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1988 **Collected:** 12/9/2020 **Lab ID:** 062023207-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1989 **Collected:** 12/9/2020 **Lab ID:** 062023207-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-1990 **Collected:** 12/9/2020 **Lab ID:** 062023207-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/14/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-1991 **Collected:** 12/9/2020 **Lab ID:** 062023207-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description		BRTWD-1991		Collected:	12/9/2020	Lab ID:	062023207-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-1992		Collected:	12/9/2020	Lab ID:	062023207-0030	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1993		Collected:	12/9/2020	Lab ID:	062023207-0031	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-1994		Collected:	12/9/2020	Lab ID:	062023207-0032	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-1995		Collected:	12/9/2020	Lab ID:	062023207-0033	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-1997		Collected:	12/9/2020	Lab ID:	062023207-0034	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-1998		Collected:	12/9/2020	Lab ID:	062023207-0035	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	1/14/2021	AM	1/18/2021	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description		BRTWD-1999		Collected:	12/9/2020	Lab ID:	062023207-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2000		Collected:	12/9/2020	Lab ID:	062023207-0037	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2003		Collected:	12/9/2020	Lab ID:	062023207-0038	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2004		Collected:	12/9/2020	Lab ID:	062023207-0039	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2005		Collected:	12/9/2020	Lab ID:	062023207-0040	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	1/14/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2006		Collected:	12/9/2020	Lab ID:	062023207-0041	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2007		Collected:	12/9/2020	Lab ID:	062023207-0042	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-2012 **Collected:** 12/9/2020 **Lab ID:** 062023207-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2013 **Collected:** 12/9/2020 **Lab ID:** 062023207-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2014 **Collected:** 12/9/2020 **Lab ID:** 062023207-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2015 **Collected:** 12/9/2020 **Lab ID:** 062023207-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2016 **Collected:** 12/9/2020 **Lab ID:** 062023207-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	34	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2017 **Collected:** 12/9/2020 **Lab ID:** 062023207-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Lead MDL: 1.0µg/L

Client Sample Description BRTWD-2026 **Collected:** 12/9/2020 **Lab ID:** 062023207-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	27	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2027 **Collected:** 12/9/2020 **Lab ID:** 062023207-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-2027 **Collected:** 12/9/2020 **Lab ID:** 062023207-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2028 **Collected:** 12/9/2020 **Lab ID:** 062023207-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2033 **Collected:** 12/9/2020 **Lab ID:** 062023207-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2039 **Collected:** 12/9/2020 **Lab ID:** 062023207-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.4	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2040 **Collected:** 12/9/2020 **Lab ID:** 062023207-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L							

Client Sample Description BRTWD-2041 **Collected:** 12/9/2020 **Lab ID:** 062023207-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

Client Sample Description BRTWD-2042 **Collected:** 12/9/2020 **Lab ID:** 062023207-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	1/15/2021	AM	1/18/2021	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description		BRTWD-2043		Collected:	12/9/2020	Lab ID:	062023207-0057	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	44	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2044		Collected:	12/9/2020	Lab ID:	062023207-0058	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2047		Collected:	12/9/2020	Lab ID:	062023207-0059	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2049		Collected:	12/9/2020	Lab ID:	062023207-0060	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2050		Collected:	12/9/2020	Lab ID:	062023207-0061	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2051		Collected:	12/9/2020	Lab ID:	062023207-0062	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2053		Collected:	12/9/2020	Lab ID:	062023207-0063	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/18/2021	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062023207

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 04:05 AM
 Collected: 12/9/2020

Project: 19-45270, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description		BRTWD-2054		Collected:	12/9/2020	Lab ID:	062023207-0064	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2060		Collected:	12/9/2020	Lab ID:	062023207-0065	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2061		Collected:	12/9/2020	Lab ID:	062023207-0066	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2067		Collected:	12/9/2020	Lab ID:	062023207-0067	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2068		Collected:	12/9/2020	Lab ID:	062023207-0068	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								
Client Sample Description		BRTWD-2081		Collected:	12/9/2020	Lab ID:	062023207-0069	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Client Sample Description		BRTWD-2082		Collected:	12/9/2020	Lab ID:	062023207-0070	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	1/15/2021	AM	1/18/2021	AM
Lead MDL: 1.0µg/L								



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062023207
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45270
Building: West Middle School

WMS

062108227

Page 1 of 1

Client: Brentwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-1938	Bathroom	1000	Men's Bathroom	BF	5/6/2021	6:53:00 AM
BRTWD-1939	Bathroom	1000	Men's Bathroom	BF	5/6/2021	6:54:00 AM
BRTWD-1986	Bathroom	1035B1A	Girls Coach's Office Bathroom	BF	5/6/2021	6:44:00 AM
BRTWD-2016	Home Economics	1043A	Room 104/106 Laundry Room	EC	5/6/2021	6:47:00 AM
BRTWD-2043	Classroom	2010	Room 226	CF	5/6/2021	6:51:00 AM

Samples Submitted 5

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
21 MAY - 6 PM 2:51

Building Address
2030 Udall Road
Bay Shore, NY 11706

Analysis Type: ELAP 200.5
Lab Received: 5/6/21 @ 2:51pm
Signature: [Signature]

Samplers Name: Alexandria Orlassino
Samplers Signature: [Signature]
JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

5/13/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 5/6/2021. The results are tabulated on the attached data pages for the following client designated project:

**Brentwood Union Free School District. JCB # 19-45270. West
Middle School. WMS.**

The reference number for these samples is EMSL Order #062108227. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062108227

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hempstead, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 05/06/21 2:51 PM
 Collected: 5/6/2021

Project: Brentwood Union Free School District. JCB # 19-45270. West Middle School. WMS.

Analytical Results

Client Sample Description BRTWD - 1938 **Collected:** 5/6/2021 **Lab ID:** 062108227-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.1	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1939 **Collected:** 5/6/2021 **Lab ID:** 062108227-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 1986 **Collected:** 5/6/2021 **Lab ID:** 062108227-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Client Sample Description BRTWD - 2016 **Collected:** 5/6/2021 **Lab ID:** 062108227-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description BRTWD - 2043 **Collected:** 5/6/2021 **Lab ID:** 062108227-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	5/11/2021	DI	5/12/2021	AL

Lead MDL: 1.0µg/L

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: West Middle School

WMS

062110642

Client:

Brentwood Union Free School District

~~Retest~~/New Install []

Turn Around: Normal 1 wk Rush _____

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3001	Bathroom	2040	Mens Bathroom (Across Room 202)	BF	6/17/2021	6:57:00 AM

Samples Submitted 1

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 JUN 17 P 4: 01

Page 1 Of 1

Building Address

2030 Udall Road

Bay Shore, NY 11706

Alyssa McDonald 6/18/21

Analysis Type: ELAP 200.5

Lab Received: *Alyssa McDonald*

Signature: *Alyssa McDonald*

Sampler's Name: *Alexandria Orlassino*

Sampler's Signature: *A Orlassino*

JCB Project Manager: *Meghan Gwynn*

OrderID: 062110642



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

6/18/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 6/17/2021. The results are tabulated on the attached data pages for the following client designated project:

#21-48246, West Middle School, Brentwood Union Free School
District, 2030 Udall Road, Bay Shore, NY 11706

The reference number for these samples is EMSL Order #062110642. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062110642

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 06/17/21 4:01 PM
Collected: 6/17/2021

Project: #21-48246, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-3001 **Collected:** 6/17/2021 **Lab ID:** 062110642-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	6/18/2021	AM	6/18/2021	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062121664 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: West Middle School

WMS

Client:

Brentwood Union Free School District

Retest/New Install MTurn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3004	CR	2023	Room 214 Life Skills	EC	10/28/2021	7:14:00 AM

Samples Submitted 1

16 200.5
Tung
11/2/21

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
2021 OCT 28 P 12:06

Building Address

2030 Udall Road

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: Unique MeraSignature: WMSSamplers Name: Meghan GwynnSamplers Signature: Meghan GwynnJCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

11/2/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/28/2021. The results are tabulated on the attached data pages for the following client designated project:

West Middle School, 2030 Udall Road, Bay Shore, NY 11706,
Brentwood Union Free School District, 21-48246

The reference number for these samples is EMSL Order #062121664. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Dominique Iaccarino, Chemistry Lab Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062121664

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/28/2021 12:06 PM
Collected: 10/28/2021

Project: **West Middle School, 2030 Udall Road, Bay Shore, NY 11706, Brentwood Union Free School District, 21-48246**

Analytical Results

Client Sample Description BRTWD-3004 **Collected:** 10/28/2021 **Lab ID:** 062121664-0001
Room 214 Life Skills

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/2/2021	TH	11/2/2021	TH
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

062218235

Page 1 of 1



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246

Building: West Middle School

WMS

Client:

Brentwood Union Free School District

Retest/New Install ☒ DS

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3008	HA	1026	Corridor Near Student Management Office (1023)	WF	8/23/2022	7:37:00 AM

Samples Submitted 1

Pb 200.5
[Signature]
 8/29/22

RECEIVED
 EMSL ANALYTICAL, INC.
 CARLE PLACE, NY
 2022 AUG 23 P 12: 24



Building Address

2030 Udall Road

Bay Shore, NY 11706

Analysis Type: ELAP 200.5

Lab Received: 8/23/22 @ 12:24pm

Signature: *[Signature]*Samplers Name: Meghan GwynnSamplers Signature: *[Signature]*JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

8/29/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/23/2022. The results are tabulated on the attached data pages for the following client designated project:

JCB #: 21-48246, West Middle School, WMS, Brentwood Union
Free School District, 2030 Udall Road Bay Shore, NY 11706

The reference number for these samples is EMSL Order #062218235. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062218235

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 8/23/2022 12:24 PM
Collected: 8/23/2022

Project: JCB #: 21-48246, West Middle School, WMS, Brentwood Union Free School District, 2030 Udall Road Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-3008 **Collected:** 8/23/2022 **Lab ID:** 062218235-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	8/29/2022	CM	8/29/2022	CM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 21-48246
Building: West Middle School

WMS

Client:

Brentwood Union Free School District

Retest ☒ New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BRTWD-3009	HA	1026	Corridor Near Room 124 (1016)	WF	10/19/2022	7:13:00 AM
BRTWD-3010	HA	1026	Corridor Near Room 124 (1016)	WC	10/19/2022	7:12:00 AM
BRTWD-3038	HA	1050	Corridor Near Cafeteria (1034)	WC	10/19/2022	7:10:00 AM
BRTWD-3039	HA	1050	Corridor Near Cafeteria (1034)	WF	10/19/2022	7:10:00 AM
BRTWD-3040	HA	2043	Corridor Near Room 216 (2021)	WF	10/19/2022	7:18:00 AM
BRTWD-3041	HA	2019	Corridor Near Room 228 (2008)	WC	10/19/2022	7:20:00 AM
BRTWD-3042	HA	2019	Corridor Near Room 228 (2008)	WF	10/19/2022	7:21:00 AM

Samples Submitted 7

062222242

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2022 OCT 19 P 12:56

Building Address

2030 Udall Road

Bay Shore, NY 11706



Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: Meghan Gwynn

Samplers Signature: _____

JCB Project Manager: Meghan Gwynn



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Meghan Gwynn
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

10/22/2022

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/19/2022. The results are tabulated on the attached data pages for the following client designated project:

**#21-48246, West Middle School, Brentwood Union Free School
District, 2030 Udall Road, Bay Shore, NY 11706**

The reference number for these samples is EMSL Order #062222242. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Daniel Clarke, Asbestos Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062222242

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Meghan Gwynn**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/19/2022 12:56 PM
 Collected: 10/19/2022

Project: #21-48246, West Middle School, Brentwood Union Free School District, 2030 Udall Road, Bay Shore, NY 11706

Analytical Results

Client Sample Description BRTWD-3009 **Collected:** 10/19/2022 **Lab ID:** 062222242-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3010 **Collected:** 10/19/2022 **Lab ID:** 062222242-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3038 **Collected:** 10/19/2022 **Lab ID:** 062222242-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3039 **Collected:** 10/19/2022 **Lab ID:** 062222242-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3040 **Collected:** 10/19/2022 **Lab ID:** 062222242-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<12 DN	12 µg/L	10/21/2022	CM	10/22/2022	CM

Client Sample Description BRTWD-3041 **Collected:** 10/19/2022 **Lab ID:** 062222242-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Client Sample Description BRTWD-3042 **Collected:** 10/19/2022 **Lab ID:** 062222242-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	10/21/2022	CM	10/21/2022	CM

Lead MDL: 1.0µg/L



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062222242

CustomerID: JCBR50

CustomerPO:

ProjectID:

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

Attachment 3:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

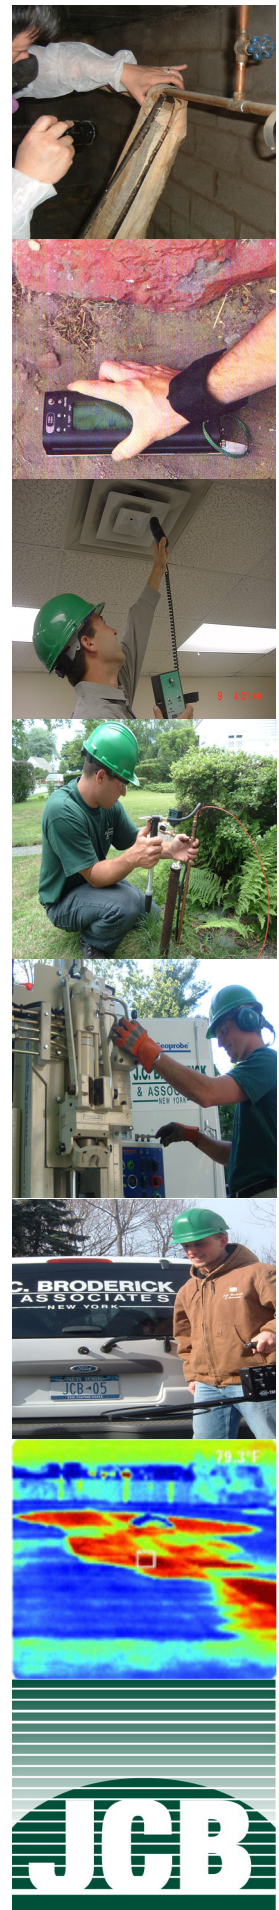

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2023
Issued April 01, 2022
Revised August 16, 2022

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Department
of Health

Serial No.: 65459

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

